


PARKS AND RECREATION
 DESIGN AND DEVELOPMENT
 October 19, 2011

CITY OF BELLINGHAM
 TRAIL SECTION
 3/8" = 1'-0"

DRAWING
 2505.01

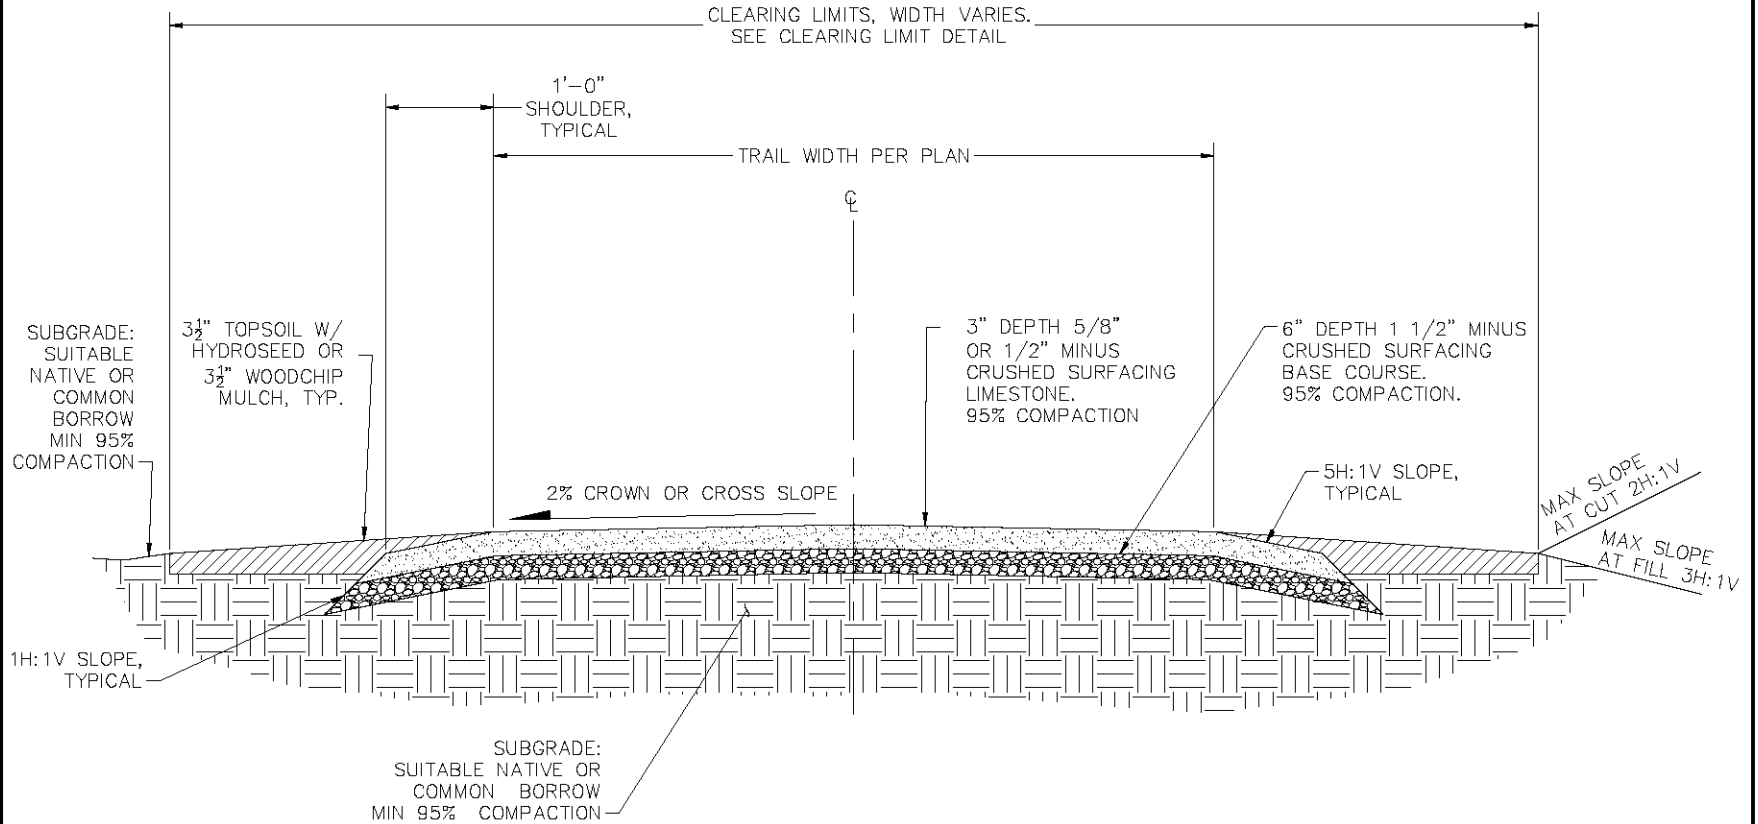

NOTES:

- A. WHERE TRAIL IS LOCATED OVER BURIED UTILITIES, THE ENTIRE TRENCH SHALL BE BACKFILLED WITH IMPORTED GRAVEL AND COMPACTED TO 95% MAXIMUM DENSITY.
- B. SECTION SHOWN IS FOR TYPICAL CONDITIONS. TRAIL MAY BE MODIFIED TO ACCOMMODATE SITE SPECIFIC REQUIREMENTS.
- C. DRAINAGE DITCH PARALLEL TO TRAIL MAY BE REQUIRED FOR STORM WATER DESIGN. MINIMUM WIDTH OF DITCH IS 3 FT OR AS APPROVED BY PARKS AND RECREATION. BANK SLOPE EACH SIDE OF CENTERLINE OF DITCH WITH MAX SIDE SLOPES OF 4H:1V
- D. CRUSHED SURFACING BASE COURSE DEPTH AND SIZE OF AGGREGATE SHOWN IS MINIMUM REQUIREMENT. ACTUAL SIZE AGGREGATE MAY VARY PER SITE SPECIFIC CONDITIONS.
- E. STAKE ALIGNMENT AND CLEARING LIMITS IN THE FIELD PRIOR TO CLEARING. VIOLATORS WILL BE FINED. BMC 13.40.150
- F. SUBGRADE COMPACTION MUST BE CERTIFIED BY A GEOTECHNICAL ENGINEER.