


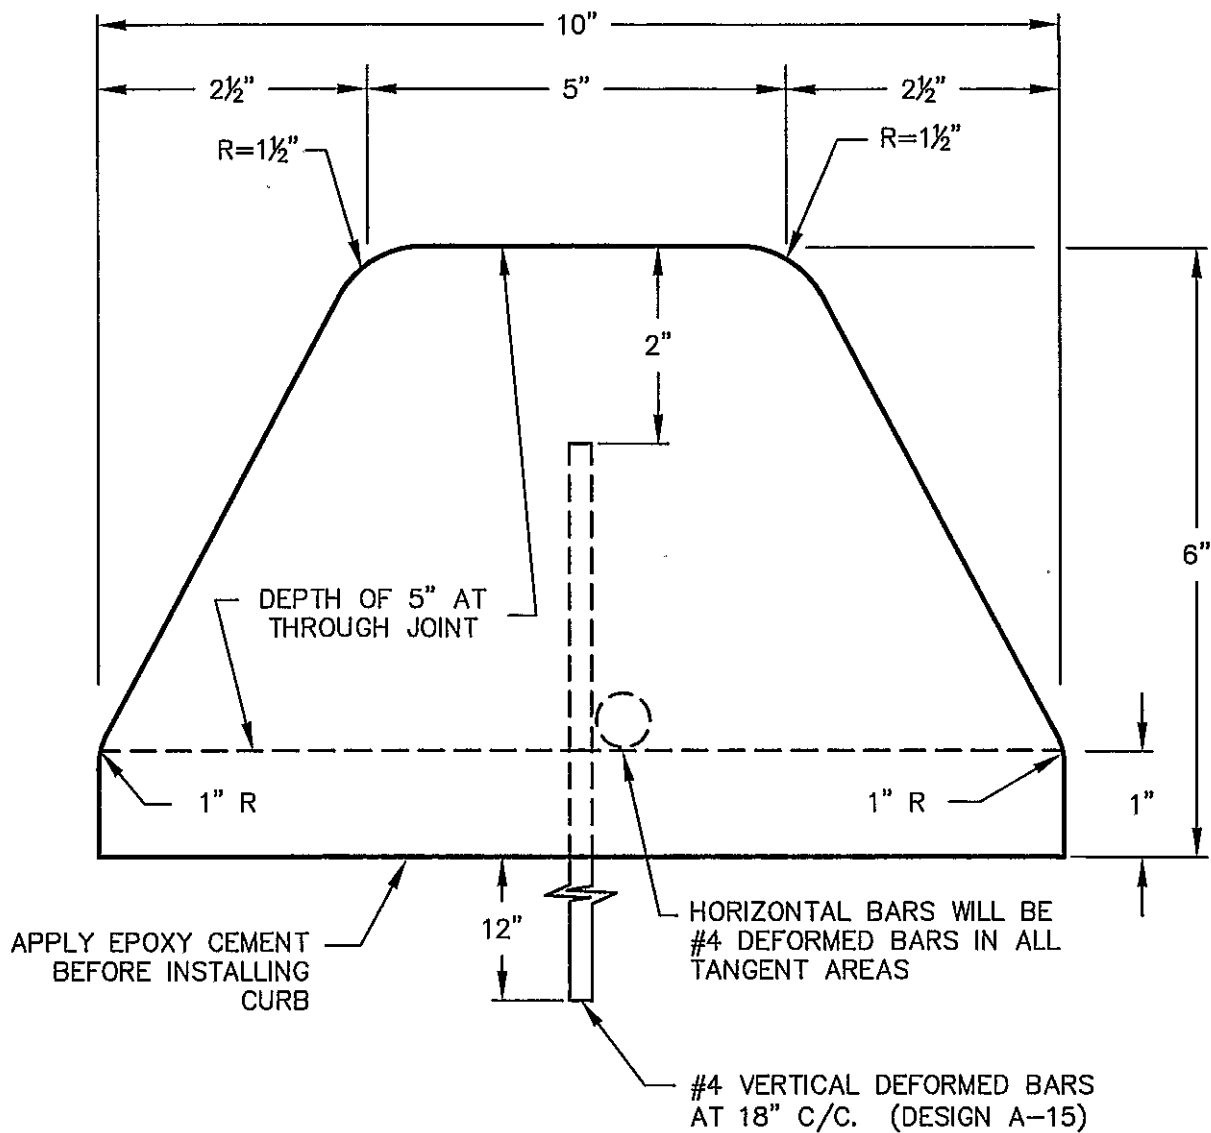

JOINTS:

JOINTS SHALL BE PLACED AT 10' INTERVALS.
JOINTS SHALL BE CUT VERTICALLY AND TO A
DEPTH OF 5 INCHES.

APPROVED

Ray J. Poulter
City Engineer

11/29/04
Date

CITY OF BELLINGHAM
EXTRUDED CEMENT
CONCRETE CURB

DRAWING
CG-212