


MARK 2"x4" STAKE WITH "DRAIN" AND DEPTH TO PIPE INVERT FROM FINISHED GROUND LEVEL.

2"x4" STAKE BURIED TO DEPTH OF PIPE INVERT, EXTEND A MINIMUM OF 3' ABOVE GRADE. PAINT WHITE ABOVE GROUND.

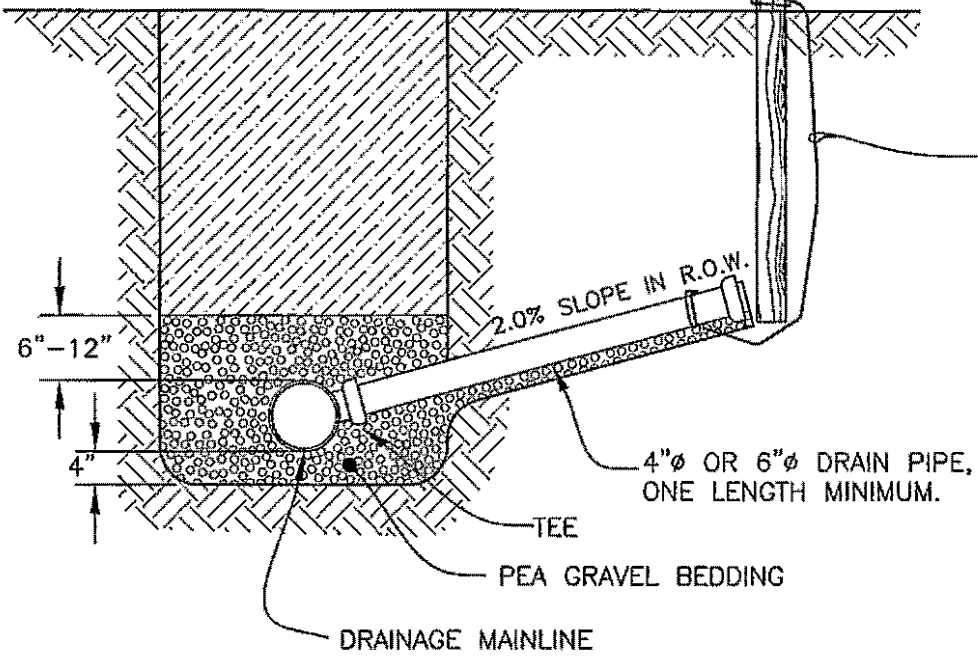


8 GAUGE, WHITE COATED WIRE, TO BE DOUBLED AROUND PIPE AND 2"x4" STAKE AT OR ABOVE FINISHED GRADE.

NOTES:

1. UNLESS OTHERWISE INDICATED ON PLAN, SIDE SERVICE SHALL BE LOWER THAN THE LOWEST LOT ELEVATION.
2. WHEN REPLACING EXISTING SIDE SERVICE, CONTRACTOR SHALL VERIFY POSITIVE FALL, OTHER EXISTING CONNECTIONS, AND SAGS OR DEFLECTIONS IN PIPE, AS PER ASTM F 1743 8.6.

NOT TO SCALE

<p>APPROVED</p>  <p>City Engineer</p> <p style="text-align: right;">4-28-05 Date</p>	<p style="text-align: center;">CITY OF BELLINGHAM</p> <p style="text-align: center;">STORM DRAIN SIDE SERVICE</p>	<p style="text-align: center;">DRAWING</p> <p style="text-align: center;">DR-530</p>
---	---	--