


# TYPE "A" MONOLITHIC RETAINING WALL AND SIDEWALK

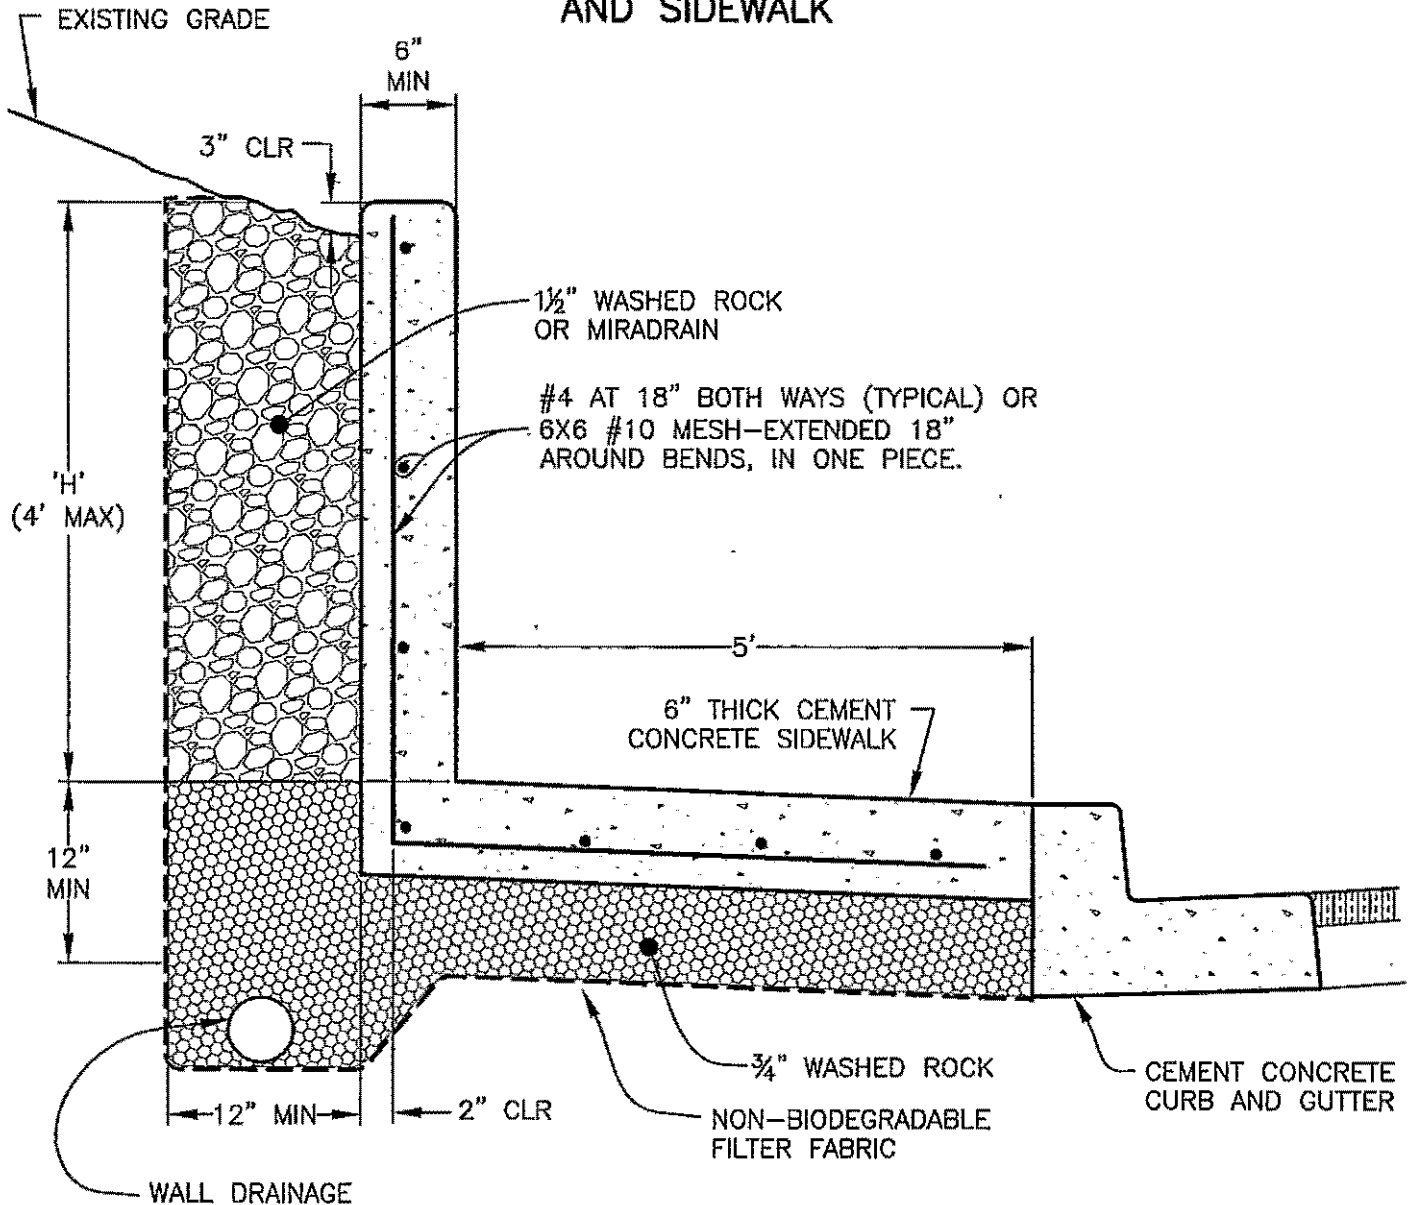

## **NOTES:**

1. PLACE JOINTS AS FOR SIDEWALKS OR AS DIRECTED BY THE ENGINEER.
2. 'H' TO BE AS DIRECTED BY ENGINEER. REBAR NOT REQUIRED FOR WALL PLACED ON LIGHT BASES OR WHERE 'H' < 14".
3. 3/4" CHAMFER AT EXPOSED CORNERS.

APPROVED

*Randy Partha*  
City Engineer

*11/29/04*  
Date

CITY OF BELLINGHAM  
LOW RETAINING WALLS

DRAWING  
MS-1005