



WRAP PIPE WITH 1/8"
RED RUBBER OR
NEOPRENE.

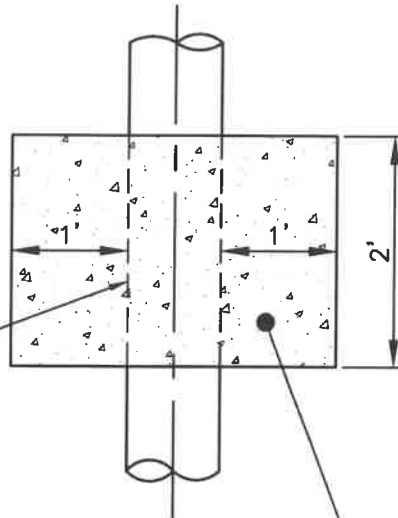

PLAN

CAST-IN-PLACE CONCRETE

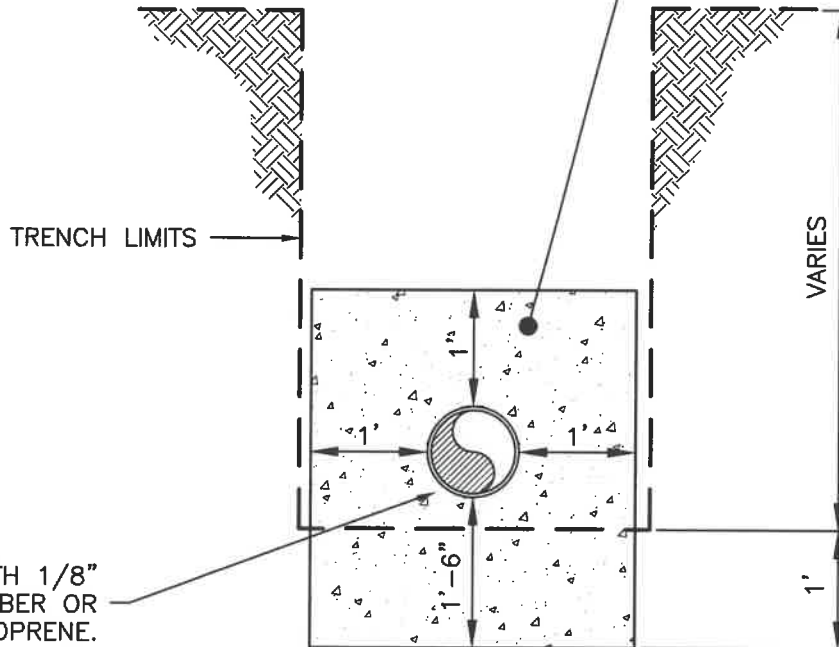

SECTION

NOTES:

1. MAXIMUM SPACING BETWEEN PIPE ANCHORS SHALL BE 36'.
2. PIPE ANCHORS SHALL BE PLACED SO THAT 1' OF THE ANCHOR WILL BE BELOW THE TRENCH LIMITS ON UNDISTURBED GROUND.
3. CONCRETE ANCHORS SHALL BE PROVIDED WHEN REQUIRED PER WASHINGTON STATE DEPARTMENT OF ECOLOGY'S CRITERIA FOR SEWAGE WORKS DESIGN, LATEST EDITION, SECTION C1-4.4.

NOT TO SCALE

APPROVED

City Engineer

22 May 2023
Date

CITY OF BELLINGHAM

PIPE ANCHOR

DRAWING

SS-760