


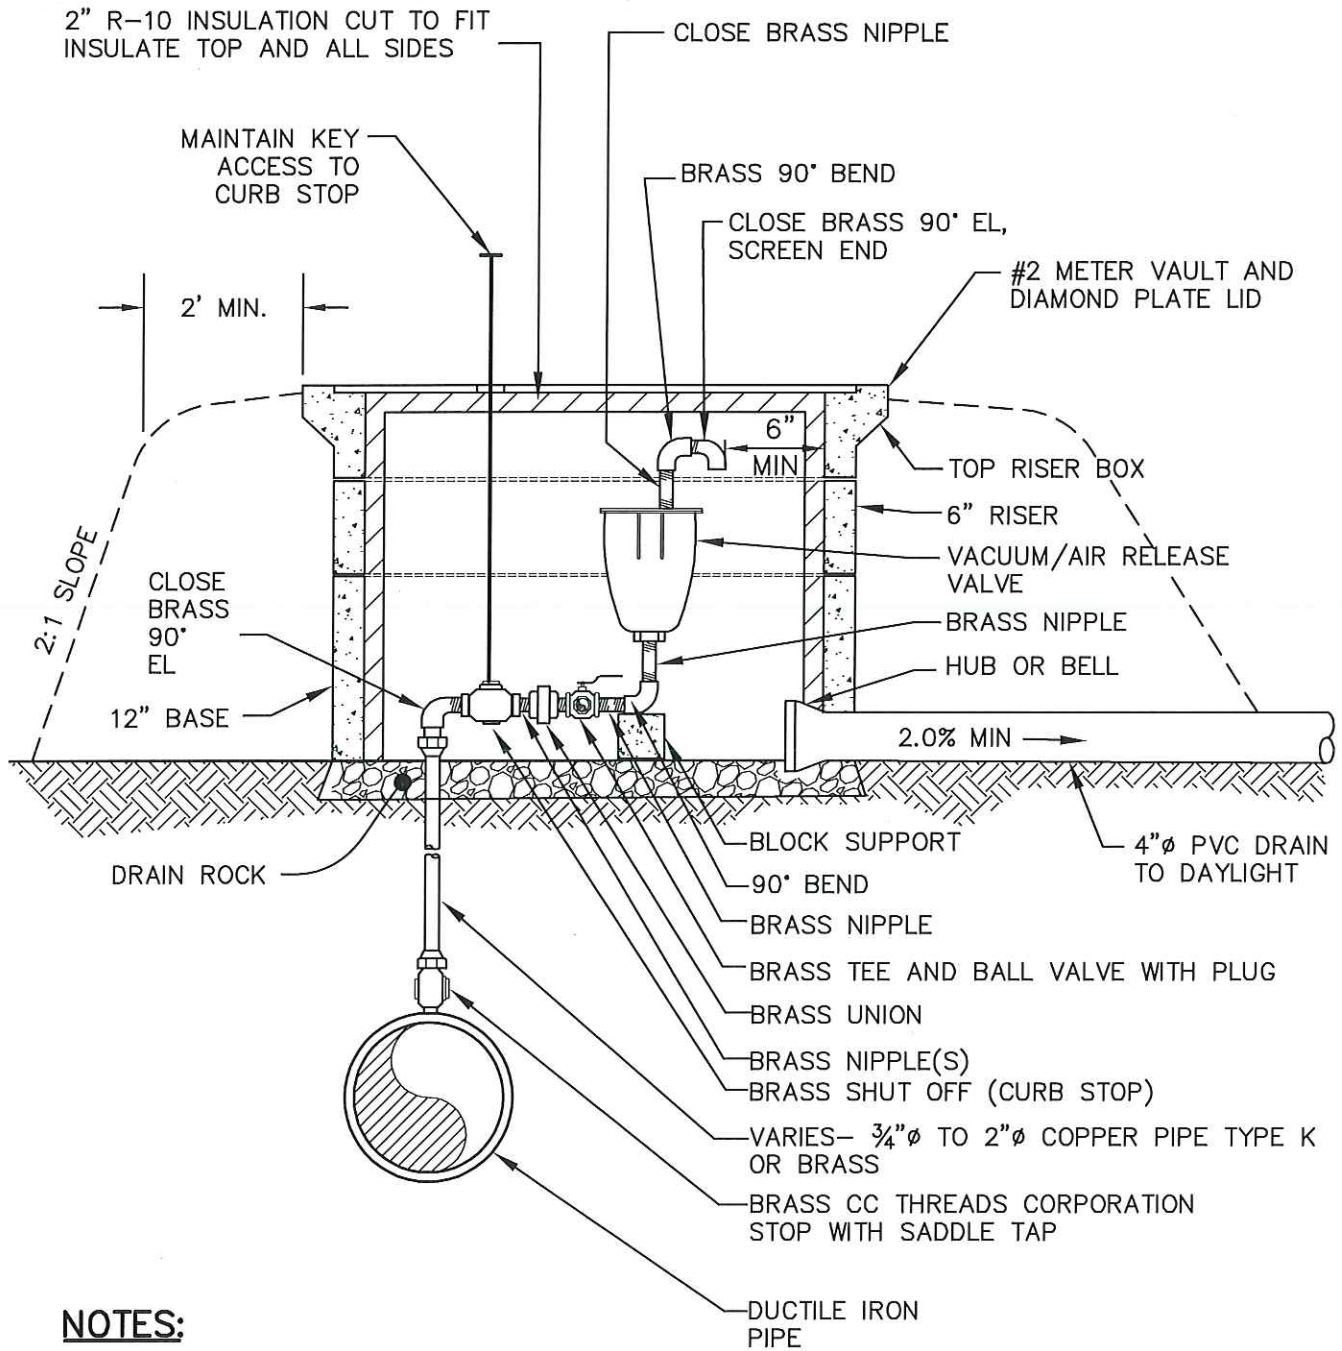

NOTES:

1. MAINTAIN CONSTANT RISE IN PIPING.

APPROVED

[Signature]

City Engineer

4 APR 2017

Date

CITY OF BELLINGHAM
TYPICAL VACUUM/AIR
RELEASE VALVE—ABOVE GROUND

DRAWING

WA-817