


NOTE:

- BOTH DIRECT TAP OR TAPPING CLAMP WITH SADDLE MUST USE COPPER THREADED CORPORATIONS.
- WATER SERVICE TRENCH TO BE BACKFILLED WITH 24" MIN. DEPTH OF CLEAN SANDY FILL

PROFILE VIEW
NTS

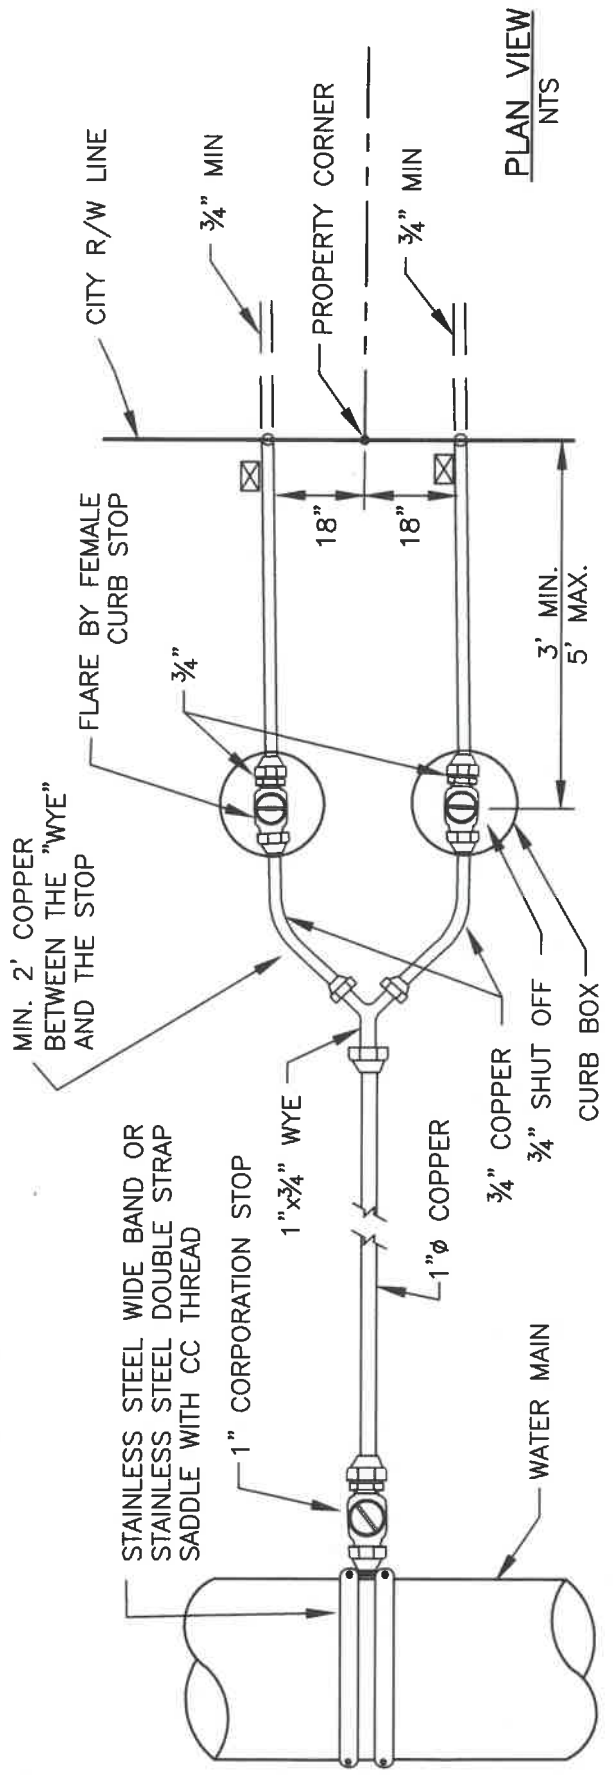

PLAN VIEW
NTS

APPROVED

 City Engineer
 20 July 2020
 Date

CITY OF BELLINGHAM
 OPTIONAL DUAL WATER SERVICE
 DETAIL

DRAWING
 WA-826