


NOTES:


1. POTHOLE TAP LOCATION TO IDENTIFY POSSIBLE CONFLICTS WITH BELL JOINTS.
2. 2' MIN CLEARANCE FROM BELL TO TAP LOCATION.
3. CONTRACTOR TO PROVIDE SHORING FOR EXCAVATION OVER 4' DEEP. ADJUST TRENCH DIMENSIONS TO ALLOW FOR MIN CLEARANCE WITH SHORING.
4. CONTRACTOR TO PROVIDE TRENCH SUMP AND PUMPING IF NEEDED FOR DEWATERING.
5. SPACING FOR MORE THAN ONE SERVICE TAP SHALL BE 1' FOR DUCTILE AND 2' FOR CAST IRON.

CROSS SECTION

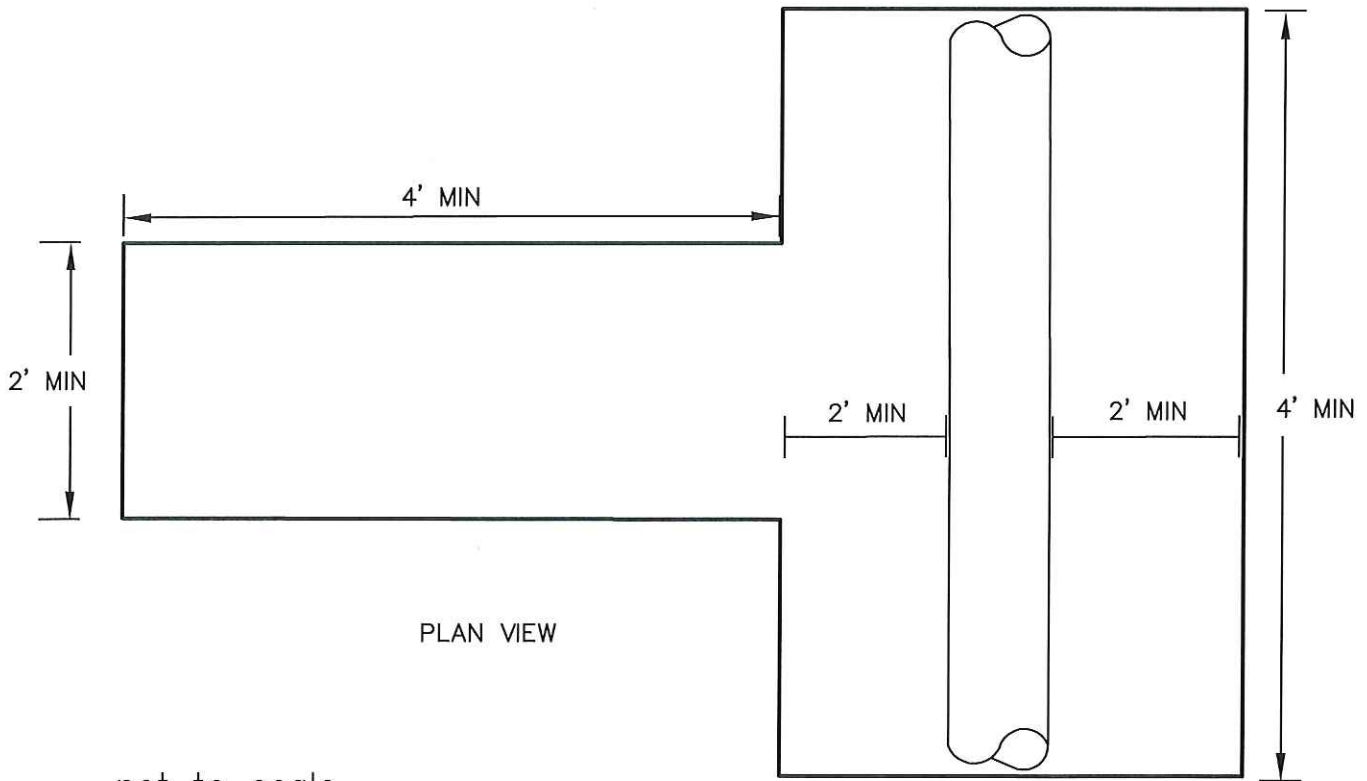

PLAN VIEW

not to scale

<p>APPROVED</p>  <p>City Engineer</p> <p><u>26 APR 2017</u> Date</p>	<p>CITY OF BELLINGHAM WATER TAP EXCAVATION UNDER 4"</p>	<p>DRAWING WA-874</p>
--	---	---------------------------