

BEDDING SPECIFICATIONS FOR DUCTILE IRON PIPE


THE FOLLOWING SUPPLEMENTAL SPECIFICATIONS ARE TO BE USED IN CONJUNCTION WITH THE STANDARD SPECIFICATIONS FOR ROAD, BRIDGE AND MUNICIPAL CONSTRUCTION, CURRENT EDITION:

BEDDING FOR WATERMAINS FOR DUCTILE IRON PIPE—

BEDDING MATERIAL FOR DUCTILE IRON PIPE SHALL CONFORM TO THE FOLLOWING SPECIFICATIONS.

PIPE ZONE BEDDING — BEDDING SHALL BE A CLEAN GRANULAR MATERIAL FREE FROM ORGANIC MATTER AND CONFORMING TO THE STANDARD SPECIFICATION: 9-03.12(3), GRAVEL BACKFILL FOR PIPE ZONE BEDDING.

BACKFILL — WHEREVER A TRENCH IS EXCAVATED IN THE EXISTING OR PROPOSED ROADWAY, SIDEWALK OR OTHER AREAS WHERE SETTLEMENT WOULD BE DETRIMENTAL, THE ENTIRE TRENCH SHALL BE BACKFILLED WITH IMPORTED GRAVEL AND COMPACTED TO 95% OF MAXIMUM DENSITY.

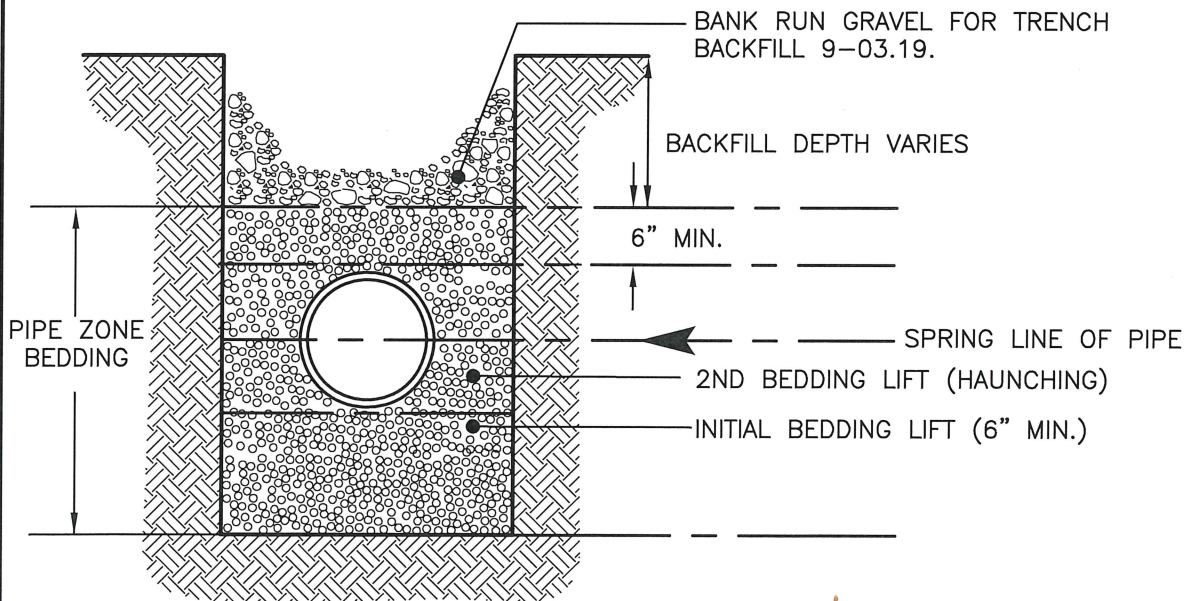

APPROVED

City Engineer

12 SEPT 2016

Date

CITY OF BELLINGHAM

WATER PIPE BEDDING
DETAILS

DRAWING

WA-820