


APPROVED
City Engineer *Thad Roberts*

Date *12/28/09*

CITY OF BELLINGHAM
TYPICAL WATER SERVICE
ON PRIVATE PROPERTY

DRAWING
WA-828

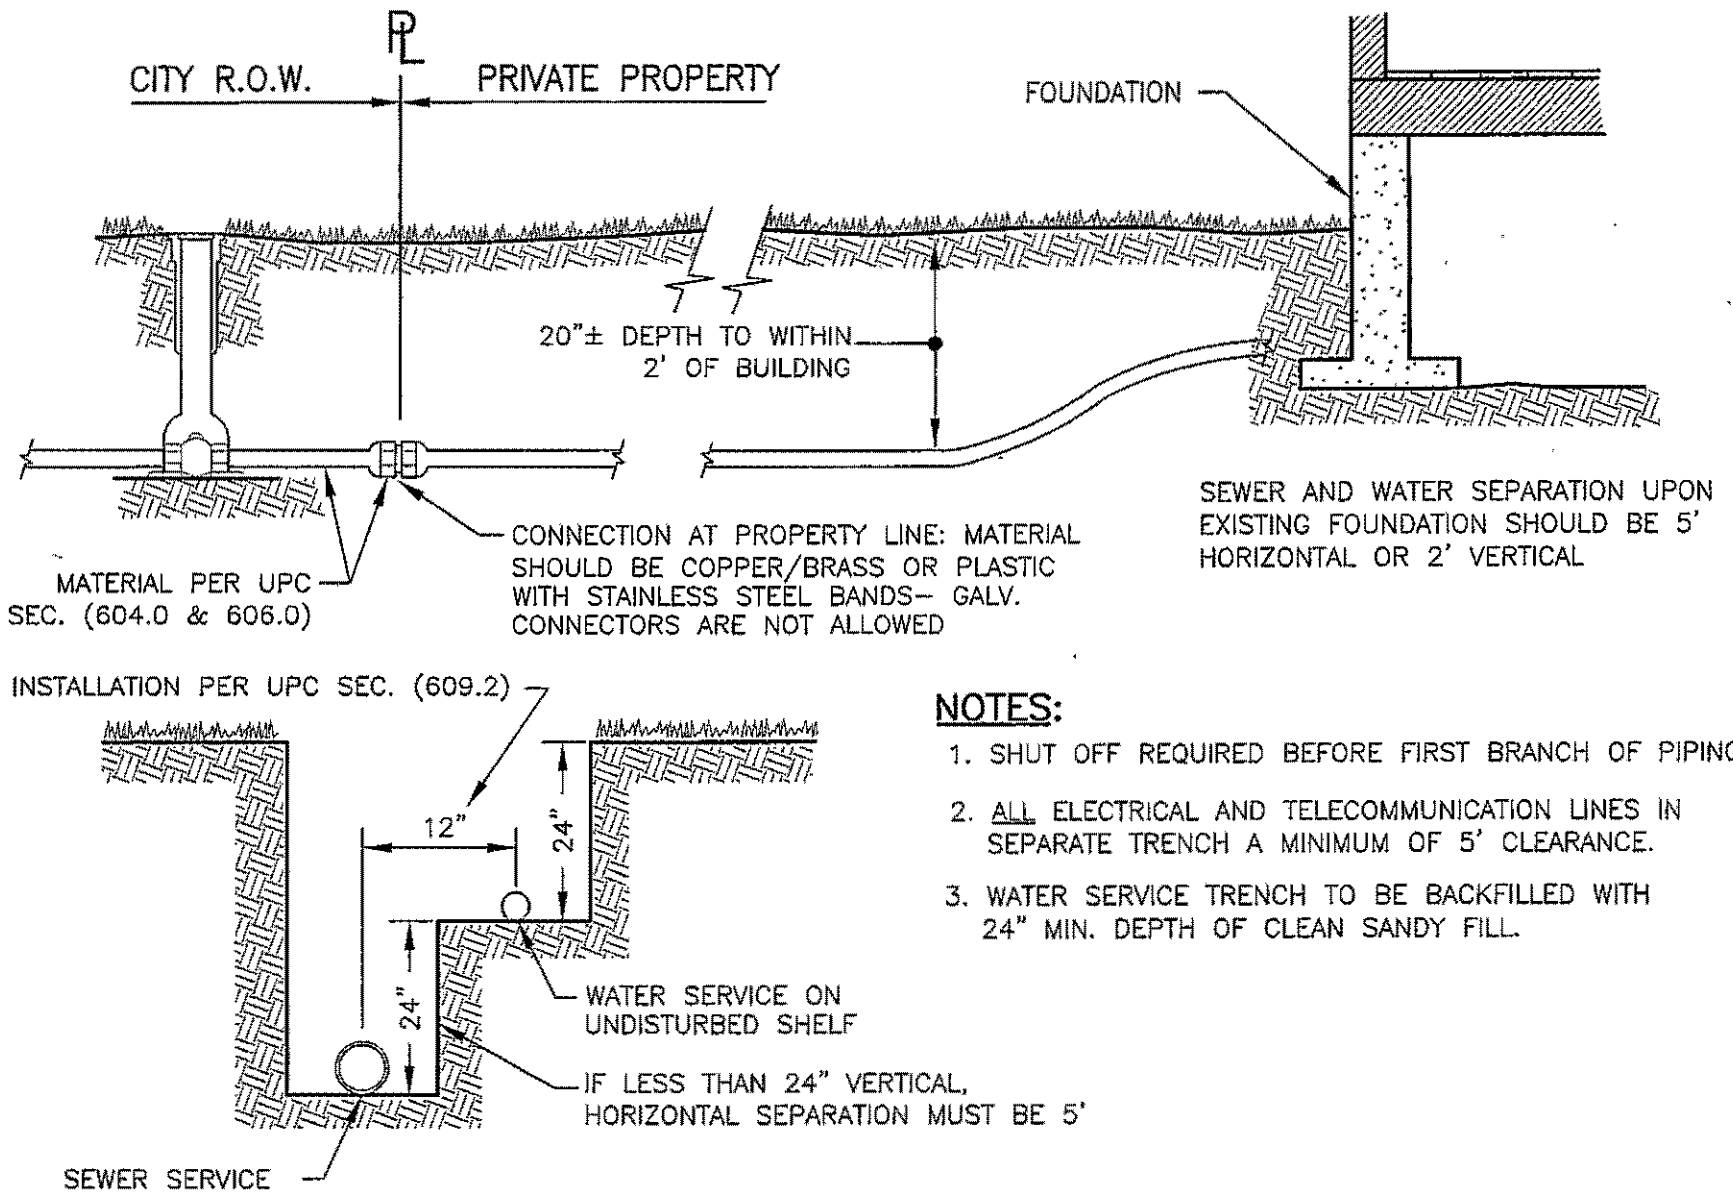

- NOTES:**
1. SHUT OFF REQUIRED BEFORE FIRST BRANCH OF PIPING.
 2. ALL ELECTRICAL AND TELECOMMUNICATION LINES IN SEPARATE TRENCH A MINIMUM OF 5' CLEARANCE.
 3. WATER SERVICE TRENCH TO BE BACKFILLED WITH 24" MIN. DEPTH OF CLEAN SANDY FILL.