Preliminary Stormwater Management Report

THE WOODS AT VIEWCREST



Photo Courtesy of the WSDOE Coastal Atlas

February 28th, 2022

Prepared by:

Pacific Surveying and Engineering Services, Inc. 909 Squalicum Way, Suite 11 Bellingham, Washington 98225 (360) 671-7387

www.psesurvey.com

Prepared for:

Ann C. Jones Family 807 Chuckanut Shore Road Bellingham, Washington 98229

1 TABLE OF CONTENTS

1	TA	ABLE O	F CONTENTS	1
2	CE	ERTIFIC	ATION	3
3	IN	TRODU	CTION	4
	3.1	PURPO	SE AND OBJECTIVES	4
	3.2	PROJE	CT BACKGROUND	4
4	E)	CISTING	CONDITIONS	5
•	4.1		JSE & ZONING	
	4.2		ATION.	
	4.3		NG SOIL CONDITIONS	
	4.4		GRAPHY & DRAINAGE	
5	ST	ORMW	ATER SYSTEM EVALUATION	6
	5.1		IPROVEMENTS	
	5.2		CONTROL	
	5.3	WATER	QUALITY	6
6	М	NIMUM	STORMWATER MANAGEMENT REQUIREMENTS	7
	6.1		REMENT NO. 1 – PREPARE STORMWATER SITE PLANS	
		6.1.1	COLLECT AND ANALYZE EXISTING CONDITIONS INFORMATION	7
		6.1.2	PREPARE PRELIMINARY DEVELOPMENT LAYOUT	
		6.1.3	PERFORM OFF-SITE ANALYSIS	7
		6.1.4	DETERMINE APPLICABLE MINIMUM REQUIREMENTS	8
		6.1.5	PREPARE A PERMANENT STORMWATER CONTROL PLAN	8
	6.	1.5 (1) EX	(ISTING SITE HYDROLOGY	8
	6.	1.5 (2) DI	EVELOPED SITE HYDROLOGY	8
	6.	1.5 (3) PI	ERFORMANCE STANDARDS AND GOALS	8
			OW CONTROL SYSTEM	
		` '	ATER QUALITY SYSTEM	
		` '	DNVEYANCE SYSTEM ANALYSIS AND DESIGN	
	0.	6.1.6	PREPARE A CONSTRUCTION STORM WATER POLLUTION PREVENTION PLAN	
		6.1.7	COMPLETE THE STORM WATER SITE PLAN	
		6.1.8	CHECK COMPLIANCE WITH ALL APPLICABLE MINIMUM REQUIREMENTS	
	6.2		REMENT NO. 2 – CONSTRUCTION STORMWATER POLLUTION PREVENTION (SWPPP)	
		6.2.1	ELEMENT #1 - MARK CLEARING LIMITS	
		6.2.2	ELEMENT #2 - ESTABLISH CONSTRUCTION ACCESS	9
		6.2.3	ELEMENT #3 - CONTROL FLOW RATES	10
		6.2.4	ELEMENT #4 - INSTALL SEDIMENT CONTROLS	10
		6.2.5	ELEMENT #5 - STABILIZE SOILS	10
		6.2.6	ELEMENT #6 - PROTECT SLOPES	11
		6.2.7	ELEMENT #7 - PROTECT DRAIN INLETS	
		6.2.8	ELEMENT #8 - STABILIZE CHANNELS AND OUTLETS	12
		6.2.9	ELEMENT #9 - CONTROL POLLUTANTS	12
		6.2.10	ELEMENT #10 - CONTROL DE-WATERING	
		6.2.11	ELEMENT #11 - MAINTAIN BMPS	13

		6.2.12 ELEMENT #12 - MANAGE THE PROJECT	13
		6.2.13 ELEMENT #13 – PROTECT LOW IMPACT DEVELOPMENT BMP'S	14
	6.3	REQUIREMENT NO. 3 – SOURCE CONTROL OF POLLUTION	14
	6.4	REQUIREMENT NO. 4 – PRESERVATION OF NATURAL DRAINAGE SYSTEMS AND OUTFALLS	15
	6.5	REQUIREMENT NO. 5 - ON-SITE STORM WATER MANAGEMENT	15
	6.6	REQUIREMENT NO. 6 - RUNOFF TREATMENT	16
	6.7	REQUIREMENT NO. 7 – FLOW CONTROL	16
	6.8	REQUIREMENT NO. 8 – WETLANDS PROTECTION	16
	6.9	REQUIREMENT NO. 9 – OPERATION AND MAINTENANCE	17
7	PR	RINCIPAL FINDINGS AND RECOMMENDATIONS	18
7 8		RINCIPAL FINDINGS AND RECOMMENDATIONS	18
-			
-	AP	PPENDIX19	19
-	AP 8.1	PPENDIX 19 VICINITY MAP	19
-	AP 8.1 8.2	PPENDIX 19 VICINITY MAP NRCS SOILS REPORT GEOLOGIC FEASABILITY INVESTIGATION BASIN MAP	19 20 21
-	8.1 8.2 8.3	PPENDIX 19 VICINITY MAP	19 20 21 22
-	8.1 8.2 8.3 8.4	PPENDIX 19 VICINITY MAP	1920212223
	8.1 8.2 8.3 8.4 8.5	PPENDIX 19 VICINITY MAP	1920212223

2 CERTIFICATION

ENGINEER'S DECLARATION

I, Jeff Vander Yacht, a Professional Engineer registered in the State of Washington as a Civil Engineer, do hereby declare that the Stormwater Design Report titled "Preliminary Stormwater Management Report – Jones Edgemoor Subdivision", dated February 28th, 2022, was prepared by me, or under my personal supervision, and that said Report was prepared in accordance with generally accepted engineering practices.

Respectfully,



Jeff Vander Yacht, P.E. Registration No. 37432 Pacific Surveying & Engineering

3 INTRODUCTION

3.1 PURPOSE AND OBJECTIVES

This preliminary storm water management report has been prepared on behalf of the Jones Family who is proposing to construct a 37-home residential development, and associated roads, driveways, and utilities. This report is provided as a general overview of the stormwater best management practices that will be implemented. This report is prepared to support the Preliminary Plat application review process.

The purpose of this report is to evaluate the impacts of the development regarding stormwater management, to detail the methods and assumptions used for this evaluation and present mitigation design recommendations.

Proposed measures include implementation of best management practices (BMP's) designed to assure post development conditions meet or exceed minimum requirements outlined by the City of Bellingham's Municipal Code (BMC) and applicable sections of the Washington State Department of Ecology "Storm Water Management Manual for Western Washington", 2019 publication (hereinafter referred to as the DOE Manual). This report functions as a combined 'Storm Water Management Plan' and 'Storm Water Pollution Prevention Plan' (SWPPP). A SWPPP has been developed within this report to detail temporary erosion control and stormwater pollution prevention requirements during construction.

3.2 PROJECT BACKGROUND

General information for this project is as follows:

PROJECT NAME: The Woods at Viewcrest

LOCATION: 807 Chuckanut Shore Road

Bellingham, WA 98229-8925

DESCRIPTION: Construction of two public roads, single family residential lots

and associated access and utility improvements.

OWNER: Ann C. Jones Family LP

807 Chuckanut Shore Rd, Bellingham, WA. 98229

Ph: (360)301-320-4145

ENGINEER & CONTACT: Jeff Vander Yacht, P.E.

Pacific Surveying & Engineering

909 Squalicum Way, Suite 111, Bellingham, WA. 98225

Ph: (360) 671-7387, Fax: (360) 671-4685

4 EXISTING CONDITIONS

4.1 LAND USE & ZONING

The project property is approximately 21 acres in the Edgemoor neighborhood in subarea 7 and is zoned as single-family residential. Residential housing is located to the north, east, and west of the project area, and the site is bounded by Viewcrest Rd to the north, S. Clarkwood Dr, to the west, and Sea Pines Rd to the east. The southern boundary of the property abuts Chuckanut Bay. A Vicinity Map showing the project location is included in Appendix 8.1.

4.2 VEGETATION

The site is currently undeveloped, and no structures exist within the project site. The site is primarily forested with wide variety of second growth timber, shrubs and herbaceous plants.

4.3 EXISTING SOIL CONDITIONS

In the vicinity of the proposed site improvements soils consist of mainly of Everett-Urban loam (unit 52) with a hydrologic soil group rating B per the NRCS Web Soil Survey. Minor areas of the project site are composed of Nati loam (Unit 110) with a hydrologic soil group rating C per NRCS Web Soil Survey. The complete NRCS soil survey can be found in Appendix 8.2

A Geologic Feasibility Investigation was prepared for this parcel of land by Element Solutions. That report is attached as Appendix 8.3.

4.4 TOPOGRAPHY & DRAINAGE

The topography is steep and generally slopes downward to the south towards Chuckanut Bay, with some slopes exceeding 30%. Stormwater from the site generally follows this flow path, and sheet flows directly to Chuckanut Bay. Two small portions of the site drain either to the north towards Viewcrest Dr or to the west towards S. Clarkwood drive and then drains into City of Bellingham storm sewers which discharges flows to Chuckanut Bay. The discharge locations for these basins are separated by a minimum of 0.38 miles, therefore the project site is separated into three Threshold Discharge Areas (TDA). The area of the site that sheet flows directly to Chuckanut Bay is contained within TDA 2, and the area that drains to the Viewcrest Rd storm sewer is contained within TDA 1, and the area draining to the west into S.Clarkwoood Dr is contained within TDA 3. See the Basin Map in Appendix 8.4.

We have reviewed the City of Bellingham's 2020 Surface and Stormwater Comprehensive Plan. No known conveyance deficiencies exist downstream of the Jones Edgemoor project between the outfall for TDA 1 and the discharge point of the city storm sewer into Chuckanut Bay.

5 STORMWATER SYSTEM EVALUATION

5.1 SITE IMPROVEMENTS

This project proposes to construct 37 single family homes, two public roads, sidewalks, one private road, driveways, and associated utilities. The project will result in approximately 51,951 SF of asphalt roadways and 11,320 SF of concrete sidewalk. In addition, this project proposes to meet water quality treatment requirements through the use of two modular wetland treatment systems.

5.2 FLOW CONTROL

Stormwater runoff from TDA 2 directly discharges into Chuckanut Bay, which a considered a flow control exempt saltwater body. Therefore, this TDA is exempt from flow control requirements per BMC 15.42. TDA 3 will not contain any proposed hard surfaces, therefore this TDA is exempt from flow control requirements. Site improvements associated with TDA 1 will result in more than 10,000 SF of hard surfaces triggering flow-control requirements. These requirements will be met through use of a subsurface detention vault coupled with a flow control system.

5.3 WATER QUALITY

This project proposes more than 5,000 SF of pollution generating new plus replaced impervious surfacing (including private on-site work permitted separately), therefore is subject to water quality requirements outlined in the BMC 15.42.

This project is required to meet basic water quality treatment standards per BMC 15.42. However, this project has elected to increase the level of stormwater treatment and meet the enhanced treatment level standard.

The project proposes enhanced treatment for the new and replaced pollution generating surfaces in each TDA through the use of two modular wetland devices. Each modular wetland device will be sized to meet the water quality treatment requirements for the area.

The proposed project includes constructing two public roads, single family residential lots and associated access and utility improvements. The project will result in 5,000 or more of pollution - generating impervious surfaces with portions of these surfaces outputting surface runoff to Chuckanut Bay.

6 MINIMUM STORMWATER MANAGEMENT REQUIREMENTS

This project proposes more than 5,000 SF of pollution generating new plus replaced impervious surfacing

Per BMC 15.42, this project is required to meet the Nine Minimum Stormwater Management Requirements. The nine minimum requirements have each been addressed as follows:

6.1 REQUIREMENT NO. 1 – PREPARE STORMWATER SITE PLANS

We have completed the requirements of a stormwater site plan per the WSDOE Manual. The required steps have been performed as follows:

6.1.1 COLLECT AND ANALYZE EXISTING CONDITIONS INFORMATION

Site visits were performed to determine the existing drainage conditions. Downstream conditions were investigated utilizing field surveyed topographic maps as well as site visit observations. See Section 4.4 above for a detailed description of existing site conditions.

6.1.2 PREPARE PRELIMINARY DEVELOPMENT LAYOUT

A preliminary site development plan has been prepared which shows the proposed access and drainage systems.

6.1.3 PERFORM OFF-SITE ANALYSIS

A qualitative off-site analysis has been completed in accordance with the WSDOE Manual. See section 4 above. Based on field observations and visual inspection of the downstream conveyance system, it is our determination that the proposed project will not adversely impact the existing stormwater systems.

The primary inflow to Chuckanut Bay is Chuckanut Creek, which is listed on the WSDOE 303(d) list of impaired water bodies. The water quality assessment fulfills the state's obligation to submit an integrated report to meet the Clean Water Act. It can be assumed that the water quality issues that effect Chuckanut Creek are also present in Chuckanut Bay. This project has included BMPs and stormwater treatment facilities in accordance with the DOE's 2019 SWMM for Western Washington and will not contribute to or exacerbate the identified water quality issues.

Parameter	Category	Mitigation
рН	2	BMP's will be implemented prior to installing materials that could affect pH, and great care will be taken to avoid pH-laden discharge of wastewater.
Dissolved Oxygen	5	The installation of a stormwater treatment system that meets or exceeds City of Bellingham standards will provide protection from adversely altering dissolved oxygen levels.
Bacteria	5	The installation of a stormwater treatment system and proper connections to the sanitary sewer system that meet or exceed City of Bellingham standards will provide protection from discharge of bacteria to the subject water

		bodies.
Temperature	2	The installation of a stormwater treatment system that meets or exceeds City of Bellingham standards will provide protection from adversely altering of discharge temperatures.

Table 6.1.2 –Chuckanut Creek Watershed assessment listing as filtered by Ecology's 303(d)/305(d) Integrated Report Viewer

6.1.4 DETERMINE APPLICABLE MINIMUM REQUIREMENTS

This project shall meet the nine minimum requirements for storm water management as outlined in BMC 15.42, which references the WSDOE Stormwater Management Manual for Western Washington, 2019 edition.

6.1.5 PREPARE A PERMANENT STORMWATER CONTROL PLAN

A permanent storm water control plan has been developed and presented herein, in accordance with the guidelines outlined in the Section 3.1.5, Volume I of the WSDOE Manual.

6.1.5 (1) EXISTING SITE HYDROLOGY

Existing conditions are explained in detail in Section 4. Geotechnical Report and Drainage Basin Exhibits can be found in Appendixes 8.2 and 8.4 respectively.

6.1.5 (2) DEVELOPED SITE HYDROLOGY

Proposed improvements to the site are discussed in Section 5 and detailed in Appendix 8.4 of this report. Drainage Basin Exhibits and Geotechnical Report can be found in Appendixes 8.2 and 8.3 respectively.

6.1.5 (3) PERFORMANCE STANDARDS AND GOALS

The project is a New Development Project that proposes more than 10,000 SF of new plus replaced impervious surface area and over 5,000 SF of new pollution generating impervious surface area. Based on the proposed improvements areas Minimum Requirements 1-9 apply to the project.

6.1.5 (4) FLOW CONTROL SYSTEM

TDA 2 – Chuckanut Bay is not subject to flow control requirements as it discharges directly to a flow control exempt water body. TDA 3 – S Clarkwood Dr will not contain any new plus replaced hard surfaces and will not be subject to flow control requirements. TDA 1 – Viewcrest Rd proposes more than 10,000 SF of new plus replaced impervious surfacing and will require flow control. A detention vault and flow control system will be used to ensure post-developed runoff does not exceed pre-developed rates.

6.1.5 (5) WATER QUALITY SYSTEM

The project is subject to water quality system requirements as this project results in more than 5,000 square feet of pollution generating new plus replaced impervious surface per the WSDOE Manual. In TDA 2 – Chuckanut Bay, a modular wetland is proposed to meet water quality requirements for all proposed pollution generating hard surfaces in the area. In TDA 1 – Viewcrest Road, a modular wetland device is proposed to meet water quality

requirements for all proposed pollution generating hard surfaces in the area. Both facilities will be sized to treat a minimum of 91% of the runoff for this project. In TDA 3-S Clarkwood Dr, no pollution generating surfaces are proposed and therefore water quality treatment will not be required.

6.1.5 (6) CONVEYANCE SYSTEM ANALYSIS AND DESIGN

Stormwater Conveyance systems within the project area have been sized to adequately convey stormwater runoff from the site.

6.1.6 PREPARE A CONSTRUCTION STORM WATER POLLUTION PREVENTION PLAN

Construction Storm Water Pollution Prevention Plan (SWPPP) and temporary erosion and sediment controls will be implemented, See section 6.2 below, during the construction of the project. Permanent storm water control shall be implemented in the completed project as outlined above in Section 6.1.5 of this report.

6.1.7 COMPLETE THE STORM WATER SITE PLAN

A Preliminarily Storm Water Site Plan has been prepared according to the WSDOE Manual.

6.1.8 CHECK COMPLIANCE WITH ALL APPLICABLE MINIMUM REQUIREMENTS

The storm water management facilities proposed in this report comply with all of the applicable standards of the WSDOE Manual.

6.2 REQUIREMENT NO. 2 – CONSTRUCTION STORMWATER POLLUTION PREVENTION (SWPPP)

A Storm Water Pollution Prevention Plan (SWPPP) has been developed. The SWPPP consists of two parts: a narrative and a set of site plan drawings. The narrative portion consists of the thirteen SWPPP elements per WSDOE Manual described below in addition to other components of this storm water report including descriptions of existing site conditions, proposed project, critical areas, soils, etcetera. The site plan drawings depict implementation of BMP's and can be seen in Appendix 7.3, "Stormwater Site Plan". Additional descriptions of the BMPs are included in Appendix 7.4. Construction Source Control BMPs.

6.2.1 ELEMENT #1 - MARK CLEARING LIMITS

Prior to beginning land disturbing activities, including clearing and grading, all clearing limits, sensitive areas and their buffers, and trees that are to be preserved within the construction area should be clearly marked, both in the field and on the plans, to prevent damage and offsite impacts. Plastic, metal, or stake wire fence may be used to mark the clearing limits.

6.2.2 ELEMENT #2 - ESTABLISH CONSTRUCTION ACCESS

- (a) Construction vehicle access and exit shall be limited to one route on Viewcrest drive where the public road is to be built.
- (b) Access points shall be stabilized with quarry spalls or crushed rock to minimize the tracking of sediment onto public roads per WSDOE BMP C105: Stabilized Construction Entrance.
- (c) Wheel wash or tire baths are not anticipated to be needed for this project.

- (d) Public roads shall at a minimum be cleaned thoroughly at the end of each day. Sediment shall be removed from roads by shoveling or pickup sweeping and shall be transported to a controlled sediment disposal area. Street washing will be allowed only after sediment is removed in this manner.
- (e) Street wash wastewater shall be controlled by pumping back on-site, or otherwise be prevented from discharging into systems tributary to state surface waters.

6.2.3 ELEMENT #3 - CONTROL FLOW RATES

(a) Properties and waterways downstream from development sites shall be protected from erosion due to increases in the volume, velocity, and peak flow rate of stormwater runoff from the project site.

6.2.4 ELEMENT #4 - INSTALL SEDIMENT CONTROLS

- (a) The duff layer, native topsoil, and natural vegetation shall be retained in an undisturbed state to the maximum extent practicable until after the stormwater conveyance system has been installed.
- (b) Prior to leaving a construction site, stormwater runoff from disturbed areas shall pass through a sediment pond or other appropriate sediment removal BMP that is shown in the temporary erosion and sedimentation control plan. Runoff from fully stabilized areas may be discharged without a sediment removal BMP, but must meet the flow control performance standard of element 3 above. Full stabilization means concrete or asphalt paving; quarry spalls used as ditch lining; or the use of rolled erosion products, a bonded fiber matrix product, or vegetative cover in a manner that will fully prevent soil erosion. Sediment ponds, vegetated buffer strips, sediment barriers or filters, dikes, and other BMPs intended to trap sediment on-site shall be constructed as one of the first steps in grading. These BMPs shall be functional before other land disturbing activities take place.
- (c) Earthen structures such as dams, dikes, and diversions shall be seeded and mulched according to the timing indicated in element 5 below.

The minimum required sediment control WSDOE BMPs are C233: Silt Fence.

6.2.5 ELEMENT #5 - STABILIZE SOILS

- (a) All exposed and unworked soils shall be stabilized by application of effective BMPs that protect the soil from the erosive forces of raindrop impact and flowing water, and wind erosion.
- (b) From October 1 through April 30 of each year, no soils shall remain exposed and unworked for more than 2 days. From May 1 to September 30 of each year, no soils shall remain exposed and unworked for more than 7 days. This condition applies to all soils on site, whether at final grade or not.
- (c) Applicable practices include, but are not limited to, temporary and permanent seeding, sodding, mulching, plastic covering, soil application of polyacrylamide (pam), early application of gravel base on areas to be paved, and dust control.
- (d) Soil stabilization measures selected should be appropriate for the time of year, site conditions, estimated duration of use, and potential water quality impacts that stabilization agents may have on downstream waters or ground water.
- (e) Soil stockpiles must be stabilized and protected with sediment trapping measures.

- (f) Work on linear construction sites and activities, including right-of-way and easement clearing, roadway development, pipelines, and trenching for utilities, shall not exceed the capability of the individual contractor for his portion of the project to install the bedding materials, roadbeds, structures, pipelines, and/or utilities, and to re-stabilize the disturbed soils, meeting the timing conditions listed above.
- (g) In addition, at the discretion of the technical administrator, those sites unable to maintain the quality of their stormwater discharge may be required to provide soil stabilization to all exposed soil areas regardless of the working status of the area. Upon written notification, the property owner shall provide full stabilization of all exposed soil areas within 24 hours.

The minimum required soil stabilizing WSDOE BMPs are C120: Temporary and Permanent Seeding, C121 Mulching, C140 Dust Control.

6.2.6 ELEMENT #6 - PROTECT SLOPES

- (A) Cut and fill slopes shall be designed and constructed in a manner that will minimize erosion.
- (B) Consider soil type and its potential for erosion.
- (C) Reduce slope runoff velocities by reducing the continuous length of slope with terracing and diversions, reduce slope steepness, and roughen slope surface.
- (D) Divert upslope drainage and run-on waters from off-site with interceptors at top of slope. Off-site stormwater should be handled separately from stormwater generated on the site. Diversion of off-site stormwater around the site may be a viable option. Diverted flows shall be redirected to the natural drainage location at or before the property boundary.
- (E) Contain down slope collected flows in pipes, slope drains, or protected channels.
- (F) Provide drainage to remove ground water intersecting the slope surface of exposed soil areas.
- (G) Excavated material shall be placed on the uphill side of trenches, consistent with safety and space considerations.
- (H) Check dams shall be placed at regular intervals within trenches that are cut down a slope.
- (I) Stabilize soils on slopes, as specified in element #5.

In addition to BMP's listed in element #5 above, if required the minimum slope protection BMP's are: C120 Temporary and Permanent Seeding

6.2.7 ELEMENT #7 - PROTECT DRAIN INLETS

- (a) All storm drain inlets made operable during construction shall be protected so that stormwater runoff shall not enter the conveyance system without first being filtered or treated to remove sediment. The required BMP is: C220 Storm Drain Inlet Protection
- (b) All approach roads shall be kept clean, and all sediment and street wash water shall not be allowed to enter storm drains without prior and adequate treatment unless treatment is provided before the storm drain discharges to waters of the state.

6.2.8 ELEMENT #8 - STABILIZE CHANNELS AND OUTLETS

- (a) No permanent open channels are proposed for construction. If temporary open channels are constructed, they shall be designed and constructed then stabilized to prevent erosion from the expected velocity of flow from a 2 year, 24-hour frequency storm for the developed condition.
- (b) Stabilization, including armoring material, adequate to prevent erosion of outlets, adjacent stream banks, slopes and downstream reaches shall be provided at the outlets of all conveyance systems.

6.2.9 ELEMENT #9 - CONTROL POLLUTANTS

- (a) All pollutants, including waste materials and demolition debris, that occur on-site during construction shall be handled and disposed of in a manner that does not cause contamination of stormwater.
- (b) Cover, containment, and protection from vandalism shall be provided for all chemicals, liquid products, petroleum products, and non-inert wastes present on the site (see chapter 173-304 WAC, as currently enacted or hereafter modified, for the definition of inert waste, which is incorporated herein by this reference).
- (c) Maintenance and repair of heavy equipment and vehicles involving oil changes, hydraulic system drain down, solvent and de-greasing cleaning operations, fuel tank drain down and removal, and other activities which may result in discharge or spillage of pollutants to the ground or into stormwater runoff must be conducted using spill prevention measures, such as drip pans. Contaminated surfaces shall be cleaned immediately following any discharge or spill incident. Emergency repairs may be performed on-site using temporary plastic placed beneath and, if raining, over the vehicle.
- (d) There is no anticipated need for wheel wash, or tire bath wastewater, for this project. If the need were to arise the wheel wash, or tire bath wastewater shall be discharged to a separate on-site treatment system or to the sanitary sewer.
- (e) Application of agricultural chemicals, including fertilizers and pesticides, shall be conducted in a manner and at application rates that will not result in loss of chemicals to stormwater runoff. Manufacturers' recommendations shall be followed for application rates and procedures. There is no anticipated use for agricultural chemicals, including fertilizers and pesticides for this project.
- (f) Management of pH-modifying sources shall prevent contamination of runoff and stormwater collected on the site. These sources include, but are not limited to, bulk cement, cement kiln dust, fly ash, new concrete washing and curing waters, waste streams generated from concrete grinding and sawing, exposed aggregate processes, and concrete pumping and mixer washout waters. The minimum required BMP' is: C151 Concrete Handling.

6.2.10 ELEMENT #10 - CONTROL DE-WATERING

- (a) All foundation, vault, and trench de-watering water, which has similar characteristics to stormwater runoff at the site, shall be discharged into a controlled conveyance system, prior to discharge to a sediment trap or sediment pond. Channels must be stabilized, as specified in element #8.
- (b) Clean, non-turbid de-watering water, such as well-point ground water, can be discharged to systems tributary to state surface waters, as specified in element #8, provided the de-watering flow does not cause erosion or flooding of the receiving waters. These clean waters should not be routed through sediment ponds with stormwater.

- (c) Highly turbid or otherwise contaminated dewatering water, such as from construction equipment operation, clamshell digging, concrete tremie pour, or work inside a cofferdam, shall be handled separately from stormwater at the site.
- (d) Other disposal options, depending on site constraints, may include, by way of example: 1) transport off-site in vehicle, such as a vacuum flush truck, for legal disposal in a manner that does not pollute state waters, 2) on-site treatment using chemical treatment or other suitable treatment technologies.

6.2.11 ELEMENT #11 - MAINTAIN BMPS

- (a) All temporary and permanent erosion and sediment control BMPs shall be maintained and repaired as needed to assure continued performance of their intended function. All maintenance and repair shall be conducted in accordance with BMPs.
- (b) Sediment control BMPs shall be inspected weekly or after a runoff-producing storm event during the dry season and daily during the wet season. All projects that disturb an area greater than one acre shall have a certified erosion control lead available to the site. This erosion control lead shall be responsible to provide overview of ongoing day to day erosion control requirements. The erosion control lead shall (within 24 hours) report to the city and department of ecology any site discharges that exceed state water quality standards that have or are likely to have entered waters of the state.
- (c) All temporary erosion and sediment control BMPs shall be removed within 30 days after final site stabilization is achieved or after the temporary BMPs are no longer needed. Trapped sediment shall be removed or stabilized on site. Disturbed soil areas resulting from removal of BMPs or vegetation shall be permanently stabilized.

6.2.12 ELEMENT #12 - MANAGE THE PROJECT

- (a) Phasing of construction development projects shall be phased where feasible in order to prevent, to the maximum extent practicable, the transport of sediment from the development site during construction. Revegetation of exposed areas and maintenance of that vegetation shall be an integral part of the clearing activities for any phase.
- (b) When establishing these permitted clearing and grading areas, consideration should be given to minimizing removal of existing trees and minimizing disturbance/compaction of native soils except as needed for building purposes. Permitted clearing and grading areas and any other areas required to preserve critical or sensitive areas, buffers, native growth protection easements, or tree retention areas, shall be delineated on the site plans and the development site.
- (c) Coordination with utilities and other contractors the primary project proponent shall evaluate, with input from utilities and other contractors, the stormwater management requirements for the entire project, including the utilities, when preparing the construction SWPPP.
- (d) Inspection and monitoring all BMPs shall be inspected, maintained, and repaired as needed to assure continued performance of their intended function.
- (e) For any project disturbing more than one acre, a certified professional in erosion and sediment control shall be identified in the construction SWPPP and shall be on-site or on-call at all times. Certification may be through the Washington state department of transportation/associated general contractors (WSDOT/AGC) construction site erosion and sediment control certification program or any equivalent local or national certification and/or training program, in the city's discretion.
- (f) Whenever inspection and/or monitoring reveals that the BMPs identified in the construction

SWPPP are inadequate, due to the actual discharge of or potential to discharge a significant amount of any pollutant, the SWPPP shall be modified, as appropriate, in a timely manner.

(g) Maintenance of the construction SWPPP - the construction SWPPP shall be retained on-site. The construction SWPPP shall be modified whenever there is a significant change in the design, construction, operation, or maintenance of any BMP.

6.2.13 ELEMENT #13 - PROTECT LOW IMPACT DEVELOPMENT BMP'S

The project proposes to install topsoil in accordance with BMP T5.13 Post Construction Soil Quality and Depth. Upon placement of the BMP the owner shall avoid vehicle traffic in the area other than specific lawn / landscape maintenance equipment.

6.3 REQUIREMENT NO. 3 – SOURCE CONTROL OF POLLUTION

The following construction site source control Best Management Practices (BMP's) have been selected as requirements on this project, obtained from the WSDOE Manual, Volume 2:

- □ BMP C101: Preserving Natural Vegetation
- BMP C105: Stabilized Construction Entrance
- BMP C120: Temporary & Permanent Seeding
- BMP C125: Topsoiling
- □ BMP C140: Dust Control
- BMP C151: Concrete Handling
- BMP C152: Sawcutting and Surface Pollution Prevention

The following runoff conveyance and treatment BMPs are required to be implemented during the construction of the project to minimize erosion and sedimentation impacts associated with construction activities:

- □ BMP C209: Rock Lining Outlet Protection
- □ BMP C220: Storm Drain Inlet Protection

Detailed descriptions of each of the above BMP's are included in Appendix 8.7 Construction BMP's. The above construction source control, runoff conveyance, and treatment BMP's are the minimum requirements for anticipated site conditions during the construction period. Additional BMP's may be required at the discretion of the engineer for unexpected storm events or site conditions encountered during construction that may include but are not limited to the following:

- □ BMP C107: Construction Road/Parking Area Stabilization
- BMP C121: Mulching
- □ BMP C122: Nets & Blankets
- BMP C124: Sodding
- BMP C130: Surface Roughening
- BMP C150: Materials on Hand
- BMP C200: Interceptor Dike and Swale
- BMP C201: Grass Lined Channels
- BMP C202: Channel Lining

	BMP C205:	Sub-Surface Drains
	BMP C233:	Silt Fence
	BMP C235:	Straw Wattles
П	BMP C251:	Construction Storm water Filtration

Upon completion of construction, the following pollutant source control BMPs are recommended for implementation associated with the management and maintenance of the development, obtained from the DOE Manual, Volume 4:

S406 BMPs for Streets and Highways
S410 BMPs for Illicit Connections to Storm Drains
S411 BMPs for Landscape & Vegetation Management
S415 BMPs for Maintenance of Public and Private utility Corridors and Facilities
S417 BMPs for Maintenance of Storm Water Drainage and Treatment Systems
S453 BMPs for Formation of a Pollution Prevention Team
S454 BMPs for Preventative Maintenance / Good Housekeeping
S455 BMPs for Spill Prevention and Cleanup
S456 BMPs for Employee Training
S457 BMPs for Inspections
S458 BMPs for Record Keeping

Detailed descriptions of each of the above Pollution Source-Specific BMPs are included in the WSDOE Stormwater Management Manual for Western Washington, 2019 edition.

6.4 REQUIREMENT NO. 4 – PRESERVATION OF NATURAL DRAINAGE SYSTEMS AND OUTFALLS

Natural drainage systems and outfalls will be preserved as part of the project. Post-development flows will not be diverted and will continue to be discharged in the pre-development threshold discharge basin.

6.5 REQUIREMENT NO. 5 – ON-SITE STORM WATER MANAGEMENT

The project triggers minimum requirements 1-9 and use On-Site Stormwater Management BMP's from List 2 for each surface type.

The following provides a list of surfaces and considers BMP's for each surface type in order listed in the DOE Manual:

Lawn/Landscape Areas: Lawn/Landscape areas will implement BMP T5.13 – Post Construction Soil Quality and Depth. BMP-T5.13 provides increased treatment of pollutants and sediments and reduces pollution through prevention as the need for some landscaping chemicals is reduced. Runoff generated onsite will be conveyed to the appropriate facilities and treated if necessary. See Appendix 8.9 for the BMP T5.14 requirements.

Impervious Surface Areas: The feasibility of on-site Stormwater Management BMPs has been considered and are explained further below:

Other Hard Surfaces:

- 1. **Full Dispersion:** Full Dispersion is considered infeasible for the project based on the minimum design requirements outlined in BMP T5.30 Full Dispersion, specific infeasibility criteria applicable to the project included:
 - a. "If they are within a threshold discharge area that is or will be more than 65% forested and less than 10% impervious... with vegetated flow paths of 100 feet or more through the native vegetation preserved area" No such vegetative area or flow path exists on the project site.
- 2. **Permeable Pavement:** Permeable Pavement is considered infeasible for the project based on the Infeasibility Criteria Detailed in BMP T5.15 Permeable Pavements, Specific infeasibility criteria applicable to the project include:
 - a. Due to low permeability and silty clays on site infiltration is not feasible. Separation requirements from the bottom of the permeable pavement section to impervious soil is not achievable.
- 3. **Bioretention:** Bioretention is considered infeasible for the project based on the Infeasibility Criteria Detailed in BMP T7.30 Bioretention Cells, Swales, and Planter boxes, specific infeasibility criteria applicable to the project include.
 - a. ""Where the minimum vertical separation of 1-foot to the seasonal high-water table, bedrock, or other impervious layer would not be achieved below bioretention..." The native soils onsite are considered impervious and unsuitable for infiltration.
- **4. Sheet Flow Dispersion:** Sheet Flow Dispersion and Concentrated Flow Dispersion is considered infeasible for the project based on the minimum design requirements outlined in BMP T5.11 Concentrated Flow Dispersion, Specific infeasibility criteria applicable to the project include:
 - a. "Maintain a vegetated flow path of at least 50 feet between the discharge point and any property line, structure, steep slope, stream, lake, wetland, or impervious area" No such vegetative area or flow path exists on the project.

6.6 REQUIREMENT NO. 6 – RUNOFF TREATMENT

This project is required to meet basic water quality treatment standards per BMC 15.42. However, this project has elected to increase the level of stormwater treatment and meet the enhanced treatment level standard.

The site improvements will meet Enhanced Treatment for this project with the use of modular wetland devic3s. The treatment method and sizing calculations are detailed in Section 5.5

6.7 REQUIREMENT NO. 7 – FLOW CONTROL

Flow control for the Chuckanut Bay TDA is not required due to direct discharge to a flow control exempt water body. S. Clarkwood Dr TDA will not require flow control as less than 10,000 SF of new plus replaced impervious surfacing is proposed. The Viewcrest Rd TDA does require flow control as more than 10,000 SF of new plus replaced impervious surfacing is proposed in the TDA. See Section 5.2 for more detail.

6.8 REQUIREMENT NO. 8 - WETLANDS PROTECTION

Three wetlands exist on the site that were delineated by Northwest Ecological Services in September 2020. All three wetlands are located in the eastern portion of the site, and will be protected upon project completion. The critical areas summary compiled by Northwest Ecological Services can be found in Appendix 8.9.

6.9 REQUIREMENT NO. 9 - OPERATION AND MAINTENANCE

Operation and maintenance of the proposed storm water management facilities shall be the responsibility of the City of Bellingham. Since the City of Bellingham has a City-wide maintenance program for all of their stormwater drainage systems, we assume that the facilities constructed as a part of this project will be maintained using the current maintenance processes and procedures by the City of Bellingham.


7 PRINCIPAL FINDINGS AND RECOMMENDATIONS

Detailed analysis has shown that all drainage requirements can be met for the proposed project site. Storm water treatment requirements for the developed project shall be accomplished with the use of a modular wetland device. All storm water management associated with the proposed project will comply with the BMC 15.42 and all applicable minimum requirements outlined in the DOE Manual.

.

8 APPENDIX

8.1 VICINITY MAP

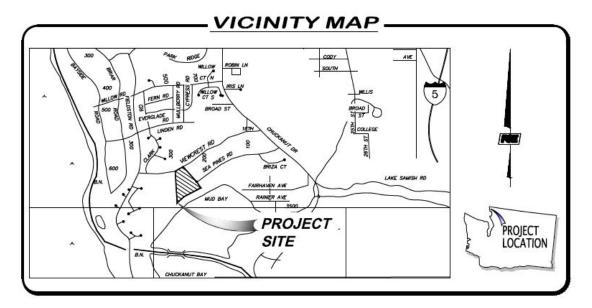

8.2 NRCS SOILS REPORT



Natural Resources Conservation

Service

A product of the National Cooperative Soil Survey, a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local participants

Custom Soil Resource Report for Whatcom County Area, Washington



Preface

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (https://offices.sc.egov.usda.gov/locator/app?agency=nrcs) or your NRCS State Soil Scientist (http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2 053951).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

Contents

Preface	2
How Soil Surveys Are Made	
Soil Map	
Soil Map	
Legend	10
Map Unit Legend	11
Map Unit Descriptions	11
Whatcom County Area, Washington	13
52—Everett-Urban land complex, 5 to 20 percent slopes	13
110—Nati loam, 30 to 60 percent slopes	14
References	16

How Soil Surveys Are Made

Soil surveys are made to provide information about the soils and miscellaneous areas in a specific area. They include a description of the soils and miscellaneous areas and their location on the landscape and tables that show soil properties and limitations affecting various uses. Soil scientists observed the steepness, length, and shape of the slopes; the general pattern of drainage; the kinds of crops and native plants; and the kinds of bedrock. They observed and described many soil profiles. A soil profile is the sequence of natural layers, or horizons, in a soil. The profile extends from the surface down into the unconsolidated material in which the soil formed or from the surface down to bedrock. The unconsolidated material is devoid of roots and other living organisms and has not been changed by other biological activity.

Currently, soils are mapped according to the boundaries of major land resource areas (MLRAs). MLRAs are geographically associated land resource units that share common characteristics related to physiography, geology, climate, water resources, soils, biological resources, and land uses (USDA, 2006). Soil survey areas typically consist of parts of one or more MLRA.

The soils and miscellaneous areas in a survey area occur in an orderly pattern that is related to the geology, landforms, relief, climate, and natural vegetation of the area. Each kind of soil and miscellaneous area is associated with a particular kind of landform or with a segment of the landform. By observing the soils and miscellaneous areas in the survey area and relating their position to specific segments of the landform, a soil scientist develops a concept, or model, of how they were formed. Thus, during mapping, this model enables the soil scientist to predict with a considerable degree of accuracy the kind of soil or miscellaneous area at a specific location on the landscape.

Commonly, individual soils on the landscape merge into one another as their characteristics gradually change. To construct an accurate soil map, however, soil scientists must determine the boundaries between the soils. They can observe only a limited number of soil profiles. Nevertheless, these observations, supplemented by an understanding of the soil-vegetation-landscape relationship, are sufficient to verify predictions of the kinds of soil in an area and to determine the boundaries.

Soil scientists recorded the characteristics of the soil profiles that they studied. They noted soil color, texture, size and shape of soil aggregates, kind and amount of rock fragments, distribution of plant roots, reaction, and other features that enable them to identify soils. After describing the soils in the survey area and determining their properties, the soil scientists assigned the soils to taxonomic classes (units). Taxonomic classes are concepts. Each taxonomic class has a set of soil characteristics with precisely defined limits. The classes are used as a basis for comparison to classify soils systematically. Soil taxonomy, the system of taxonomic classification used in the United States, is based mainly on the kind and character of soil properties and the arrangement of horizons within the profile. After the soil

Custom Soil Resource Report

scientists classified and named the soils in the survey area, they compared the individual soils with similar soils in the same taxonomic class in other areas so that they could confirm data and assemble additional data based on experience and research.

The objective of soil mapping is not to delineate pure map unit components; the objective is to separate the landscape into landforms or landform segments that have similar use and management requirements. Each map unit is defined by a unique combination of soil components and/or miscellaneous areas in predictable proportions. Some components may be highly contrasting to the other components of the map unit. The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The delineation of such landforms and landform segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Soil scientists make many field observations in the process of producing a soil map. The frequency of observation is dependent upon several factors, including scale of mapping, intensity of mapping, design of map units, complexity of the landscape, and experience of the soil scientist. Observations are made to test and refine the soil-landscape model and predictions and to verify the classification of the soils at specific locations. Once the soil-landscape model is refined, a significantly smaller number of measurements of individual soil properties are made and recorded. These measurements may include field measurements, such as those for color, depth to bedrock, and texture, and laboratory measurements, such as those for content of sand, silt, clay, salt, and other components. Properties of each soil typically vary from one point to another across the landscape.

Observations for map unit components are aggregated to develop ranges of characteristics for the components. The aggregated values are presented. Direct measurements do not exist for every property presented for every map unit component. Values for some properties are estimated from combinations of other properties.

While a soil survey is in progress, samples of some of the soils in the area generally are collected for laboratory analyses and for engineering tests. Soil scientists interpret the data from these analyses and tests as well as the field-observed characteristics and the soil properties to determine the expected behavior of the soils under different uses. Interpretations for all of the soils are field tested through observation of the soils in different uses and under different levels of management. Some interpretations are modified to fit local conditions, and some new interpretations are developed to meet local needs. Data are assembled from other sources, such as research information, production records, and field experience of specialists. For example, data on crop yields under defined levels of management are assembled from farm records and from field or plot experiments on the same kinds of soil.

Predictions about soil behavior are based not only on soil properties but also on such variables as climate and biological activity. Soil conditions are predictable over long periods of time, but they are not predictable from year to year. For example, soil scientists can predict with a fairly high degree of accuracy that a given soil will have a high water table within certain depths in most years, but they cannot predict that a high water table will always be at a specific level in the soil on a specific date.


After soil scientists located and identified the significant natural bodies of soil in the survey area, they drew the boundaries of these bodies on aerial photographs and

Custom Soil Resource Report

identified each as a specific map unit. Aerial photographs show trees, buildings, fields, roads, and rivers, all of which help in locating boundaries accurately.

Soil Map

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.

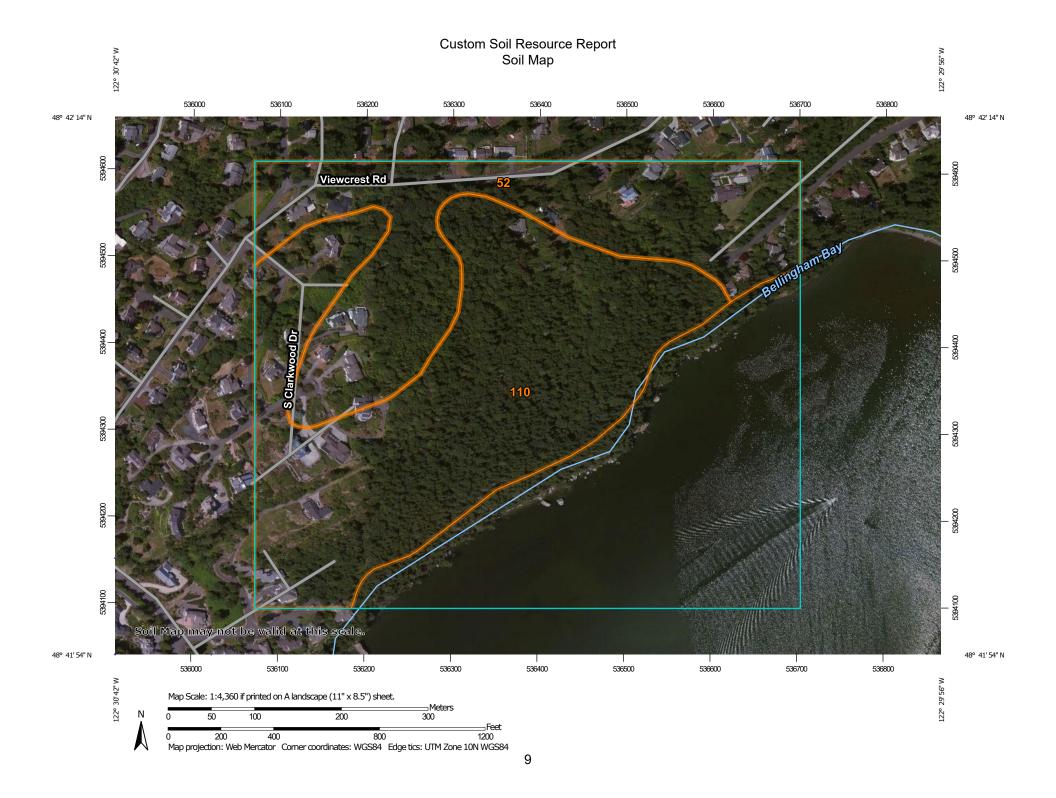

MAP LEGEND

Area of Interest (AOI)

Area of Interest (AOI)

Soils

Soil Map Unit Polygons

-

Soil Map Unit Lines

Soil Map Unit Points

Special Point Features

(

Blowout

 \boxtimes

Borrow Pit

Ж

Clay Spot

 \wedge

Closed Depression

`.

osca Depressio

.

Gravelly Spot

0

Landfill

Gravel Pit

٨.

Lava Flow

Marsh or swamp

_

Mine or Quarry

仌

Miscellaneous Water

0

Perennial Water

.

Rock Outcrop
Saline Spot

~

Sandy Spot

_

Severely Eroded Spot

Sinkhole

24

Slide or Slip

Ø

Sodic Spot

LEGEND

۵

Spoil Area Stony Spot

Ø

Very Stony Spot

3

Wet Spot Other

Δ

Special Line Features

Water Features

_

Streams and Canals

Transportation

ransp

Rails

~

Interstate Highways

US Routes

 \sim

Major Roads

~

Local Roads

Background

Marie Control

Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24.000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service Web Soil Survey URL:

Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Whatcom County Area, Washington Survey Area Data: Version 20, Jun 4, 2020

Soil map units are labeled (as space allows) for map scales 1:50.000 or larger.

Date(s) aerial images were photographed: Jul 9, 2010—Aug 28, 2011

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
52	Everett-Urban land complex, 5 to 20 percent slopes	21.0	26.1%
110	Nati loam, 30 to 60 percent slopes	33.4	41.4%
Totals for Area of Interest		80.6	100.0%

Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however,

Custom Soil Resource Report

onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An association is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

Whatcom County Area, Washington

52—Everett-Urban land complex, 5 to 20 percent slopes

Map Unit Setting

National map unit symbol: 2j52 Elevation: 50 to 250 feet

Mean annual precipitation: 30 to 50 inches Mean annual air temperature: 50 degrees F

Frost-free period: 180 days

Farmland classification: Not prime farmland

Map Unit Composition

Everett and similar soils: 50 percent

Urban land: 30 percent

Minor components: 20 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Everett

Setting

Landform: Moraines, terraces

Parent material: Loess and volcanic ash over glacial outwash

Typical profile

H1 - 0 to 6 inches: gravelly ashy sandy loam H2 - 6 to 13 inches: gravelly ashy sandy loam H3 - 13 to 25 inches: very gravelly sandy loam H4 - 25 to 41 inches: very gravelly loamy sand H5 - 41 to 60 inches: very gravelly sand

Properties and qualities

Slope: 5 to 20 percent

Depth to restrictive feature: 40 to 60 inches to densic material

Drainage class: Somewhat excessively drained

Capacity of the most limiting layer to transmit water (Ksat): Very low to moderately

low (0.00 to 0.06 in/hr)

Depth to water table: About 39 to 59 inches

Frequency of flooding: None Frequency of ponding: None

Available water supply, 0 to 60 inches: Low (about 4.3 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 3e

Hydrologic Soil Group: B

Forage suitability group: Droughty Soils (G002XN402WA)
Other vegetative classification: Droughty Soils (G002XN402WA)

Hydric soil rating: No

Description of Urban Land

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 8

Hydric soil rating: No

Custom Soil Resource Report

Minor Components

Sehome

Percent of map unit: 5 percent Hydric soil rating: No

Squalicum

Percent of map unit: 5 percent

Hydric soil rating: No

Chuckanut

Percent of map unit: 4 percent

Hydric soil rating: No

Whatcom

Percent of map unit: 3 percent

Hydric soil rating: No

Labounty, undrained

Percent of map unit: 3 percent Landform: Depressions

Other vegetative classification: Wet Soils (G002XN102WA)

Hydric soil rating: Yes

110—Nati loam, 30 to 60 percent slopes

Map Unit Setting

National map unit symbol: 2j0z Elevation: 100 to 1,600 feet

Mean annual precipitation: 35 to 50 inches
Mean annual air temperature: 46 to 48 degrees F

Frost-free period: 140 to 170 days

Farmland classification: Not prime farmland

Map Unit Composition

Nati and similar soils: 85 percent Minor components: 10 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Nati

Setting

Landform: Ridges, hillslopes

Landform position (two-dimensional): Backslope

Parent material: Volcanic ash and colluvium and slope alluvium derived from

sandstone and silstone and glacial drift

Typical profile

H1 - 0 to 10 inches: ashy loam H2 - 10 to 38 inches: ashy loam

Custom Soil Resource Report

H3 - 38 to 42 inches: weathered bedrock

Properties and qualities

Slope: 30 to 60 percent

Depth to restrictive feature: More than 80 inches; 20 to 40 inches to paralithic

bedrock

Drainage class: Well drained

Capacity of the most limiting layer to transmit water (Ksat): Moderately high to high

(0.57 to 1.98 in/hr)

Depth to water table: More than 80 inches

Frequency of flooding: None Frequency of ponding: None

Available water supply, 0 to 60 inches: Low (about 5.4 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 7e

Hydrologic Soil Group: C Hydric soil rating: No

Minor Components

Squalicum

Percent of map unit: 5 percent

Hydric soil rating: No

Shalcar, undrained

Percent of map unit: 1 percent

Landform: Flood plains

Other vegetative classification: Wet Soils (G002XN102WA)

Hydric soil rating: Yes

Chuckanut

Percent of map unit: 1 percent

Hydric soil rating: No

Bellingham, undrained

Percent of map unit: 1 percent

Landform: Depressions

Other vegetative classification: Wet Soils (G002XN102WA)

Hydric soil rating: Yes

Sehome

Percent of map unit: 1 percent

Hydric soil rating: No

Comar

Percent of map unit: 1 percent

Hydric soil rating: No

References

American Association of State Highway and Transportation Officials (AASHTO). 2004. Standard specifications for transportation materials and methods of sampling and testing. 24th edition.

American Society for Testing and Materials (ASTM). 2005. Standard classification of soils for engineering purposes. ASTM Standard D2487-00.

Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe. 1979. Classification of wetlands and deep-water habitats of the United States. U.S. Fish and Wildlife Service FWS/OBS-79/31.

Federal Register. July 13, 1994. Changes in hydric soils of the United States.

Federal Register. September 18, 2002. Hydric soils of the United States.

Hurt, G.W., and L.M. Vasilas, editors. Version 6.0, 2006. Field indicators of hydric soils in the United States.

National Research Council. 1995. Wetlands: Characteristics and boundaries.

Soil Survey Division Staff. 1993. Soil survey manual. Soil Conservation Service. U.S. Department of Agriculture Handbook 18. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_054262

Soil Survey Staff. 1999. Soil taxonomy: A basic system of soil classification for making and interpreting soil surveys. 2nd edition. Natural Resources Conservation Service, U.S. Department of Agriculture Handbook 436. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2 053577

Soil Survey Staff. 2010. Keys to soil taxonomy. 11th edition. U.S. Department of Agriculture, Natural Resources Conservation Service. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2 053580

Tiner, R.W., Jr. 1985. Wetlands of Delaware. U.S. Fish and Wildlife Service and Delaware Department of Natural Resources and Environmental Control, Wetlands Section.

United States Army Corps of Engineers, Environmental Laboratory. 1987. Corps of Engineers wetlands delineation manual. Waterways Experiment Station Technical Report Y-87-1.

United States Department of Agriculture, Natural Resources Conservation Service. National forestry manual. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2 053374

United States Department of Agriculture, Natural Resources Conservation Service. National range and pasture handbook. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/landuse/rangepasture/?cid=stelprdb1043084

Custom Soil Resource Report

United States Department of Agriculture, Natural Resources Conservation Service. National soil survey handbook, title 430-VI. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2_054242

United States Department of Agriculture, Natural Resources Conservation Service. 2006. Land resource regions and major land resource areas of the United States, the Caribbean, and the Pacific Basin. U.S. Department of Agriculture Handbook 296. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053624

United States Department of Agriculture, Soil Conservation Service. 1961. Land capability classification. U.S. Department of Agriculture Handbook 210. http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_052290.pdf

8.3 GEOLOGIC FEASABILITY INVESTIGATION

GEOTECHNICAL INVESTIGATION & GEOHAZARD REPORT JONES EDGEMOOR ESTATE PROPOSED 38-LOT PLAT DEVELOPMENT VIEWCREST ROAD, BELLINGHAM, WA

Submitted to Ann C Jones, Family LP November 3, 2021





Submitted by: ELEMENT Solutions 909 Squalicum Way, Suite 111 Bellingham, WA 98225 T | 360.671.9172 info@elementsolutions.org

ELEMENT Solutions 909 Squalicum Way, Ste. 111 Bellingham, WA 98225



November 3, 2021

To: Ann C Jones, Family LP

807 Chuckanut Shore Road, Bellingham, WA 98229

Subject: Geotechnical Investigation & Geohazard Assessment

Proposed 38-Lot Plat - Jones Edgemoor Estate

Viewcrest Road, Bellingham, WA

Dear Ms. Jones,

Element Solutions (Element) is pleased to present the following Geotechnical Investigation for the above referenced project and site. This report was compiled using information provided by the project team, desktop review of public information, field reconnaissance with slope observation, subsurface geotechnical explorations, laboratory testing, review and analysis of conditions encountered, and the professional judgment of our geotechnical professionals.

The work plan generally included review of the study area and mapped geologic conditions, field reconnaissance and visual assessment of existing site conditions, and a subsurface investigation that entailed the logging and evaluation of twenty-six (26) exploratory test pits. Reconnaissance for observation of slope conditions, interpretation of geologic hazards, and assessment of exposed bedrock characteristics was performed on several dates during the course of this study. Test pits were observed on June 30 and July 1, 2020, at locations dispersed throughout the upland areas of the site interior as current access allowed. Additional explorations for utility construction planning were completed along Sea Pines Road on November 13, 2020, including two (2) machine test pits and two (2) hand auger borings. Our interpretations and conclusions regarding geologic hazards and subsurface conditions across the study area, based on work completed to date, are summarized in the following report.

This report is intended to provide the project team with site-wide geologic information, project feasibility commentary, and relevant geotechnical recommendations to inform project decisions, conceptual planning, and engineering design considerations for the proposed plat at the Jones-Edgemoor Estate property.

Thank you for the opportunity to work on this project. Should you have any questions regarding this report, please contact us at (360) 671-9172. Element Solutions is a wholly owned subsidiary of Pacific Surveying & Engineering.

Sincerely,

John R Gillaspy, LEG, M.S.

Environmental Services Manager

ELEMENT SOLUTIONS

Table of Contents

Tab	le of Co	ontents	1
1	Introd	uction	1
1.1	Gen	neral Overview	1
1.2	Proj	ject Understanding	1
1.3	Pur	pose and Summary of Scope	2
1.4	Assı	umptions and Limitations	2
2	Deskto	op Review and Interpretation	3
2.1		thods	
2.2		ation and Physiography	
2.3		ologic Background	
	2.3.1		
2.4	Geo	ologic Hazard Commentary	5
	2.4.1	Slope Gradient Review	5
	2.4.2	Special Hazard Areas	6
3	Geote	chnical Explorations	7
3.1		thods	
	3.1.1	Subsurface Investigation	7
3.2	Sub	surface Soil Conditions	
	3.2.1	Laboratory Testing Results	10
3.3	Gro	undwater Conditions	11
3.4	Add	litional Explorations – Sea Pines Road	11
	3.4.1	Methods	11
	3.4.2	Subsurface Conditions	12
	3.4.3	Utility Construction and Bedrock Profile	12
4	Geolo	gic Hazards & Slope Stability	13
4.1	Rev	iew Methodology	13
	4.1.1	Stability Factors and Areas of Potential Hazard	13
4.2	Slop	pe Review & Observations	14
	4.2.1	Northwest Slope	14
	4.2.2	Western and Central Slopes	15
	4.2.3	Southwest Slopes	
4.3	Bed	rock Outcrops & Structures	17
	4.3.1	Bedding	
	4.3.2	Joint Patterns	
	4.3.3	Rock Face Stability	
	4.3.4	Rock Fall Characteristics	
4.4	Geo	hazard Review Findings & Recommendations	
	4.4.1	Conclusions on Slope Stability for Development	
	4.4.2	Preliminary Building Setback & Avoidance Recommendations	
	4.4.3	Need for Lot-Specific Reviews	23

5	Conclusions and Recommendations 24						
5.1	5.1 Project Feasibility Discussion						
	5.1.1	Foundation Feasibility Commentary24					
	5.1.2	Road & Utility Construction Feasibility25					
	5.1.3	Stormwater Infiltration Design Feasibility25					
5.2	Seisi	mic Design and Liquefaction Potential26					
	5.2.1	Seismic Design Coefficients					
	5.2.2	Liquefaction Susceptibility27					
5.3	Four	ndation Design and Construction27					
	5.3.1	Bearing Capacity28					
	5.3.2	Lateral Resistance					
	5.3.3	Foundation Drainage					
5.4	Retaining Wall Foundations29						
	5.4.1	Lateral Earth Pressures					
	5.4.2	Wall Construction Recommendations30					
5.5	Slab	-On-Grade Floors30					
	5.5.1	Slab Preparation and Construction30					
	5.5.2	Slab Drainage and Moisture Control31					
5.6	Pave	ement Recommendations31					
	5.6.1	Pavement Design Considerations					
	5.6.2	Pavement Construction32					
5.7	Stor	mwater Infiltration32					
5.8	Eart	hwork and Excavations34					
	5.8.1	General Site and Subgrade Preparation34					
	5.8.2	Difficulty of Excavations35					
	5.8.3	Wet Season Construction35					
	5.8.4	Excavation Dewatering36					
	5.8.5	Excavation Shoring36					
	5.8.6	Temporary Cut-slopes					
5.9	Stru	ctural Fill Recommendations37					
	5.9.1	Use of Structural Fill					
	5.9.2	Installation and Compaction38					
	5.9.3	Existing Material Suitability					
	5.9.4	Imported Material Specifications					
5.10	Utili [.]	ty Construction39					
	5.10.1	Utility Trenching and Excavation39					
	5.10.2	Backfill and Pipe Zone Bedding40					
5.11	Cont	tractor Responsibilities41					
5.12 General Critical Area Guidelines & Recommendations							
	5.12.1	Stormwater Management42					
	5.12.2	Site Management During Construction44					
	5.12.3	Long-term Erosion Control and Maintenance44					
6	Closure						

References	47
Appendix I	1
Appendix II	2
Appendix III	3

1 Introduction

1.1 General Overview

Element has completed this geotechnical investigation and geologic hazard assessment on behalf of the clients, property owners, for contribution to the plat design and approval process for proposed residential development of the project site. In general, the work was conducted to provide a distributed subsurface site characterization and inform preliminary geotechnical aspects of project feasibility planning and engineering, including the influence of steep slopes within and bordering the development area. The project entails establishing a new plat with approximately 38 lots and associated road and utility infrastructure in Bellingham, Washington. The project site is located south of Fairhaven, on Viewcrest Road, in the Edgemoor neighborhood. The site is situated within a hilly and forested upland area bounded by a sheltered bedrock bluff slope defining the northern margin of Chuckanut Bay. Refer to Appendix I (Figures 1 and 2) for maps depicting the general site location, surrounding vicinity conditions, and current proposed lot and road layout.

1.2 **Project Understanding**

The proposed project involves future plat development of the currently vacant and forested hilly site with a single-family residential community. The project is currently in the design stage and subject to changes in layout at the time of this report. Preliminary layout plans (Pacific Surveying & Engineering) indicate that 38 residential parcels are anticipated to be created within the plat. One open space tract and one reserve tract will also be created within areas largely occupied by wetlands or geologic hazards and their associated buffers.

Two main neighborhood roads are planned to service the site, branching from a single entry at Viewcrest Road, at the north-central end of the project area. The roads are shown to extend immediately southward from the main road, then branch southwest and south across the middle of the site following existing topographic benches traversing between areas of steeper or more variable topography. Both roads will terminate in cul-de-sacs within the site. Several shared access driveways are planned to extend from the sides or ends of the main roads to service each lot.

Current road grading plans indicate the roadway corridors will be prepared using a combination of cuts and fills to address local variations in topography. Commonly, the northwest sides of the roads will involve new cut slopes, while the southeast sides will be constructed at grade or over some extent of structural fill.

No information is available on proposed lot grading or foundations, which will be addressed in later lot-specific designs. Based on standards of practice in the area, we presume the future structures will typically use stepped foundations and/or daylight basements where topography is variable or sloping. No excessive fill placement or unrestrained cuts are anticipated for lot preparations. Structural loads are expected to be typical for the scale of single-family residences with wood framing. No unusually heavy, variable, vibratory, or cyclic loads are anticipated.

The majority of stormwater generated from new impervious areas on roads and lots is expected to be collected, treated as necessary, and routed to upland dispersion areas and/or a main tightline outfall leading down to the shoreline. Stormwater from the northwest portion of the project area may be infiltrated as feasible, and otherwise directed to existing utilities along Viewcrest Road.



1.3 Purpose and Summary of Scope

The purpose of our investigation was to conduct a feasibility-level geotechnical evaluation and large-scale geologic hazard assessment in support of the proposed plat application and its public road improvements. The scope of work performed was in general accordance with the executed project agreement, with adjustments made during the course of the project based on actual conditions encountered. An additional scope of work was completed upon request in support of utility design along the western terminus of Sea Pines Road.

In summary, our final scope of site investigation has included:

- 1) Desktop review of existing geologic and soils information for the project area (as based on mapping by others and public information), as well as GIS analysis and imagery review of onsite and proximal off-site sloping topography.
- 2) Site visit for planning of access, utility notification marking/filing, and verification of utility clearances prior to conducting geotechnical explorations.
- 3) Direction and observation during excavation of twenty-six (26) test pits within the plat project area by a subcontractor, using a rubber-tracked mini-excavator, to termination depths of 2.0 to 8.0 feet below existing ground surface (bgs).
- 4) Visual reconnaissance of site interior areas to generally assess the character of slopes, observe for and map geologic hazards, and document/measure exposed bedrock structures.
- 5) Additional explorations off site at Sea Pines Road for utility construction planning. Two (2) test pit excavations and two (2) hand auger borings were performed at the western end of Sea Pines Road, near the eastern boundary of the project site.
- 6) Review and analysis of field data to assess targeted infiltration potential, slope stability, and formulate feasibility-level geotechnical recommendations for plat development.

1.4 Assumptions and Limitations

The composition and characteristics of subsurface soils were assessed by the observing geoscience professional using available geologic information and field interpretations at the time of excavation. It is possible that soil conditions, variations, or transitions occur that are not fully characterized or identified by the field observations and sampling/testing program.

No data is available for exploration depths and locations other than those recorded in the attached exploration logs. The composition and physical properties of the substrate below those depths, or in areas beyond the immediate exploration locations, cannot be determined without additional geotechnical evaluation. Soil composition, groundwater depth, and the physical properties of the substrate can vary considerably depending on geographic location, elevation, and seasonal or climactic factors. Such variability should be expected and anticipated over the study area. The actual character and type of bedrock may also vary among areas between rock exposures.

Groundwater conditions are likely to vary seasonally, and may also differ between locations within the site. The reported groundwater conditions are valid only for the date and location of exploration. If necessary for design, additional targeted explorations or seasonal monitoring of groundwater should be completed.



2 Desktop Review and Interpretation

2.1 Methods

The following desktop analysis was conducted by a qualified earth science professional and, although it is built on previous studies and information obtained by others, it includes new interpretations based on professional judgment and experience. The desktop data inventoried in Table 1 cites the available geospatial data for the subject area, which was evaluated using scientific methods based upon industry best practices.

Table 1: Data Used for Desktop Analysis

Data	Format	Date	Source
Aerial photography (Orthophoto)	SID/JPG	2017/2019	USDA/Whatcom County
Lidar	Bare earth grid	2017	NPSL
Geology	Shapefile	2006	DNR 1:100,000 Digital Geology
Soils	Shapefile	Current	USDA/NRCS Soil Survey

2.2 Location and Physiography

The large-acreage site is located within the southwestern-most part of the City of Bellingham, on the northwest end of Mud Bay. The main site frontage is along Viewcrest Road in the Edgemoor neighborhood of Fairhaven. The site is on the south side of the road, and extends south and downhill to the bay shoreline. The east margin of the site runs north-south near the cul-de-sac terminus of Sea Pines Road. The west margin runs north-south near the cul-de-sacs off South Clarkwood Drive. Bordering sites to the north, east, and west are predominantly developed and in present use as single family residential properties with similar scales of buildings and exterior improvements as the proposed project development. Refer to Appendix I (Figures 1 and 2) for maps depicting the general site location, project boundaries, and surrounding vicinity conditions.

The property is comprised of several contiguous parcels totaling 37.4 acres. The site interior remains generally well forested, populated with mixed conifers and deciduous trees of varying ages along with mature typical undergrowth (ferns, small brush). The site exhibits variable, hilly upland topography throughout a majority of its land area. The upland topography is similar in character to that of residentially developed areas to the east and west. The area along the Viewcrest Road frontage is very gentle to flat, and cleared in the northeastern region of the site while remaining forested in the northwest area. The southeast portion of the site, well outside of the plat development area, consists of a large shoreline bluff slope, over 40% grade and around 100 feet in height, extending down to the shoreline. Further review of slopes within the proposed project development area is provided below.

2.3 **Geologic Background**

The early geologic history of the northern Puget Lowlands is defined by tectonostratigraphic terrane accretion. Volcanic island arcs and associated terrestrial and marine sedimentary units collided with and were incorporated into the continental margin during subduction of the oceanic Farallon plate. This process was ongoing through the upper Mesozoic Era and resulted in the highly faulted and deformed exotic terranes associated with the exhumed and uplifted Northwest Cascades System.



By the lower Cenozoic Era, the crustal material comprising basement rock of the Puget Lowland had formed a pull-apart basin submerged beneath a shallow subtropical sea, which received both continental and marine sediment inputs. This depositional period, constrained to roughly 58 to 50 MA (Lapen, 2000), resulted in the thick sandstone, conglomerate, mudstone, siltstone, and bituminous to subbituminous coal of the Chuckanut Formation prevalent in the Bellingham area. Later folding, tilting, and uplift of the sedimentary unit caused the complex bedding patterns that influence and are exposed by today's landscape. Various continental glacial episodes occurred in recent geologic history, capping valleys and low coastal areas with thick glacial sediments, and commonly mantling foothill areas with thin glacial drift or till soils. Among hilly lowland areas such as the project site, it is common to see a range of shallow conditions over bedrock at depth. Shallow soils can include bedrock-derived colluvium, glacial drift/till, glacial outwash, and locally fine alluvial or organic deposits.

Geologic mapping at 1:100,000-scale, conducted by the Washington Department of Natural Resources (DNR), indicates that the study area is underlain by the Padden Member of the Chuckanut Formation (Ec_{cp}). The Padden Member is a sedimentary bedrock unit described as "moderately to well-sorted sandstone and conglomerate alternating with mudstone and minor coal. Sandstone ranges from fine to coarse grained, with pebbly to conglomeratic sandstone layers common" (Lapen, 2000). In our experience, it is common for bedrock to be overlain by about 2 to 5 feet of cover soils such as colluvium or mantling glacial deposits, varying locally.

2.3.1 NRCS Web Soil Survey

The United States Department of Agriculture (USDA) Natural Resources Conservation Service (NRCS) Web Soil Survey for Whatcom County indicates that there are two primary soil units in the study area; *Everett-Urban Land Complex, 5 - 20 percent slopes* (NRCS Map Unit 52) extending into some northern areas of the site, and *Nati loam, 30 - 60 percent slopes* (NRCS Map Unit 110) across the central and southern majority of the site interior.

Everett-Urban Land Complex, 5 - 20 percent slopes (NRCS Map Unit 52)

This unit typically forms on moraines and terraces from a parent material of loess and volcanic ash over glacial outwash. Typical soil profile consists of gravelly ashy sandy loam through 25 inches depth, then very gravelly sandy loam, loamy sand, and sand through 60 inches depth. The Everett soil is somewhat excessively drained, but has a very low to low capacity to transmit water through its most limiting layer. The unit is assigned Hydrologic Soil Group B and not noted as being prone to flooding or ponding. Depth to seasonal groundwater is typically between 39 to 59 inches. Restrictive flow conditions (densic material) is encountered in the range of 40 to 60 inches depth.

Nati loam, 30 - 60 percent slopes (NRCS Map Unit 110)

This unit typically forms on hillslopes from a parent material of volcanic ash, colluvium, and slope alluvium derived from sandstone, siltstone, and glacial drift. Typical soil profile consists of ashy loam through 38 inches depth followed by weathered bedrock to 42 inches depth. The Nati soil is well drained and has a moderate to high capacity to transmit water. The unit is assigned Hydrologic Soil Group C and is not noted as being prone to flooding or ponding. Depth to seasonal groundwater is typically greater than 80 inches. Paralithic bedrock is typically found beginning in the range of 20 to 40 inches depth.



The findings of our explorations are broadly consistent with the geologic and soil survey mapped units. The shallow soil column consists generally of glacial drift or colluvium and is capped with thin cover deposits derived from or composed of weathered native materials. Drift and colluvium deposits are underlain by bedrock consistent in composition and character with the regional Chuckanut Formation. Exposures on steep rock outcrops are also consistent with the folded sedimentary layering of the Chuckanut Formation.

2.4 **Geologic Hazard Commentary**

Due to the prevalent and variable sloping grades within the project site, and its bordering slope conditions, we performed an initial image review of topography and slope characteristics to determine the approach and focus for reconnaissance-level field review. In the course of this study, we assessed the presence of any obvious active geohazard features, as well as to determine if onsite or proximal areas fall under standard critical area designations for steep slopes as defined by gradient. City of Bellingham Municipal Code (BMC) 16.55.420(B) defines *Landslide Hazard Areas* (LHAs) as slopes having a consistent grade of 40% or greater and a height change of at least 10 feet. *Erosion Hazard Areas* (EHAs) are defined as areas of topography exceeding 30% which are underlain by erosion-prone soil types. BMC language does not differentiate between areas of steep grade and areas indicating active or historical instability; however, this is an important designation for assessing stability and risk of future hazards. For the purposes of our review, we refer to *potential* LHAs as areas of steep grade (over 40% and 10+ feet height), versus *active* or *historical* LHAs defined by interpretation of presence where applicable.

2.4.1 Slope Gradient Review

City of Bellingham CitylQ GIS data (accessed on-line) was initially reviewed for topographic information relating to slope grades. Within the subject site, slope grades are shown by this resource to vary typically under or over 15%, with some prominent hills and scattered features over 40% sustained grade. Steep slopes of the site development area are shown as under 100% grade (1:1), with exception of a steep rock exposure in the northwest quadrant. The regularity of slope occurrence prompted our further detailed spatial analysis using LiDAR-based topography.

The results of our detailed GIS-based topographic analysis are shown in Figures 3a and 3b. This detailed approach demonstrates that a majority of the site interior has grades of under 15% or between 15% and 30% (not regulated by critical area code), shown in light green and yellow shading, respectively. Small scattered areas within otherwise gentle topography are shown as exceeding 30% grade; however, the isolated occurrences are likely to reflect small surface variations on the scale of a few feet that are not indicative or relevant to development regulation. We conclude that the site generally does not contain EHAs that are not associated with and more appropriately classified as LHA areas (either *potential* or *identified*).

Areas over 40% grade are shown on Figures 3a and 3b as orange, and grades over 80% in red. *The site contains various slope features within the development area that are correctly classified as potential LHAs*. The steepest grades within the project area occur on the southeast faces of hillsides, and generally correspond to areas of bedrock exposure. Some isolated and small but steep features appear to be related to historical primitive road cuts. In Section 4, we present the findings of visual field review of steep slopes and steep rock exposures; and we provide interpretations of site stability based on a combination of reconnaissance findings and field data.



2.4.2 **Special Hazard Areas**

Two features of special significance were evident in initial image review. These include: 1) the main southeast shoreline bluff slope, and 2) an area of bowl-shaped topography at the northeast corner of the property. Figure 4 presents site-wide LiDAR imagery including delineation and annotation of the areas noted below.

- The southeastern bluff slope is consistently steep, commonly over 80% grade, and in some areas exceeding 100% grade (1H:1V). The crest of the southeast slope is at roughly 80 feet to 120 feet in elevation (above sea level) depending on area. The crest typically exhibits an oversteepened top of the slope and shows signs of past localized mass wasting activity (serrated trend with cuspate features). The main body of the slope face varies between around 40% and over 80% grade with an overall slope of about 1.5H:1V. From aerial and shoreline photography, we can see that the slope and upland area behind the crest remains forested with mature evergreen trees. At the base of the slope and along the face, are visible areas of exposed bedrock that appear to be dipping moderately or steeply northward into the hillside. We interpret the slope to be comprised of intermittent outcrops of steep resistant bedrock planes, interspersed with colluvium slopes that are reclined enough to support the existing forest vegetation. Despite the locally hazardous features present, we infer that the slope has a high degree of internal global stability as a function of the bedrock-structure orientation. The plat development proposes an "open space" tract along the entirety of this feature. Furthermore, the lots proposed uphill from its crest are sufficiently large to permit a substantial setback (well in excess of 100 feet) from the bluff slope. In our opinion, a detailed review of the feature is not necessary for plat approval.
- 2) The northeast corner of the project area, to the west and northwest of the Sea Pines Road terminus, exhibits geomorphic features indicative of a historical landslide feature (Figures 4 & 5). However, the actual history of the feature is not known. Signs of potential historical mass wasting activity include a concave and convergent topography, arcuate slope crest, and steeper upper scarp with lower-angle interior slope. The presence of wetlands within the interior basin is also consistent with this interpretation. With exception of its northernmost areas downhill from other off-site residences (lots not in project area), the crest is somewhat diffuse below and adjacent to the project development area, indicating some time since formation of the landform. We infer that this is likely a historical mass wasting feature with local crest reactivation or episodic retreat occurrences at its north end. The likely cause(s) of the feature at its location are not clear. It is plausible that the area originally held thicker soil deposits than elsewhere, and may have been influenced by concentrated runoff, or subsurface groundwater concentration (given the wetland presence). It is also possible that the feature originally dates back to the time of late-stage glacial recession, when surface conditions were more volatile. We have delineated the approximate boundaries of the feature (Figures 4 & 5), and the preliminary plat layout has been adjusted for avoidance of its extent plus standard 50-foot landslide hazard buffer. Based on the avoidance, no further review is necessary.



Geotechnical Explorations

3.1 Methods

Site surface characteristics within the project area were evaluated in the field during reconnaissance by the geotechnical team prior to and at the time of the field explorations. A total of twenty-six (26) test pits were completed, on June 30 and July 1, 2020, to directly observe and evaluate the subsurface conditions throughout the interior of the project site. Test pits were excavated by a subcontractor, using a Yanmar EX35-5 mini excavator, to termination depths ranging from 2.0 feet to 8.0 feet below the existing ground surface (bgs). Exploration locations were selected based on access and to provide optimal representative coverage of the site as conditions allowed. Test pit locations are indicated on Figure 6, Appendix II. Detailed exploration logs and laboratory testing reports are also attached in Appendix II. Select photos of representative conditions observed in test pit excavations are shown in Exhibit A.

3.1.1 **Subsurface Investigation**

Twenty-six (26) test pits were excavated at representative areas within the project site as access allowed at the time of the work. General exploration areas were pre-selected by Element geotechnical staff based on the provided preliminary development plan, and field-located by an Element Solutions geologist during initial site reconnaissance. Final test pit locations were adjusted based on existing access and utility considerations. Each test pit and boring location was marked in the field using a hand-held TOPCON FC-5000 GPS unit (±3 m accuracy).

Soils observed during explorations were classified by visual means according to the ASTM D2488 Soil Engineering Classification System. Subsurface water and high moisture conditions, including apparent groundwater level, seepage occurrences, and saturated soils, were also noted as encountered during explorations.

An Element geologist collected representative direct grab samples of soils encountered in test pit excavations. Samples were placed in sealed plastic bags for transport and storage. Following field activities, samples were re-examined to confirm field classifications. Representative soil samples were then submitted for laboratory testing to aid in final classification and for use in analysis of soil design properties. Remaining samples will be stored temporarily by Element; additional testing of samples can be conducted at request of the client.

3.2 **Subsurface Soil Conditions**

Subsurface soil and bedrock conditions encountered in the explorations were broadly consistent with regional geologic and soil mapping. The explorations support the overall geologic interpretation of the site as underlain by shallow bedrock and associated cover deposits; capped or mantled by glacial outwash, glacial drift, and glacial till varying locally. Cover soils thickness and character differed by location, but generally consisted of organic-rich topsoil underlain by silty sand of glacial deposition or rock-derived origins.

A brief summary of the observed soil horizons is presented below. For complete information, refer to the attached exploration logs (Appendix II). The interpreted geologic unit for each horizon, corresponding to the summaries below, is shown in bold with the soil description.



<u>Uncontrolled Fill:</u> Shallow materials, interpreted as non-native uncontrolled fill were found at one location (TP1, northeastern margin area) to approximately 3.5 feet bgs. The location coincides with an area of somewhat raised grade at the northern extent of the "East Road", currently a primitive and overgrown off-road feature. Based on topographic indications, we suspect that similar fills may extend into the properties located to the east and west of TP1. The fill consisted of silt with sand (USCS Classification: ML) containing approximately 50% to 60% fines, was soft to medium stiff with depth, cohesive with low plasticity, and damp in the early summer season. The fill contained some chunks of asphalt, and was capped with about 0.7 feet of topsoil. A band of dark orange oxidation staining was observed from about 3.0 to 3.5 feet bgs near the base of the fill material.

Topsoil: Organic-rich silty topsoil (USCS Classification: OL) was present at the surface of all exploration locations to depths ranging from approximately 0.3 feet to 3.0 feet. With the exception of TP3, topsoil horizons found in test pits along the primitive northeast-southwest (NE-SW) trending access corridor (TP2 to TP12 run) were all less than 0.9 feet thick and had an average thickness of about 0.5 feet. The limited depth may be due to prior partial stripping. The northwest margin of the site exhibited a more well-developed and thicker topsoil horizon, often in the range of 1.5 feet to 3 feet. The organic silt displayed consistent characteristics throughout the study area, and contained occasional cobbles and root material. The topsoil was generally dark brown to medium reddish-orange brown, soft, and damp to moist.

Glacial Deposits:

Glacial Drift

Interpreted glacial drift deposits encountered on site were composed of predominately coarse-grained material containing varying degrees of fines, gravel, cobbles, and occasional boulders. Glacial drift soils along the primitive NE-SW access corridor were predominately comprised of silty sand with some gravel and cobbles (USCS Classification: SM) and fine fractions in the range of 20% to 40%. The SM soil was commonly gray to grayish brown, non-plastic, low to moderately cohesive, and typically medium dense at shallow levels before transitioning to dense glacial till or bedrock conditions below. Gravel clasts were sub-rounded to rounded, as were the occasional boulders observed within the unit. Soil water content was generally noted as damp to moist conditions and decreased with depth. Mottling and oxidation staining was often observed in the drift soils, decreasing or vanishing with depth into basal till or unweathered bedrock.

Glacial Outwash

A soil horizon ranging between 1.2 feet and 3.0 feet thick, interpreted as glacial outwash (recessional), was uncovered below the topsoil in the northwest area of the site (TP13 - TP17). The outwash soils were composed of a variety of well- to poorly-graded sand and gravel, with some cobbles, and fine silt content ranging from about 2% to 20%. The granular soils were medium dense, non-cohesive, non-plastic, and damp to moist. Coloring was grayish brown to light gray in test pits where sand was the dominant constituent; and brown to orange brown in areas dominated by gravel. Clasts were rounded to well-rounded, and some caving was observed in test pit walls. Other than TP15, where refusal was met on a large boulder, dense glacial till was found at the base of outwash soils. Outwash-type soils were observed to overlie Drift soils at multiple test pits, and elsewhere was found in substitution for Drift deposits.



Glacial Till

A medium dense to densely compacted mantle of glacial till was found overlying bedrock at a majority of test pits (excluding locations on or near the tops of outcrops). The till unit was composed of grayish brown to light gray silty sand containing some clay, gravel, and occasional cobbles (USCS Classification: SM). Fines content was generally in the range of 20% - 40%, sand content was medium to fine-grained, and gravel clasts were often small and rounded. The SM soil displayed low to moderate cohesion and low plasticity. The density of the till increased greatly in the last 0.5 feet to 1.0 feet of the unit, becoming cemented and blocky, often forming a thin veneer over the underlying bedrock. The upper horizon of the till was locally-weathered and weakened, but became progressively dense with depth. Moisture content was generally low and decreased with depth in concert with an increase in densic or cemented and blocky texture.

<u>Colluvium</u>: Soils distinct from glacial deposits and interpreted as derived from on-site bedrock, either redeposited (colluvium) or weathered in place (regolith / paralithic rock), were observed in areas throughout the site; most often in test pits located on slopes or in high elevation areas. The rock-derived soils were generally comprised of tan to yellowish brown silty sand with some gravel and cobbles (USCS Classification: SM) containing approximately 20% to 30% fines content. Sand was poorly graded and mostly fine to medium. Gravel and cobble clasts were tan and angular. The SM soil was damp, non-plastic, displayed low cohesion, and was medium dense to dense as it transitioned into the more intact weathering rind of the underlying bedrock. At multiple locations in the north-central area of the site (TP-18 & 19), this deposit was found underlying Glacial Drift. Due to the nature of colluvium deposits, they may range in age and character by location.

Soils that appeared to have been weathered-in-place (eluvium) were observed at the top of the outcrop in the northwest region of the site (TP25 and TP26). These soils appeared similar in character to the more frequently observed colluvium, but were made up almost entirely of poorly-graded medium sand (USCS Classification: SP), containing less than 5% fines. The SP soil was yellowish brown, non-plastic, non-cohesive, damp to moist, and loose to medium dense in the upper 3.5 feet before transitioning to the underlying weathering rind and bedrock at 4.0 feet bgs.

Bedrock: Apparent intact sandstone bedrock of the Chuckanut formation was encountered in a majority of test pits across the study area. In the southeast part of the project area, along the primitive NE-SW access corridor (TP2 - TP12), the depth to bedrock was consistently less than 4.5 feet, with exception of TP8 where bedrock was encountered at 8.0 feet bgs. The depth to bedrock was only slightly greater along the proposed "West Road" corridor and in the central region of the site, where refusal was generally met at around 5.0 feet bgs or less. Extracted rock samples were comprised of angular, dry, tan, poorly-graded sand to silty sand. The inferred bedrock conditions are consistent with the Padden Member of the Chuckanut Formation, mapped in and around the study area and exposed in scattered outcrops. See Figure 7 for a summary of depth to bedrock by exploration location.

Bedrock was not encountered in the northwestern corner of the site at the TP13 - TP15 locations, which were terminated in dense till-like conditions or on a large boulder. This suggests that depth to bedrock is greater in the northwest corner of the site. It is also common for the Chuckanut Formation rock profile to vary locally. The depth to rock encountered along the primitive access corridor and proposed "West Road" alignment was relatively consistent and may be broadly representative of the site. However, as observed at TP8, local variation should be expected.



3.2.1 Laboratory Testing Results

Grab samples were collected from test pit excavations at the depths noted on the logs. Following field work, we reviewed the exploration findings and selected representative samples for laboratory analysis to confirm soil properties and visual classifications. Samples were delivered to GeoTest Services, Inc. for hydrometer analysis (ASTM D422/D1140 method), sieve analysis (ASTM C136/C117 method), percent passing #200 (fines content), and Atterberg Limits (Plasticity Index) testing. Organic content (ASTM D2974 method) and cation exchange capacity (EPA 9081 method) testing were performed by Northwest Agricultural Consultants. The sample array and test results are indicated in Table 2 below. Complete laboratory test reports are attached in Appendix II.

Table 2: Summary of Laboratory Testing Results¹

Sample ID	% Gravel		% Sand		% Fines		Atterberg Limits			USCS	
Sample 15	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay	LL	PL	PI	0303
TP1 - 6'	8	15	5	11	30	20	11				SM
TP2 - 2'	0	8	4	23	54	11					SP-SM
TP8 - 4'						20		51	25	26	SC
TP9 - 4'						22					SM
TP10 - 3'	0	5	2	17	55	21					SM
TP12 - 3'						28					SC/SM
TP13 - 4'	28	28	12	27	3	2					GP
TP13 - 6'	0	20	8	21	23	21	7				SM
TP16 - 3'	26	26	9	22	12	5					GP-GM
TP16 - 4.5'						39		21	16	5	SC-SM
TP24 - 4'	19	21	10	21	21	6	2				SP-SM
TP25 - 2.5'						2					SP

- 1. Test results from Northwest Agricultural Consultants:
 - a. TP1 (6.0'): Organic Matter = 1.77%; Cation Exchange Capacity = 11.6 meq/100g
 - b. TP13 (4.0'): Organic Matter = 1.50%; Cation Exchange Capacity = 3.9 meq/100g
 - c. TP24 (4.0'): Organic Matter = 1.44%; Cation Exchange Capacity = 6.2 meq/100g

Gradation results from all samples indicate that fines content of the glacial deposits ranges from as low as 2% to as high as around 40%, with typical values between 20% to 30% fines in the drift and till soils and below 10% to 20% for the local outwash deposits. Field assessment of soil plasticity suggested non-plastic to low plasticity behavior in a majority of observed soil types. Atterberg Limits testing of two fine soil samples recorded plasticity index (PI) values ranging from the region of low plasticity silty clay (CL-ML) up to the lower limit of high plasticity clay. Given the depositional source and our field observations of soil character, some variation of fine and coarse fractions and range of plasticity (from non-plastic to low plasticity) is expected, with most soils behaving as non-plastic or low plasticity.



3.3 Groundwater Conditions

Weather conditions were mostly dry during field work with only minor precipitation occurring during the first day of explorations. No excessive surface ponding was observed during field reconnaissance or explorations, outside of designated wetland areas (not assessed in this study). Groundwater and free water conditions were observed directly in excavations. Soils were generally damp to moist throughout the study area. Wet soils were only seen in TP2, where seepage and caving were observed at a depth of 3 feet bgs. However, heavy oxidation staining indicated groundwater levels rise to around 2 feet bgs in this isolated area during the wet season, but was not seen to that degree elsewhere. Varying levels of redoximorphic mottling was observed in soils throughout much of the study area, at depths between 2 feet and 4 feet, also indicate a history of cyclic wetting and drying associated with seasonal groundwater fluctuations, or transient water flow through the upper subsurface. The sloping site profile likely precludes significant perched water table development within the study area. However, some localized areas may be subject to perched water build-up due to depressed or confined areas of topography and the prevalence of restrictive glacial soils or rock at depth. The site is not proximal to any major natural surface water features.

Conditions observed in test pit explorations are interpreted to be representative of the dry season given the timeframe of explorations in the mid-summer. During the wet season, it is anticipated that groundwater and seepage levels will become elevated from those observed in the summer, and that soil moisture contents will be elevated by prolonged wet weather. The groundwater and soil moisture conditions recorded on our test pit logs are valid only for the dates of exploration.

3.4 Additional Explorations – Sea Pines Road

An additional scope of exploration was requested to document and define subsurface conditions in the area of a proposed sewer improvement near the east margin of the site. The proposed connection for Lot 37 (accessed via Sea Pines Road) plans to extend southwest from the existing 8-inch diameter sewer main current western terminus, through a portion of the easement along the north side of Sea Pines Road, and passing beneath the paved cul-de-sac to connect with the outfall from the project site. The depth to bedrock in the utility improvement area may present a challenge or further expense, and influence the final design alignment and depth.

In-progress plans show the proposed extension alignment will run northeast-southwest approximately 40 feet northwest of the Sea Pines Road centerline. Pipe invert elevation is around 105.5 feet at the existing pipe tie-in (NE end), rising gradually to about 107 feet at the connection to the site outfall (SW end). Where the proposed sewer line crosses underneath the existing culde-sac, a minimum of 18 inches of cover will be maintained as required. One or more additional manhole structures may be installed in conjunction with this extension. Base elevations of manhole structures would be in the realm of elevations 105 to 106 feet.

3.4.1 Methods

Subsurface explorations were performed in the vicinity of 315 Sea Pines Road on November 13, 2020. Weather at the time was intermittently rainy. Two (2) test pits (TPs) were machine-excavated in the grassy area north of the cul-de-sac. Two (2) supplemental hand auger borings (HAs) were completed in the area just west of the cul-de-sac during the field visit. An aerial photo site map showing the Sea Pines TP & HA locations (Figure 8) and surveyed topography, subsurface TP and HA logs, and a field photo array (Exhibit B) are attached in Appendix II.



3.4.2 Subsurface Conditions

Test pits were excavated to depths of 6.8 feet bgs (TP-1) and 6.6 feet bgs (TP-2). Organic topsoil and silty/clayey sand were found to overly bedrock at TP-1, and dense glacial till at TP-2. The thickness of cover soils was around 5 feet in each location. The upper soil was generally medium dense and damp to moist or locally wet, containing 20% to 50% fines and exhibiting variable levels of plasticity as interpreted in the field.

Bedrock conditions in TP-1 were observed in the southern (downslope) wall of the pit at a depth of 5.5 feet bgs, and were also present at the central base of the pit. Bedrock was composed of dense, dark gray, medium to fine-grained intact sandstone. Although bedrock conditions were not directly observed in TP-2, it is likely that the dense till material is a thin mantle that is underlain by rock, as seen in numerous other test pits performed within the study area to the west. Shallow seepage was observed between 2.5 feet and 3.5 feet bgs in TP-1, and between 1.2 feet and 2.5 feet in TP2. Seepage appeared to be constrained to the upper soils in the test pits, with moisture content decreasing at depth. Explorations were done in the late fall shoulder season; seepage levels are, therefore, likely elevated from dry season conditions, but not necessarily representative of fully developed wet season conditions.

One hand auger boring (HA-1) was advanced horizontally into the slope cut located just west of the driveway for 315 Sea Pines Road. The boring was advanced through silty sand that transitioned into sandstone weathering rind before hitting refusal at 1.0 feet bgs on very dense, apparently intact, bedrock conditions. Bedrock composition in this location was consistent with conditions observed in other regions of the study area, composed of orange-brown to tan, medium- to fine-grained sandstone.

HA-2 was performed just southwest of the cul-de-sac, south of the proposed sewer alignment in a vegetated area. The boring revealed approximately 0.6 feet of topsoil overlying silty sand containing some clay and gravel with the occasional cobbles, similar to cover soils seen elsewhere. The boring was advanced to an end depth of 4.2 feet bgs where refusal was met, apparently due to a large cobble in the subsurface. Although no groundwater was observed in the boring, and no heavy bands of oxidation coloring were observed, light mottling throughout indicates that the soil likely transmits some amount of water at least intermittently during the wet season.

3.4.3 **Utility Construction and Bedrock Profile**

Following field work, test locations were accurately plotted on a survey map to estimate surface and bedrock elevations. Shallow bedrock was discovered at the toe of the slope in HA-1, around elevation 117 feet, near where the utility will exit eastward from Lot 37. Dense rock conditions were found to be present approximately 1.0 feet into the slope at this area. Whereas, HA-2 found no bedrock through 4 feet depth (roughly elevation 106 feet), suggesting depth to rock can be highly variable along this area at the base of the slope. This could present challenges for excavation to planned utility bedding depth if rock is present at final design location and depth.

At the northeast side of the cul-de-sac, termination of TP-1 was around 5.0 to 7.0 feet bgs on bedrock (elevation 108 feet to 110 feet). At TP-2, bedrock was not present through 110 feet elevation. With an invert elevation in the realm of 106 feet, construction of the sewer outfall line and related structures may contact and require removal of bedrock on the order of a few feet thickness, or less.



4 Geologic Hazards & Slope Stability

4.1 Review Methodology

The presence and condition of delineated potential Landslide Hazard Areas (LHAs) within the project development area was reviewed as part of this feasibility-level study. As noted in Section 2.4, portions of land within the project site and bordering areas exhibit topography with the combination of height and grade to be defined as *potential* LHAs. The occurrence of defined LHAs is common for hilly areas dominated by bedrock geology in our region, but does not necessarily portend a high or imminent risk of failure. Nor does it trigger blanket avoidance requirements that prohibit construction. Rather, these features are examined on a case-by-case basis to assess the actual hazard presence or potential thereof, and to formulate recommendations for informed development to minimize the risks associated with these natural conditions.

Detailed lot-specific review and exploration for final design recommendations for structures is outside the scope of this study. It is our understanding that lot-specific investigation of subsurface conditions for final design and building permit review will typically be completed individually by the owner at the time of lot development (as is precedent). A lot-by-lot review of existing geohazard features can be completed as needed for the plat approval process under an additional scope of work, if required. A discussion of further work anticipated is included in Section 4.4.

Element Solutions has performed a large-scale feasibility-level assessment of on-site geologic hazards which has included the following components to date:

- Image interpretation and identification of areas of interest for field review (4.1.1)
- Consideration of potential failure mechanisms and contributing geologic conditions (4.1.1)
- Reconnaissance of vegetated/forested slopes to assess for signs of instability (4.2)
- Detailed observation and structural measurement at several steep bedrock outcrops (4.3)
- Graphical analysis of bedrock structures and outcrop stability factors (4.3)
- Determination of actual hazards and recommendations for setback/avoidance (4.4)

4.1.1 Stability Factors and Areas of Potential Hazard

The findings of subsurface explorations and our observation of local exposures indicate that the site is capped by various shallow soil deposits and underlain by folded and tilted sedimentary bedrock of the Chuckanut Formation. We infer that large-scale deep-seated, or global, stability at the site vicinity is controlled and influenced by bedrock structures. Thus, the orientation of rock structures in reference to topography is the primary factor for slope failure modes. Conversely, the stability of shallow soils at a given location is a function of several factors including the character of local deposits, presence of groundwater and potential for runoff inundation, steepness of grade, and stabilizing vegetative cover. As the underlying rock profile limits the depth of a potential failure, the most likely types of failures in cover soils include shallow slumps, translational slides, and saturated mudflows. The most common trigger for shallow instability is oversaturation by groundwater or runoff. Larger circular failures in the site vicinity may be possible where capping glacial soils are thick, or where the underlying bedrock is sufficiently weak/fractured to behave like a soil mass (not observed). Neither condition was found in test pits, although the noted apparent historical landslide area at the northeast corner of the site may have been influenced by a combination of these factors.



Upon reviewing slope gradient and LiDAR maps, we identified several features for particular focus during reconnaissance. The features occur within and bordering the proposed development area, are indicated on the annotated site map (Figure 9, Appendix III), and include:

- Northwest-facing forested slope in the NW quadrant of the site
- Various localized western and central vegetated slopes
- Northwest and west-central steep southeast bedrock faces
- Southeast-facing forested slope within the SW portion of the site

As discussed in Section 2.4.2, we also considered the presence of two specific hazard areas at the margins of the development area (Figures 4 and 5). These features represent known or suspected geologic hazards that may influence the site's final development approach. The coastal southeast slope downhill of the project area is a steep and prominent topographic feature that commonly exceeds 100 feet in height. An apparent historical landslide area is present at the northeast corner of the project area. Reconnaissance and direct observation of these bordering areas was limited or not possible within the scope of this study due to safe access difficulties. Given their location relative to proposed development features, the current review relies upon inferences from site geology and LiDAR image interpretation to set conservative setback standards.

4.2 Slope Review & Observations

During our subsurface exploration program, and following visits for examination of identified areas of interest, an Element Project Geologist and Licensed Engineering Geologist observed conditions of the vegetated slopes among the project area. The purpose of our assessment was to evaluate the present-day stability of the site slopes, and to assess for the presence of indications or features associated with past instability. We traversed the slopes of interest on foot, noting topographic and vegetation patterns and searching for the presence of failure features such as scarps, eroding gulleys, hummocky accumulation zones, etc. Element staff also photo-documented representative slope and bedrock outcrop conditions (Exhibit C). The following subsections address conditions observed by referenced area.

4.2.1 Northwest Slope

This slope is generally planar on the northwest side facing Viewcrest/Fieldston Roads. Elevation increases continuously to the southeast from about 230 feet at the base to about 350 feet maximum at the crest of the slope over a distance of about 250 feet for an average slope ratio of approximately 2:1 (H:V). Statistical analysis of the entire backslope area indicates a mean slope grade of around 50% (~27 degrees). In our experience, this grade is typical for forested, bedrock-controlled slopes in the region.

A predominant majority of the slope area is covered by an established tree canopy, and is vegetated with ferns and other native shrubs. Although many of the trees on the slope were growing straight, some displayed pistol-butt profiles, leaning trunks, and exposed root, indicating that some degree of long-term shallow soil creep is occurring (as is common for steep slopes). The lack of adequate rooting depth may also be contributing to tree orientations, independent of the soil creep phenomenon. Many trees were seen along the edge of the rock cliff face, indicating a stability in the underlying earth material on the plateau of the hill. While some small alders were observed to have fallen from this area, it is likely due to windthrow and a shallow root system, rather than general instability (Photo 1, below).



Based on vegetation patterns, GIS data analysis, and field observations, the northwest slope appears to be in an overall stable condition lacking signs of large-scale or local instability (aside from typical soil creep). The ground surface is well vegetated, and free of signs of heavy localized erosion or channeling of runoff. Where the ground surface was visible, we did not see indications of slope face retreat, serration or tension cracking, or subsidence that would indicate episodic movement. Some local evidence of historical rock-fall debris was observed near the base of the northwest slope face, but the incidence of fall did not appear to be high, and fallen materials did not extend far from the slope. No ponding, saturation, or seepage was observed above or on the slope during our visits in the summer 2020 season.

The opposite southeast side of the northwestern hill exhibits a steep or cliff-like face with prominent bedrock outcrops. Similar conditions are present to a lesser magnitude along the southeast faces of multiple smaller hills in the central project area. The cliff-formed faces are typically continuous for around 10 to 20 feet maximum and interspersed or bordered with vegetated steep slopes. Small scale rock-fall was observed along the southeastern side of two of the prominent ridge features in the central region of this area, interpreted to be occurring at a low rate of regularity. Detached bedrock blocks were not observed to have traveled far from their points of origin on the outcrops.



Photo 1: Bedrock Cliff Face; Northwest Slope

The cliff area along the northwest hill represents the greatest exposure and highest hazard potential for associated rock-fall (Photo 1, above). At its steepest point, the elevation drops about 37 feet over a horizontal distance of ~25 feet for an average slope ratio approaching 1:1.5 (H:V) along the cliff face. Grades range up to approximately vertical, and are locally overhanging on the variable outcrop faces. We observed these features to be highly influenced by the regularity and orientation of rock structures dictating their stability and character. Section 4.3 below provides a review of bedrock features and structures.

4.2.2 Western and Central Slopes

Select slopes among the middle western and central regions of the site display topography meeting the definition of a critical area slope. These slopes are similar in character to the dominant northwest slope, but occur on a smaller scale interspersed within areas of relatively gentle grades (15% to 30%, or under 15%). Topography appears to be bedrock-controlled, with steeper faces, locally cliff-formed, outcropping on the south or southeastern side of the raised areas. The steeper faces, where grades are greater than 80%, are only continuous for around 10 to 20 feet maximum. Small-scale rock-fall evidence was observed along southeastern side of two of the prominent ridge features in the central area. Similar to the northwestern area, detached blocks and rocks were not observed to have traveled far from their points of origin.

The landforms of interest consist of local rises on the order of about 20 feet maximum expression in relation to surrounding topography that is more gently rolling or sloping. With exception of the



noted cliff faces, slope gradients are in the range of about 2:1 (H:V) up to 1.5:1 locally. At the top of each local slope area, is plateau or bench topography of low grade. Vegetation is well-developed forest with mature trees and typical undergrowth. During representative reconnaissance of the vicinity, we saw no obvious indications of instability or excess erosion occurring on the steeper grade areas. There were no features identified that would constitute an active geologic hazard.

4.2.3 Southwest Slopes

Slopes flanking the southern project area can be divided into two areas with distinct character. The upland southwest slope begins within the proposed plat lot area and descends with some local breaks, at a predominantly moderate grade, down to a large gentle bench of variable width. The lower coastal southeast slope below the bench descends steeply from crest to shoreline.

The lower coastal slope was identified as a special geologic hazard area recommended for avoidance, with character overviewed in Section 2.4.2. The plat development proposes an "open space" tract along the entirety of the crest of this feature. The proposed lot layout also provides room for substantial setbacks of residences from the lower slope crest (roughly 200+ feet at all lots). We conclude that the proposed layout meets the preferred "avoidance" of the hazard area as well as a reasonable buffer zone. No detailed reconnaissance-level assessment was conducted.

The upland southwest slope generally consists of a series of smaller banks and narrow benches along its upper third (near proposed building areas), followed by more continuous sloping grades downhill. Intermittent slopes on the upper part are roughly 10 to 20 feet high and around 2:1 (H:V), up to 1.5:1 or steeper locally. Benches are on the order of 10 to 20 feet wide with grades under 30%, or below 3:1. The slope and bench topography appear to be controlled or influenced by underlying large bedrock structures, which outcrop locally. Below the second bench (downhill of all proposed building areas), the slope falls at grades of around 2:1 for approximately 50 to 60 feet of elevation until transitioning into the large lower bench of the site (outside of project area).

Topographic contours and LiDAR imagery illustrate that the southwest slope is a generally planar feature; aside from the bedrock-influenced benches breaking the upper third into multiple smaller banks. There are no obvious geomorphic features on the slope suggesting a history of slope failure or channelization of the slope face. There are no apparent head scarps or bowl-shaped features. During reconnaissance, we did not observe any indications of historical or active instability. The slope is well-vegetated with mature forest growth. Trees are generally straight or have minor curvature/tilting attributed to typical soil creep phenomenon.

Aerial photo imagery of the shoreline area was acquired for calendar years 1977, 1994, 2001, 2006, and 2016 to assess for indications of changes or evolution among the southeast slope and coastal area. All images were retrieved from the Department of Ecology Shoreline Photos collection (accessed online). The photo series illustrates that the shoreline and upslope site conditions have not changed appreciably over the preceding 44-year timeframe. Contemporary site conditions appear relatively unchanged from photos taken in years past, and no major clearing or site alterations were observed in the southeast upland area. No obvious indications of mass wasting, such as land scars or loss of vegetation on the slope or shoreline, were observed within the site or surrounding area throughout the period of photo-record. Based on the photo record, we interpret that the shoreline has not undergone visible retreat and that slopes along and above the coastline have remained generally stable over the last 44 years.



4.3 **Bedrock Outcrops & Structures**

During reconnaissance, several prominent rock outcrop slopes or cliffs were identified that corresponded to areas of steep to very steep topography indicated by imagery. An Element Project Geologist and Licensed Engineering Geologist returned to the site for detailed observation and direct measurement of the character and structures of the exposed bedrock. We also noted the patterns of rock debris, including extent, size, and relative age, associated with rock cliff areas.

Rock character, intactness, and structural features were examined and documented on the individual outcrop scale (Exhibit C). We measured representative structures with a 360 Azimuth Brunton compass, noting strike and dip of planar features. Rock structures measured included primary bedding, main and secondary jointing patterns, and other planes of weakness if present.

4.3.1 **Bedding**

Within the project area, bedding strikes roughly east-west to northeast-southwest, dipping north and northwest at moderate to steep angles. According to geologic map resources (e.g. Lapen, 2000), the site lies along the north limb of a broad anticline that traverses the ridge of Chuckanut Mountain, in a northwest-southeast trend, before bending west through the north end of Chuckanut Bay. The hinge of the anticline plunges moderately westward, creating an elongated "V" pattern of major bedding structures and oblique bedding orientations that change by location relative to the hinge. At the site location north of the hinge, bedding is dominantly north- and northwest-dipping. This site-scale pattern can be seen on LiDAR imagery (Figure 4) where resistant beds outcrop or directly influence topography. At the east part of the site, bedding is close to an east-west strike, whereas the west part of the site exhibits northeast-southwest striking topographic features interpreted to be representing or influenced by bedding planes.

It is not clear why the bedding orientations and outcropping patterns are irregular within the site, and outside the scope of this work to further assess. Variations in bedding may be attributed to natural variance in folded rock, since the planar orientation does not range more than about 10 to 20 degrees in each direction from a rough-average ENE-WSW strike. It is also possible that more complex secondary folding is present, and/or that the western part of the site is approaching the fold hinge and reflecting the hinge orientation in part. Also unclear is why the prominent rock faces are isolated and discontinuous in the uphill half of the site, while the rock patterns and outcrop style are relatively consistent along the southern margin and coastal area. It is plausible that the upland area was more heavily affected by the advancement of glacial ice over several ice age episodes. While glacial deposits are relatively thin, the effect of rock erosion during glacial advance may have been significant enough to alter the upland landscape.

Generally speaking, the major bedding orientation (dipping northwest, into hillsides) is favorable for site slope stability. We examined this relationship and variations on the outcrop scale. Bedding on the large northwest cliff face ranged in strike from 220 to 255 degrees (360 Azimuth). Dip of bedding at the northwest outcrop was between 40 and 60 degrees (Figure 10a). Bedding on the smaller west-central outcrops was either broadly similar (west location) or progressively east-west striking (east location). Both outcrops exhibited bedding that was relatively steeper than at the northwest cliff; measured dips ranged from 55 to 65 degrees (Figure 10b). Converse to the bedding, outcrop faces were oriented NNE-SSW or NE-SW and moderately steep to steep overall facing to the southeast. *At all locations, bedding is oriented nearly opposite to the exposed face*.



4.3.2 **Joint Patterns**

In the folded Chuckanut Formation, it is common to observe one or more brittle joint orientations that occur in a discontinuous, but regular interval on the one-foot to several-meter scale. These planes of weakness are also common enough to influence rock slope stability. In our experience, the primary joint plane is often roughly perpendicular to the bedding orientation, occurring as a result of folding and/or compression of the unit during deformation. One or more secondary joint orientations may be oblique or perpendicular to the first joint set and/or bedding. These are often attributed as bedding expansion joints and, therefore, form weaknesses near orthogonal to the bedding itself but are confined within bedding layers. The result of one or multiple joint patterns on slope stability can range from relatively nil to major depending on joint orientations versus each other and the exposure plane.

In the outcrops, the *main joint pattern was observed to be steeply to moderately dipping west or southwest and striking NNW-SSE or NW-SE. The dominant orientation is normal or oblique to the exposure faces, and is close to orthogonal to average bedding*. At the northwest cliff face (Stereonet Figure 10a), the main joints were near-vertical and one companion joint was measured (same strike, dipping opposite direction to NE). At the central outcrops, the main joint planes were typically steeply to moderately dipping to the SW (Stereonet Figure 10b). Joint structures are shown as dotted planes with bedding as solid lines in the attached Stereonet diagrams.

Multiple secondary joint or fracture orientations were also measured at each outcrop area. We note that these features tended to be smaller, discontinuous planes or open-face fractures that are poorly defined, and thus they do not necessarily represent a major discontinuity structure. However, they can have an influence on outcrop-scale processes such as rock fall hazard. Open planes were observed dipping steeply south or SE in a similar or oblique orientation to the outcrop (possibly influencing the outcrop orientation). These were characterized as rock fall breakage surfaces (see discussion below). We also observed a sub-horizontal joint plane along the northwest cliff face that was not observed elsewhere and may be relatively rare or inconsequential.

Finally, we observed for obvious indications of joints intersecting in unfavorable orientations contributing to rock falls or slides. Excluding the subparallel-to-face joints, we did not observe wedge or triangular joint patterns in the outcrops that could be associated with a non-planar failure system. This is consistent with our graphical interpretation of joint patterns and orientations relating to wedge failure (discussed in 4.3.3).

4.3.3 Rock Face Stability

Strength of a rock mass is controlled and limited by internal structures that are planes of inherent weakness (bedding/foliation) or fractures (joints, veins, faults), rather than rock strength itself. Inherent planes are penetrative, while fractures tend to be discontinuous but regular in occurrence. Orientation of structures with respect to the slope face influences the potential for various styles of rock slope failures. Major failure types include planar sliding (along a continuous bedding or fracture plane), wedge failure (intersection of two planes forms sliding angle with respect to outcrop), and raveling or toppling (intermittent mass wasting parallel to face, style depends on rock type). Each type of failure is discussed below in terms of its interpreted potential at outcrops on site. Interpretations are adopted from Wyllie & Mah (Rock Slope Engineering, 4th Edition, 2005), based on prior work of Hoek and Bray (1981) for rock slope stability. Stereonet plots (Figures 10a & 10b) were used for graphical analysis and interpretation of failure modes.



PLANE FAILURE:

Planar failures can theoretically occur where a sliding surface emerges on a steeper exposed face. The sliding surface must be dipping greater than the rock's friction angle (commonly between 30 to 40 degrees for granular sedimentary rock). The reference text notes that pure planar failures are rare, as they demand several unfavorable boundary conditions to be met in addition to the correct plane orientation. Planar failures are also limited to planes within about 20 degrees strike of the exposure.

Outcrops and slopes at the site are not at risk of planar failure from the bedding or primary joints. Bedding dips in the opposite direction of the cliff exposure slopes, and the main joint planes are nearly orthogonal to the slope face. Secondary joint and breakage faces are considered small and discontinuous, and not inherently at risk for sliding failure.

The northwest slope face is oriented similarly to bedding. We surmise that the slope form is influenced by rock bedding. However, the condition does not represent a dip-slope hazard. The topographic slope incline is less than the bedding orientations observed, so that bedding submerges into the ground as opposed to emerging from the slope at a lesser angle.

WEDGE FAILURE:

A wedge failure mode can be created along the intersection of two planes of weakness when the intersection line of the planes satisfies criteria for sliding relative to the slope face, even if the planes themselves would not. Again, the intersection must slope greater than the friction angle of the rock discontinuity and daylight on the slope in an orientation close enough to the slope dip.

We examined potential wedge failure modes resulting from joint-to-bedding and joint-to-joint interactions at the site. The *main intersection of bedding and joints plots in the northwest quadrant of the Stereonets, and plunges moderately to steeply northwest* (Figures 10a & 10b), thus into the steep outcrops. Other intersections with bedding and shallow joint planes are all at low angles which do not pose a risk of sliding. While this avoids direct wedge failure, we note that the steep intersections could contribute to small-scale rock fall in the opposite direction when paired with other factors including cliff exposure.

TOPPLING/RAVELING:

Failure by toppling or raveling does not require a sliding scenario, but can occur under a variety of circumstances which vary in severity and regularity by rock type. A key factor for this type of failure mechanism is the presence of a steep, sub-vertical, or overhanging slope face, along with steep bedding and/or jointing planes. Shallow secondary planes which disrupt the main planes can further deteriorate the rock mass.

We infer progressive raveling and/or small-scale wasting of the rock face is a common and unavoidable occurrence at the outcrop locations within the site. The major bedding planes have been dissected by steep and shallow jointing on the foot- to meter-scale, resulting in exposed rock susceptible to localized raveling over time despite the favorable bedding orientation. However, the presence of the natural cliff exposures indicates the rock mass at these locations is relatively stable and subject to a slow process of raveling, presumably since the last glacial episode.



4.3.4 Rock Fall Characteristics

Existing rock debris observed on the ground surface in the downslope vicinities of the several exposures is broadly consistent with our interpretation of raveling and small-scale rock breakage as the main mechanism of rock wasting. We have relied on the empirical patterns of prior rock fall observed in the field to inform their occurrence, apparent regularity, and overall magnitude.

Some evidence of incidental toppling was observed near larger rock faces in the northern and central regions of the project area. Fallen blocks were generally observed to be of an elongated shape, and the majority were measured to be from about 1 foot to 3 feet in size along the a-axis. Blocks were observed to be situated around 10 feet to 15 feet maximum from their perceived points of origin. Some larger blocks, around 5 feet to 7 feet along the a-axis, were also observed to have become detached and traveled short distances. The larger blocks were also of an elongated shape, and were only observed to have traveled about 1 to 8 feet from where they had fallen. The non-spherical shape of the blocks is interpreted to reduce the distance of potential translation or runout, along with the presence of thick forest vegetation hindering runout. None of the more recent blocks observed were noted to have fallen more than about 20 feet from the outcrop of origination.

A few relatively medium to large sized boulders were observed in the valley area downhill of the largest outcrop, below the northwest cliff face. These materials were old enough to be partially or mostly buried and covered in moss growth. Their origin cannot be directly confirmed as outcrop rock fall, as they may be an earlier byproduct of historical erosion and/or glacial depostional processes. Even presuming a rock fall origin, the boulders appear to be of significant age indicating a very rare occurrence potential in the time scale of the project.

4.4 **Geohazard Review Findings & Recommendations**

This study has involved field reconnaissance and graphical analysis to review slope stability factors and evidence of instability considering both cover soil deposits and underlying bedrock. Based on the work completed to date, we have reached the following interpretations and conclusions on project site slope stability (4.4.1). These conclusions form the basis of preliminary recommendations for building setbacks, mitigations, or development limitations with respect to specific site features (4.4.2). We also address the need for further lot-specific reviews for design and permitting of individual SFR developments. This section focuses on setbacks for building features (structures, roads, etc.). For discussion of stormwater management features placement with respect to slopes of concern, see Sections 5.1.3 and 5.12.1.

4.4.1 Conclusions on Slope Stability for Development

In our opinion, the sloping parts of the site within and in proximity to the proposed development areas (excepting localized steep cliff faces) display characteristics indicating stable conditions are broadly present. Excluding the special hazard areas discussed in Section 2.4.2, recommended to be avoided, we did not encounter evidence of active or historical slope failures, nor areas of excessive erosion. Forest vegetation throughout the site is well established. The combination of grades and subsurface conditions is conducive to maintaining long-term stability of the site with a relatively low risk of instability. The presence, character, and orientation of bedrock underlying the site is also found to be favorable for global stability of the site. Thus, the variable and locally moderate to steep topography intermittent throughout the site should not preclude its development, assuming a proper design and construction strategy is employed.



Proposed roads appear to be aligned in a manner that avoids excessive cuts or fills on sloping areas, taking advantage of natural benches or valleys in topography. Standard cut-and-fill practices and roadside bank constructions are anticipated to be feasible, as addressed below. Small retaining structures can be employed as needed where space is constrained. Roads and driveway extensions have preferentially avoided areas of steeper grades, where possible. The roads do not pass in close proximity to the delineated special hazard areas. Major utility services will be predominantly constructed along the road corridors and protected from slope processes.

The anticipated building areas on individual lots will deal with a variety of terrain situations. In our experience, the combination of topographic challenges and subsurface conditions are not uncommon for home site development in the Cascade foothills within and surrounding the Bellingham area. The blanket code definition of portions of the project site as geologically hazardous areas based on slope grades should not prevent appropriate use on the lots involved. It is expected that individual lot home designs will incorporate foundations that are best fit to the topography. Multi-tier footing systems, foundation retaining walls, and daylight basement features are commonly used to construct homes on topography similar that present on the project site. The soil and bedrock conditions are considered broadly well suited for these approaches to be adopted on a per lot basis during future design and construction.

4.4.2 Preliminary Building Setback & Avoidance Recommendations

Based on the feasibility-scale review completed to date, we recommend the following guidelines for plat planning and individual lot building placement with respect to geologic hazard features. Note that some locations are referenced below to the most current proposed plat layout.

1) Generally speaking, unless otherwise addressed below, areas within the development zone exceeding the 30% (erosion hazard) and 40% (potential landslide hazard) thresholds per code do not require avoidance or setback criteria. Rather, we recommend development of the areas adhere to best management practices for slope-side design and construction typical for this area. For instance, homes should be carefully sited and designed where steep grades are present to ensure long-term stability of slopes and structures. Local adjustments may be necessary to avoid small-scale features not fully evaluated in the scale of the current work.

Foundations on or near slopes will require embedment and suitable placement on stable subgrades to avoid unacceptable risk. Cut-and-fill leveling of building sites on slopes is not recommended. The use of heightened stem walls, stepped or tiered foundations, and retaining wall features is typically preferred to bank modifications and fill pad construction. In addition, site preparations and restoration measures (erosion control, planting practices, stormwater drainage controls, etc.) must adhere to critical area protection measures as overviewed in Section 5.12.

2) Local rock cliff features are recommended to be avoided by incorporating an appropriate setback to building foundations. The setback can be defined by distance from the slope crest above the feature, or from the relative foundation placement depth and location with respect to the outcrop exposure if the approximate building location and design style are known. For the current purposes, we preliminarily recommend setbacks based on horizontal distance from a slope crest irrespective of design. The recommended setbacks should be reviewed and adjusted as necessary during individual lot design.



We recommend preliminary minimum horizontal building setbacks from the northwest hill southeast cliff face of 30 feet for Lot 8 and 20 feet for Lot 9, the proposed lots located on the narrow ridge. A preliminary 15-foot minimum foundation setback is also recommended for Lot 14, which is located on the uphill side of the west-central steep rock outcrop. The last notable outcrop, generally located at Lot 20, is smallest in stature and may be partially abated by building pad earthwork. Where steep exposed rock remains below the building area, a minimum 10-foot foundation setback from exposure is recommended. These preliminary setbacks equate to an approximate 1:1 distance versus height of the underlying steep outcrops. In our opinion, this is a conservative approach that will provide ample building protection from future potential of instability and periodic rock face loss over the long term.

3) Due to the potential for incidental rock fall from the several outcrop faces, we recommend ample avoidance or protective measures be incorporated for areas immediately downslope of cliff exposures. For the current proposed layout, home sites that may be directly affected by rock fall include Lots 21 and 22. For full avoidance without need for other mitigative measures, a minimum separation of 15 feet from the underside (toe) of the exposed rock face is recommended at these locations. If home construction is elected or required to be closer to the rock face, use of a separate catchment structure (such as a landscape wall with some free height) or incorporation of a heightened reinforced foundation wall is advised. We recommend the conditions be reviewed in detail on an individual lot basis, where necessary during lot-specific design, and that final recommendations for rock fall avoidance or mitigation be issued at that time based on the proposed building layout.

Road and driveway areas may also be subjected to rock fall where in close proximity to the outcrop faces. Areas of potential concern include the primary access "West Road" traversing the valley area below the large northwest outcrop, the attached small driveway access to Lots 16/17/19/20, and the cul-de-sac of the "East Road" below the central small outcrop. However, with the interpreted rare regularity and low potential for significant runout of rock-fall debris, extensive mitigations do not appear necessary. We advise considering incorporation of a topographic swale or low catchment wall on the uphill side of the "West Road" and the "East Road" cul-de-sac to safeguard from incidental rock-fall reaching the roadway and intersecting driveways. If the road alignment is adjusted to be farther from the cliff feature, these measures can be avoided. Alternatively, as-needed rock fall cleanup and repair could be done in exchange for up-front mitigations where construction is costly or limited.

- 4) The coastal southeast slope and its upland vicinity is recommended to be fully avoided by development. For general planning purposes, we recommend applying a non-development building buffer equivalent to the slope height. Total height varies locally from about 100 feet minimum to around 150 feet maximum. The current proposed layout allows for over 150 feet separation to building zones at all areas, consistent with this guideline.
- 5) The northeast corner area, interpreted as a possible historical landslide area based on geomorphic features, is recommended to be avoided. Per City of Bellingham code, the standard minimum setback from active or historical LHA features to developments is 50 feet. The current plat layout allows for ample setback to upslope areas. This setback can be investigated further on a per-lot basis during lot design, and may be eligible for reduction upon demonstrating adequate factor-of-safety is achieved at a lesser distance.



4.4.3 **Need for Lot-Specific Reviews**

The site-wide geohazard review completed to date represents an overview of site features with specific attention paid to potential hazards identified along the boundaries of or intermittently within the large hilly property. It is not intended to serve as a detailed examination of the conditions on individual lots to advise on lot designs. Based on our experience, it is most appropriate to conduct detailed evaluation of topographic and subsurface conditions on individual lots in the future just prior to or during their design and development when proposed features and final layouts can be taken into account.

We recommend that all lots containing or bordering potential LHAs (as code-defined, grades over 40% and relief over 10 feet) be required to conduct lot-specific final critical area reviews at the time of building permitting. At minimum, a reconnaissance-level assessment and review of proposed building plans should be completed. We recommend site evaluations include subsurface exploration to assess foundation conditions and prescribe foundation design/construction recommendations for any building areas on or directly adjacent to slopes over 40% grade. Future studies should be responsible for either confirming the findings and recommendations of this report, including setbacks if applicable, or offering new or revised recommendations based on detailed assessment of a lot.

To some degree, further lot-specific review and critical area documentation can be completed supplementally to this report. Some portions of the site can also be addressed in kind (such as lots at the base of the northwest hill, and lots lining the top of the southern slope). If further detailed lot review is required for plat approval or requested by the client, Element Solutions will be pleased to provide the additional assessment on a per-lot basis.



5 Conclusions and Recommendations

5.1 **Project Feasibility Discussion**

Based on the findings of our site-wide subsurface investigation, geologic hazard assessment, and the interpretations presented herein, it is our opinion that the proposed plat development is feasible as generally proposed. We recommend following the guidelines and recommendations below for plat design and construction. We anticipate conventional design and construction practices will be suitable for this project, assuming a typical level of risk is acceptable.

This study was conducted as a feasibility-level evaluation for the plat, and is not intended to present detailed information for individual lot constructions. In this section, we provide preliminary commentary and general design guidelines for development. On the per-lot scale, the information may need to be expanded upon or modified to address lot-specific conditions. Detailed work done at a later date by Element Solutions or another qualified geotechnical consultant may supersede the broadly based recommendations of this report.

5.1.1 Foundation Feasibility Commentary

For a shallow foundation to be feasible, adverse levels of settlement must be avoided. This requires that either the ground conditions below the structure are suitable for supporting anticipated loads without inducing excessive settlement, or that site preparations and/or design factors are incorporated to minimize inherent settlement risk to an acceptable degree. Settlement can be a result of shallow factors (organic or soft/loose subgrade, uncontrolled or improperly compacted fill, erosion of support, etc.), deeper factors such as soft-soil consolidation, or a combination of both. Foundation settlement can also be associated with sloping grades and insufficient embedment or bearing support.

Native soils at the project site are generally well-suited for residential building foundations and pavement development. The soils are not excessively moisture-sensitive, nor are they of excessively soft consistency or loose density. Shallow deposits are locally variable, however. Shallow saturation in the winter season (caused by underlying restrictive conditions) can also pose a risk for moisture-sensitive subgrade deterioration from freeze-thaw effects. These factors can be mitigated to a reasonable level by careful site preparation to minimize variability and ensure proper subgrades are established. In addition to the prescribed site preparations below, some localized over-excavation of problematic subgrades may be needed during site preparations and home foundation constructions.

With the exception of surficial topsoils and rare historical grade fills at shallow depths, no unsuitable or highly compressible soils were encountered through maximum depth explored. Additionally, the site subsurface is not susceptible to excessive settlement during a seismic event. There are no concerns for loss of building support associated with deeper conditions given the underlying dense to very dense glacial drift/till and bedrock profile throughout the site.

Based on the findings of field explorations and analysis of the site conditions, it is our opinion that shallow footing foundation systems are feasible for the proposed project. In Section 5.3, we provide preliminary foundation design and construction recommendations tailored to the subsurface conditions documented in the site-wide test pit survey.



5.1.2 Road & Utility Construction Feasibility

The primary challenge for road and driveway construction within the development is the prevalence of variable surface grades, even along the optimal alignments proposed with the plat layout. We expect cut-and-fill grading will commonly be necessary along the length of roadways. Most grade adjustments will be on the order of a few feet. Maximum fill thickness is anticipated to be in the range of 5 to 7 feet locally. Some road areas will also be dealing with off-camber, or cross-sloping, topography. It is recommended to build road sections in full cuts or fills, and to avoid partial cut-and-fill transitions where feasible. Where transitional areas are unavoidable, we recommend additional site preparations to properly bench subgrades for fill placement along with diligence in compaction of base materials below and along the side banks of the road to minimize the risk of future road settlement due to partial fills. Utilities constructed below partially filled roadway areas should preferably be placed at depth within underlying native soils to ensure that the integrity and performance of the line is not adversely affected.

Depending on depth of road cuts and utility installs planned, some areas may encounter bedrock before target depth of excavations. Sandstone bedrock was commonly encountered by about 4 to 5 feet depth at most test pit explorations along the entry corridor and "West Road" alignment in the north- and west-central regions of the site. Locally, bedrock was present within about 2 to 3 feet depth along the "East Road" alignment and cul-de-sac. At TP-4 in the east-central area, bedrock was found directly below topsoil. Refer to Figure 7 for illustration of depth to bedrock by test pit location. In our experience, rock excavation for utility installs and local subgrade leveling in Chuckanut Formation bedrock is relatively difficult where intact sandstone is present, and moderately difficult where rock is composed of fractured sandstone or siltstone. Conventional equipment can be used with rock breaking attachments, but the process can be time-consuming. It is recommended that subsurface data be carefully reviewed for design and construction planning so that major conflicts with rock depths can be avoided. Additional targeted explorations should be done if needed to better define depth to bedrock at certain areas for utility construction.

5.1.3 **Stormwater Infiltration Design Feasibility**

The project will be required to manage stormwater from new impervious surfaces in accordance with the Department of Ecology Stormwater Management Manual for Western Washington and its local municipal application. In this study, the general feasibility of on-site stormwater infiltration was evaluated in accordance with current City of Bellingham pre-permit review standards. Alternatives such as on-site dispersion and tightline outfalls were also considered.

Due to topographical and surrounding development constraints, we understand primary stormwater management for the project's interior infrastructure and building lots will generally need to be either handled within the property, or directed via tightline down the coastal slope to the southeast shoreline for release. Stormwater management of the site in majority will most likely entail collection/detention of runoff from pavements and structures, then tightline conveyance to suitable upland dispersion areas and/or by a primary outfall pipe down to the coastline. A combination of factors such as limited lot sizes, variably sloping topography, and proximity to other homes and roads will preclude use of dispersion on most individual lots. Northerly areas of the site may drain separately out to Viewcrest Road.



While there are some localized opportunities that could be pursued for small-scale infiltration on lots, as discussed below, the predominant majority of the site is not conducive to infiltration due to shallow restrictive soil/rock conditions, potential for perched seasonal groundwater, steep grades with potential for saturation-induced instability, or a combination of limiting factors. Local infiltration, where viable, is best suited for individual lot stormwater management at select areas to be addressed with future design and construction of home sites. Aside from the localized infiltration usage, most lots are recommended to have runoff captured and routed for dispersion or off-site disposal.

Potential Residential Lot Infiltration Areas

The northwestern and north-central portion of the property in the vicinity of Viewcrest Road was interpreted from exploration data to have the best potential for per-lot infiltration. This area generally consists of approximately 1.5 to 3.0 feet of cover soil and 1.5 to 3.0 feet of glacial outwash overlying glacial drift or till. The outwash material consists of sand and gravel with a generally low fines content and relatively high natural transmissivity. Analysis of infiltration capacity for the outwash-type soils found locally is presented in Section 5.7.

The project is within the City of Bellingham jurisdiction, which stipulates that at least 3.0 feet of permeable soils and at least 1.0 feet of separation must be available for residential downspout infiltration systems to be feasible. Typical options include linear trenches or drywells. The soil profiles observed in TP-13 through TP-17 (Lots 1 to 7 area) all appear to meet or exceed these criteria, where explored. The northwest and north-central areas also generally grade down to the north, separate from the majority site topography. Therefore, stormwater infiltrated locally on these lots will not place a hydrologic load on sensitive slope areas.

Pursuant to local stormwater regulations, which dictate residential lot infiltration systems be used where feasible, we recommend infiltration systems be considered on these northerly lots/areas in the future during final lot design. The actual application will depend on other factors, including grading, space, and conditions at areas open for stormwater use on each lot. We recommend a contingency plan of off-site tightline disposal in the event that infiltration is found to be non-viable upon further review on a per-lot basis. A public stormwater utility is mapped along the south side of Viewcrest Road directly in front of lots in the referenced area that may be an option for off-site stormwater disposal.

5.2 **Seismic Design and Liquefaction Potential**

This section addresses site-modified seismic design parameters based on regional-scale mapping of Site Class and the subsurface conditions encountered in our investigation. Additionally, we address site-specific liquefaction susceptibility.

5.2.1 Seismic Design Coefficients

For structural design purposes, our assessment of site geology may be considered Site Class C, representing a dense soil and bedrock profile. For design code standards per IBC 2018, we have determined utilizing web-based design tools that the following seismic parameters (Table 3) are appropriate for design of the proposed residences. Peak Ground Acceleration values were generated based on a combination of ASCE 7-16 and IBC 2018 guidelines.



Table 3: Seismic Design Parameters

Coefficient	Description	Value
S _S	Mapped Spectral Acceleration (0.2 second period)	1.018
S ₁	Mapped Spectral Acceleration (1.0 second period)	0.358
S _{MS}	Site-modified Spectral Acceleration (0.2 second period)	1.222
S _{M1}	Site-modified Spectral Acceleration (1.0 second period)	0.537
S _{DS}	Design Value (0.2 second SA)	0.815
S _{D1}	Design Value (1.0 second SA)	0.358
PGA	MCE _G Peak Ground Acceleration	0.435 [g]
F _{PGA}	Site Amplification Factor at PGA	1.2
PGA_{M}	Site Modified Peak Ground Acceleration	0.522 [g]

5.2.2 Liquefaction Susceptibility

Soil liquefaction is a result of loss in effective shear strength under the influence of elevated pore water pressure development during a seismic event. For soils with lower internal shear strength, earth shaking during an earthquake may cause pore water pressures to exceed the strength of the soil and "liquefy" portions of the profile. In general, saturated, loose to medium dense and cohesionless granular soils are most prone to liquefaction. Whereas high-fines cohesive and plastic soils and dense/hard soils or bedrock are not considered liquefiable. Liquefaction can induce total and differential ground settlement, surface disruptions, and lateral spreading where there is a lack of buttress or lateral support (such as near a slope or water body). Liquefaction and seismic shaking can also instigate soil slope failures where global stability of a slope is limited by shear strength. The effects of liquefaction are difficult to predict and can vary locally as evidenced by past events.

The Liquefaction Susceptibility Map of Whatcom County, Washington (Palmer et al., 2004) indicates the site vicinity has a negligible potential for liquefaction to occur due to the underlying bedrock geology. The mapping is based on generalizations of subsurface conditions associated with regional-scale geologic deposits, and should be considered on the site scale for potential variations based on exploration data. Our on-site findings have confirmed the map designation of no discernable liquefaction hazard at the site.

5.3 Foundation Design and Construction

For home foundation site preparations, we recommend first removing all topsoil and organic materials, uncontrolled fills or disturbed soils if present, and soft or loose cover soils down to native subgrade of medium dense/stiff or better consistency. Local over-excavation may be required to address problematic areas and variations in the shallow deposits. Recompact granular subgrades to mitigate excavation disturbance and promote a uniform density. Fine-grained subgrades should be protected from excessive disturbance and exposure limited during inclement weather conditions before foundations are installed.

Foundation excavation depths to reach competent subgrade are expected to be typical for shallow construction where building on gentle grades. Where building on grades of 3:1 (H:V) or higher, a minimum embedment of 2.0 feet is recommended for lateral stability and erosion protection. Foundation areas proposed on grades of 40% or greater are recommended to undergo site-specific review and be designed appropriately for slope-side construction. It is presumed that critical area slope evaluations will be required on a case-by-case basis for areas of steep grades.



We recommend all foundations on sloping topography be constructed directly on native cut subgrades by use of stepped footings or tiered footing levels. This will avoid the risk of differential settlement between foundations supported on native subgrade versus those on leveling fills.

5.3.1 **Bearing Capacity**

Assuming home site foundation areas are prepared as recommended above, a prescriptive or general *allowable vertical bearing capacity of 2,000 pounds per square foot (psf) is recommended*. This capacity takes into account the range of native soils present on site, and incorporates a factor of safety of at least 3. Values assume placement directly on medium dense/stiff or better undisturbed native subgrade. The allowable bearing capacity can be increased up to 1/3 to account for short-term transient loading such as associated with seismic or wind loads.

A greater allowable bearing capacity can be utilized where foundations will be placed directly on dense/hard glacial till or bedrock subgrades. In these cases, an *allowable vertical bearing capacity* of up to 3,000 pounds per square foot (psf) can be employed. Where increased bearing loads are planned to be used, we recommend that subgrade conditions be verified directly by site-specific evaluation as well as during construction by a geotechnical professional.

Foundations shall be sized sufficiently to meet the maximum allowable bearing load requirements, or to meet minimum size requirements per IBC requirements governing at the time of construction, whichever is larger.

Expected settlements will be largely elastic and well within structural tolerances for the proposed home structures, provided footing bearing surfaces are carefully prepared and not disturbed. Settlements should not exceed 1-inch total, nor ½-inch differential, over 50 lineal feet, within codedefined limits.

5.3.2 Lateral Resistance

Sliding resistance contribution to lateral load resistance applies to foundations placed in contact with the supporting subgrade. For application to either placement on native soils or structural fills, as conditions dictate, a coefficient of sliding friction of 0.30 is recommended for broad use. This value is function of the internal friction of the subgrade soil, and includes a factor-of-safety of at least 1.5. For well-compacted imported granular structural fills placed as foundation base fill, and for foundations placed directly on sandstone bedrock, the coefficient can be increased to 0.50.

Lateral earth pressures imparted and passive lateral resistance provided by foundation backfill are addressed in Section 5.4 Retaining Wall Foundations. The frictional forces can also be applied to restraining scenarios.

5.3.3 **Foundation Drainage**

The site commonly exhibits conditions with potential for shallow seasonal soil saturation and/or perched transient groundwater. Lots on lower portions of the site may be susceptible to subsurface drainage from the upland vicinity. We highly recommend use of perimeter foundation drains to promote long-term dry foundation conditions. In addition to perimeter foundation drainage, we recommend exterior ground surfaces and pavements be graded to slope away from structures. Building ancillary features should avoid those that could allow water to collect and pond against the outside of the structure. Exterior pavements and flatworks near the structure should incorporate local surface drains to control runoff.



For greatest effectiveness, footing drains should be placed even with the base of the footing along the exterior of structures. A continuous, 4-inch minimum diameter, perforated pipe that is sloped for gravity-assisted drainage and wrapped in filtration fabric or a filter sock is recommended. The area around the pipe and extending against the adjacent foundation wall should be backfilled with drain rock and separated from adjacent soils by use of soil separation fabric. Unless otherwise specified by design, the upper 1.0 foot of subsurface should be capped by low permeability fill material or pavement to minimize vertical water transmission from the building exterior to the foundation. Connect footing drains via tight-line to a catch basin or discharge facility separately from roof drains and other exterior surface drains to avoid backwards transmission or flooding of the foundation drain system by stormwater sources.

5.4 **Retaining Wall Foundations**

Retaining wall foundations may be used with some residences to permit construction directly against slope cuts or for daylight basements on sloping grades. In these cases, cast-in-place concrete walls of about 1-story maximum height are expected. This section provides preliminary guidelines and recommendations for structural retaining wall design and construction. Since walls will typically be employed in areas with steep slopes, we recommend lot-specific critical area reviews to confirm or modify the input as appropriate. At minimum, we recommend that Element Solutions be contacted to review proposed design plans and consult on specific applications in the absence of additional investigation.

5.4.1 Lateral Earth Pressures

Wall features in lateral contact with soils are subject to earth pressures and resistances from native soils (cut locations), or as a result of backfill materials placed against them (fill conditions). Recommended static lateral earth pressures (active and at-rest) are summarized in Table 4 (provided as equivalent fluid weight, units psf/foot or pcf). For the seismic design case (^), experience has shown that retaining wall structures perform very well based on designs employing the at-rest earth pressure loading pressures. The provided values assume fully drained conditions and increase linearly with depth. *Undrained design situations must also account for hydrostatic pressure with correspondingly increased values; contact Element Solutions for consultation on design using undrained conditions if required for the project.*

Table 4: Lateral Earth Pressures by Soil Type

Soil	Condition	Soil Unit	Active	At-Rest^	Passive Lateral
3011	Condition	Weight (PCF)	(EFW)	(EFW)	Resistance (EFW)
Native Soil (SM – ML)	Retained	115 - 125	40	60	375* (static)
(Silty Sand-Sandy Silt)	Retained	115 - 125	40	60	300* (seismic)
Structural Fill (GP)	Doolefill	125 – 135	20	Ε0	600* (static)
Structural FIII (GP)	Backfill	125 – 135	30	50	500* (seismic)

Values in Table 4 do not include additional pressures imparted from sloping backfills, vehicle loads, temporary stockpiles, or loads from nearby structures. Wall designs must account for adjacent surcharge loads in addition to the model lateral earth pressures. Structural Fill values will typically apply where walls are used to build up from existing grades. The exception is for walls constructed closely to and in part against native soil cuts. In that case, where backfill width is less than wall height, we recommend using the Table 4 earth pressure values corresponding to native soils.



The passive lateral resistance values for soils in Table 4 are <u>unfactored values*</u>. Appropriate factors of safety should be applied when using passive soil resistance to reduce the parameter to the acceptable design value. We recommend safety factors of 3 and 2 be applied under static and seismic conditions, respectively. For backfills providing passive restraint and extending at least 3.0 times the wall foundation depth horizontally from the foundation, values for compacted structural fill can be used. For lesser supporting widths of structural fill, and for foundations placed "neat" against undisturbed and competent native soils, the corresponding native soil parameters should be applied for passive resistance. All passive restraint values assume a horizontal surface for the supporting soil, and sloping surfaces must be evaluated on a case-specific basis.

5.4.2 Wall Construction Recommendations

A dedicated wall drain system is necessary to promote backfill drainage and minimize hydrostatic pressures behind walls. All walls are recommended to incorporate foundation drains as specified in 5.3.3 Foundation Drainage. In addition, backfill for the first 12 inches minimum behind walls is recommended to consist of fully free-draining material, such as Gravel Backfill for Drains (WSDOT SS 9-03.12(4)), or approved equivalent. We recommend placing filter fabric between the drainage corridor and backfills or retained soils to limit fine material from entering the free-draining zone.

Sealing of home foundation retaining walls with waterproofing treatment is advisable if low levels of potential leakage over time is unacceptable; without treatment, some through-wall transmission during heavy flows should be expected.

We recommend relatively free-draining gravel backfill be utilized within 5 feet of retaining walls. Free-draining materials have a typical maximum of around 3% fines content (depending on material type), and thus standard structural fill may not be suitable. Retaining wall backfill should comply with WSDOT SS 9-03.12(2) Gravel Backfill for Walls, or approved equivalent.

Backfill placed near walls (within about 5 feet) should be compacted with appropriate small equipment to avoid excess compaction leading to potentially elevated earth pressures. Place and compact fills in approximately 6-inch lifts while working progressively further from the back of the wall. Backfill should be delayed until the wall concrete has cured to acceptable strength.

5.5 Slab-On-Grade Floors

A slab-on-grade floor may be used for portions of the home structures. Loading is anticipated to be light residential use; no heavily trafficked or loaded areas are expected. Any slabs that will be subject to high loads or heavy vehicle traffic are recommended to be designed as rigid pavement sections with adequate slab thickness, reinforcement, and base materials for the expected use.

5.5.1 Slab Preparation and Construction

For slab-on-grade areas preparation, we recommend all organic soils and unsuitably loose or soft soils be removed. Granular subgrades should be recompacted after stripping to a uniformly medium dense or better condition. Fine-grained subgrades should be verified as suitably stiff and unyielding. We recommend a proof roll be conducted on slab subgrades, if weather conditions and access permits, prior to capping with structural fill. Any areas identified by proof roll to be loose, soft, or pumping are recommended for over-excavation and backfill with structural fill.



For the encountered site conditions, we recommend installing a base pad of at least 6 inches minimum thickness below floor slabs. This will promote under-slab drainage and provide stabilization over shallow moisture-sensitive subgrades. Slab base fill is considered structural fill, and should comply with the recommendations below for material type and installation. A properly compacted angular crushed-rock capillary break using structural-quality material (Section 4.4.2) can account for the recommended base section.

Assuming diligent subgrade preparations and recommended base pad installation, we recommend slab design use an allowable Subgrade Modulus (k) of up to 125 pci for design of light-load interior floor slabs.

5.5.2 **Slab Drainage and Moisture Control**

All interior slab-on-grade floors are recommended to be underlain by a capillary break section composed of appropriate free-draining material. For this purpose, we recommend a 6-inch minimum section of uniformly-graded, low-fines content, angular, clear crushed rock be placed and compacted to a dense and unyielding condition. Capillary break material is recommended to contain at maximum 3 percent fines (amount passing U.S. #200 Sieve) and be composed of 3/4-inch to 1.0-inch clear crushed rock material with nominal content passing the U.S. #4 Sieve. Where composed of approved structural-quality material (as recommended), it can account for the slab base pad.

A vapor barrier is also recommended below interior floor slabs. To inhibit moisture transmission through the slab where floor coverings can be impacted by moisture, we recommend placing a 10-mil or thicker polyethylene membrane below the slab. The barrier should be placed to overlap between sheets and properly sealed at the adjoining edges. The installer should take care not to damage or puncture the membrane during or after placement to maintain its integrity.

5.6 Pavement Recommendations

General recommendations for geotechnical site preparation and earthwork construction are provided in the sections below. In this section, we provide site- and project-specific recommendations and commentary for design and construction of proposed pavement areas.

5.6.1 Pavement Design Considerations

The site soil conditions are considered typical for asphaltic pavement section support. We recommend the standard City of Bellingham Pavement Section criteria for the road classification be applied for new public roadways. For private, light duty access roads and driveways, we recommend the following minimum asphaltic pavement section:

<u>Light Use Private Areas*</u>

Asphalt (HMA Class B) 3"
Gravel Base (CSTC/CSBC or Gravel Borrow) 6"

These sections are intended only as guidelines for design. Sections should be verified as suitable for the final development plans and adjusted if needed by the design engineer.



^{*} For private roads required to allow heavy service vehicles or emergency vehicles, a 12-inch minimum total pavement section is recommended.

5.6.2 Pavement Construction

Preparations for new pavement and exterior flatwork areas should generally follow the subgrade preparation recommendations in Section 5.8 and typical industry practices. Given the extent of the project area and the range of conditions observed, some variation in stripping depth should be anticipated to reach suitable subgrade conditions.

Subgrade for new pavement sections and flatworks should consist of generally stiff or medium dense native soils, or compacted approved fill installed over suitable native subgrade. Shallow subgrades will generally consist of silty sands and sandy silts of varying content. Granular subgrades should be lightly recompacted to establish a suitably uniform and medium dense state. Fine-grained subgrades should be prepared with a smooth finishing bucket to limit disturbance.

It is important to carefully assess pavement subgrades for suitability. Subgrade assessment should be done by a qualified geotechnical professional. We also highly advise conducting proof rolls of pavement subgrades, as proof rolling is well suited to identifying areas of problematic (weak) subgrade when under traffic loading. Any yielding or pumping areas identified should be overexcavated to remove under-performing subgrades and backfilled with gravel base material.

In cases where pavement subgrade is marginally suitable and additional excavation is not viable, or does not reach improved conditions within a reasonable depth, a geotechnical professional can assess the need for a minimum excavation depth for stabilization. Measures to stabilize poor subgrades will typically include specifying a certain structural fill replacement to "bridge" the weak conditions at depth, and/or placement of a ground fabric or geotextile for separation/structural purposes. The type and specification of subgrade reinforcement should be determined per the conditions at a given location. For situations requiring a lesser level of stabilization, a separation and filtration fabric may be sufficient (such as Mirafi 140N or 160N fabric). For heavier uses, an extruded polypropylene biaxial geogrid (i.e. Tensar BX series or similar) is recommended.

5.7 **Stormwater Infiltration**

Samples of outwash-type soils were collected from several explorations in the northwest and west-central areas of the site, and analyzed for grain size distribution with results as summarized above (Section 3.2.2); complete lab testing reports are attached in Appendix II. Saturated hydraulic conductivities (K_{sat}), representing infiltration rates, were then estimated using the Washington Department of Ecology Stormwater Management Manual (DOE SWMMWW, 2019) grain size analysis method. Rate calculations were performed using the grain size distribution data from lab testing (D10, D60, D90, and % Fines values). These variables were input into the following equation as adapted from Massmann, 2003 and Massmann et al., 2003:

$$log_{10}(K_{sat}) = -1.57 + 1.9D_{10} + 0.015D_{60} - 0.013D_{90} - 2.08f_{fines}$$

$$K_{sat}design = K_{sat}initial \times CF_{t} \times CF_{v} \times CF_{m}$$

Correction factors in the second equation were used to translate initial Ksat value to a corrected Ksat. We applied typical correction factors of 0.40 (CF_t) for grain-size test method and 0.9 (CF_m) for degree of influent control. A general value of 0.5 (CF_v) for site variability was applied to account for level of variation in fines content and consistency/density of the soils as observed, which may not



be fully reflected in the samples analyzed. The total correction factor applied was $CF_T = 0.18$. Laboratory inputs and corrected Ksat values per sample location are presented in Table 5:

Table 5: Infiltration rate calculation results (Massmann Grain Size Method)

Loc.	Depth (ft bgs)	Class.	D10	D60	D90	Fines %	Ksat (in/hr)	Corrected Ksat (in/hr)
TP13	4.0	GP	0.64	12.22	27.16	1.5%	395	71.1
TP16	3.0	GP- GM	0.26	11.78	38.90	5.3%	43	7.8
TP24	4.0	SP-SM	0.11	4.94	25.59	8.3%	23	4.1

The samples analyzed were selected to represent the range of variability in the local outwash deposits observed in portions of the site. Generally, these granular soils contained fines contents in the range of 5% to 20%, and typically around 10% or less. The level of fines most directly affects the calculated Ksat value. Samples from TP13 (4 feet bgs) and TP16 (3 feet bgs) were chosen to represent gravel-rich soils at the low and moderate end of the average fines content spectrum, respectively. These soils found locally are highly transmissive and favorable for infiltration. The sample from TP-24 (4 feet bgs) better represents the sand-rich version of shallow outwash-type soils on site.

As expected, the gravel-rich samples with low fines yield a relatively high Corrected Ksat value which is subject to significant variation depending on local gravel and fines content. Whereas, the sandier deposits are typically more predictable for rate determination. For preliminary design purposes, we recommend design values not exceed the lower range of results. A *Corrected Ksat of up to 4 inches/hour maximum is advised for use in preliminary design of select residential stormwater features with infiltration depths corresponding to outwash soils*.

We also reviewed the infiltration soil classification using the alternative USDA Classification System (MO5 Soil Technical Note 16; Benham et al., 2009) which is commonly used for prescriptive sizing of residential trench and drywell systems. The USDA method excludes the sample fraction retained on #10 sieve (gravel portion) and uses adjusted boundaries of sand sizes. The outwash soils sampled are classified as *Coarse Sand* per USDA textural criteria. Some notably sandier variations of the unit may be better classified as Sand. The designer may elect to use prescriptive design sizing for drywells based on DOE SMMWW (2019) standards. Actual soil conditions at the system location and depth should be reviewed to confirm final sizing criteria.

Samples of outwash soils from TP-13 and TP-24 were also tested for treatment-related properties. Samples recorded a Cation Exchange Capacity (CEC) of 3.9 and 6.2 meq/100g and an Organic Content of 1.5% and 1.4%, respectively. Organic Content values are found to exceed the 1.0% organic content requirements per the 2019 DOE SWMMWW. However, CEC values for native soils are near the 5.0 meq/100g minimum standards for CEC treatment requirements. Results are above or below the threshold corresponding to the local content of granular material, higher for sand and lower for gravel. If treatment is required, native soil amendment or import of an engineered treatment media may be necessary.



Design Commentary

The tabulated (Table 5) preliminary design rates appear suitable for small-scale infiltration of rooftop stormwater where outwash conditions are present. We assume single residence systems would consist of prescriptive downspout infiltration features, either drywells where depths allow or shallow trenches where transmissive soils are depth-limited. Alternatively, a civil designer can be employed for engineered design of a lot-specific system.

Shallow soils at the northwest area entailing Lots 1 to 7 also appear to be suitable for pervious pavement use. Topsoil/subsoil in that area was observed to range from 1.5 to 3.0 feet thick. Below the thick cover soils, the subgrade was sandy soil. The above corrected design rate is suitable for pervious pavement design in this area. There may be similar opportunity for small, localized, stormwater systems servicing driveways, as well as pervious pavements/flatworks, that can be evaluated during individual lot designs at other locations. The current exploration data can be used as a general guide to identify potential infiltration areas. To confirm or adjust values for final design use, we recommend additional targeted explorations at specific locations/areas proposed for stormwater infiltration or pervious pavement use.

On the majority of lots where on-site infiltration and direct release is infeasible due to steep slopes, shallow bedrock, or other restrictions, stormwater should be collected and tight-lined to an approved dispersion location or to a community shoreline outfall pipe.

We recommend conditions be confirmed and systems be best fit on individual lots proposed for infiltration at the time of future lot development. The results of this feasibility-level review are suitable for general planning purposes, but are not intended to provide final design recommendations for individual lots without further review.

5.8 **Earthwork and Excavations**

5.8.1 General Site and Subgrade Preparation

We recommend stripping and removing topsoil, unsuitably soft or loose subgrades, uncontrolled fills, and soils containing organic remains or other deleterious materials. Stripping should include all proposed structure and pavement/flatwork improvement areas, and areas receiving structural fills to raise grade below or proximal to structures and pavements.

Once subgrade level is reached and any remaining unsuitable materials are removed, granular subgrades should be recompacted to a suitably dense, uniform, unyielding condition. We recommend subgrades beneath structures and pavements be evaluated by a geotechnical professional by appropriate means including T-probing and visual assessment to confirm competent unyielding conditions are established. Where unsuitable soils are identified, additional stripping or over-excavation and replacement with structural fill should be conducted under guidance of the geotechnical consultant.

A proof roll should be conducted over prepared subgrade with a loaded single-axle dump truck or water truck, or other appropriately sized and loaded equipment, under observation of a geotechnical professional. When access is not feasible, or weather conditions do not permit a proof roll, alternative means can be used to verify subgrade adequacy at the discretion of the geotechnical



consultant. If areas of excessive deflection/rutting, looseness, or pumping are identified by proof roll, mark locations for rectification. Loose or rutting areas can be recompacted, subject to suitable moisture conditions, then re-assessed for suitability. Any pumping locations or persisting loose/soft areas likely reflect excessive moisture conditions and should be over-excavated until reaching suitable support conditions (or alternatively stabilized as directed by the geotechnical professional), then backfilled with new imported structural fill to restore planned subgrade level.

For over-excavations below structural loads, the width of excavation at base level is recommended to extend a 1H:1V distance outside of the loaded location corresponding to the depth of over-excavation. For instance, an over-excavation of 1 foot should also extend 1 foot in each direction from the edge of a structural load.

5.8.2 **Difficulty of Excavations**

The native soil conditions encountered at shallow levels (within a few feet of the surface) are anticipated to be viable for excavation and site preparations using traditional mechanical equipment (such as excavators/backhoes, bulldozers). Tooth-edge buckets may be preferable for excavation of dense or cemented materials as encountered. Flat-edged buckets should be used when preparing fine-grained subgrades to lessen disturbance of the subgrade, and when trimming excavation bases to final foundation design grade.

The depth to bedrock is found to vary within the project area, and in some cases is notably shallow. It is likely that conflicts with bedrock will arise when constructing infrastructure. Chuckanut Formation bedrock can typically be excavated with difficulty for road grading and utility trenching using standard equipment and mechanical rock-breaking equipment. Blasting is not recommended due to the potential for blasting to impact stability of adjacent sloping areas.

5.8.3 Wet Season Construction

Shallow native soils at the project site consist of silty sand to sandy silt with elevated fines content. These types of soil are highly moisture sensitive, and prone to significant issues such as weakening and degradation as a result of exposure to wet weather in the presence of construction traffic and activities. Furthermore, earthwork activities on moisture sensitive conditions can be difficult with additional costs and time commonly incurred for wet weather construction. Moisture-sensitive soils can be difficult to work and manage even in the dry season during periods of inclement weather. Finally, we recommend against placing frozen soil as fill, and against placing fill over frozen subgrade. Therefore, it is preferable to perform major earthwork construction for this project in the drier/warmer part of the year (late spring to early fall), and to avoid major grading activities during wet weather as possible.

For project earthwork activities that take place in the winter season or in inclement weather, we recommend the following guidelines:

- Limit machine and truck traffic on exposed subgrades to only as necessary. If traffic through an area is unavoidable, consider capping with temporary stabilizing material and/or leaving stripped levels high to be trimmed to grade later.
- Be prepared to substitute native material use (if planned) with imported structural fill. Be
 prepared to change imported materials to a low-fines content free-draining aggregate or
 clear rock substitute if moisture cannot be adequately controlled.



- Grade subgrades for runoff, and provide outlets or dewatering for confined excavations that are susceptible to water inundation from runoff or seepage.
- Implement controls to the extent possible to limit surface runoff from adjacent areas from entering the excavation or work area.
- Avoid directing temporary runoff or water diversions from excavations onto nearby steeply sloping grades.
- Plan and conduct work in stages to minimize open time for sensitive subgrades. Preferably,
 strip and cover moisture-prone subgrades quickly if working in rainy weather.

5.8.4 Excavation Dewatering

Shallow conditions were generally free of wetness in the summer season, as seen in the test pit exploration logs. However, perched groundwater was observed locally, and shallow restrictive conditions are commonly present. This indicates a potential for seasonally induced seepage and water transmission through the shallow subsurface. While development of a full perched water table is unlikely given the sloping grades of the site, migration of shallow transient water from uphill sources into excavations may be expected to occur in the winter and spring seasons. Perched water may collect locally in topographically convergent areas.

Dewatering actions may be needed to maintain workable shallow excavations if site preparation or utility work is done in the wet season or under sustained wet weather. We anticipate conventional methods should be sufficient for controlling transient water inundation, including pumping for evacuation and providing temporary runoff outlets from work areas. Some additional expense and difficulty should be anticipated for wet season site preparation and utility construction.

The scope of work completed to date has not included direct monitoring of groundwater fluctuations through the wet season, or characterization of flow rates/volumes for subsurface water transmission. A hydrogeologic study has not been conducted at this site. The information and commentary provided is intended only for planning purposes, and does not necessarily provide recommendations for dewatering design.

5.8.5 **Excavation Shoring**

In Washington State, shoring or sloping is required for excavations that are deeper than 4.0 feet (WAC 296-155, Part N). Excavations for this project are anticipated to be primarily shallow, although some work may call for depths in excess of 4 feet. If shoring is elected due to space constraints, or as the preferred method of construction, the system must be evaluated and designed by a registered professional engineer licensed with the State of Washington. The shoring designer should review the findings of this report, and account for potential loads including soil pressures (active or at-rest, as applicable), hydrostatic influences, and loads from sources such as adjacent stockpiles, heavy equipment, and traffic.

In addition to providing safe excavation access and egress in accordance with OSHA requirements, shoring should be designed to adequately protect adjacent features (such as existing utilities, structures, pavements) from detrimental effects including during installation and removal of the shoring. In the event that shoring is required in proximity to an existing feature/facility, we recommend the standards for protection be clearly established in project requirements. In some



cases, an acceptable level of damage to adjacent conditions is suitable in order to expedite work. The standards for repair to existing features as a result of excavation shoring use should also be agreed upon prior to construction.

5.8.6 **Temporary Cut-slopes**

We recommend all temporary construction slopes adhere to local, state, and federal requirements. Establishment and maintenance of suitable cut-slopes to provide worker and site safety is the responsibility of the contractor. The following guidelines for cut-slope preparation are provided for general planning purposes only, and should be revised as necessary once conditions are open and observed during construction.

Temporary cut-slopes within the shallow native soils should be sloped no greater than 1:1 (H:V), corresponding generally to "Type B" soils. If soils are locally soft or loose with apparent instability, or if work proceeds in wet conditions, a down-grading of the soil type and corresponding reduction to 1.5:1 (H:V) or less is recommended. Excavations can be evaluated in construction by a qualified geotechnical professional to determine if steeper grades are permissible for short-term and/or relatively small slopes based on actual observed condition and soil strength.

Loads from external factors, including but not limited to heavy equipment, traffic, stored materials, and soil stockpiles should be avoided directly above unreinforced cut-slopes. If loading is unavoidable, a lesser slope angle or temporary shoring of the location may be necessary. We recommend cut-slopes that will remain open for an extended duration be protected from exposure to inclement weather conditions. Covering slopes with plastic can help prevent erosion and degradation of the slope face over time. If utilized, cover sheeting should be anchored sufficiently to resist wind displacement and overlapped to minimize leakage.

5.9 Structural Fill Recommendations

5.9.1 Use of Structural Fill

Structural fill constitutes all fill soils placed underneath structures or pavements for support. Additionally, soil backfills against foundations and walls, and soils used similarly for the purpose of providing lateral stability to structures, are considered structural fill.

In general, structural fill shall consist of primarily granular and non-plastic aggregate of suitable gradational characteristics, that is relatively uniform in mineral composition, contains no discernible organic materials, and is free of other trash and deleterious materials. It is typically recommended that all aggregate be less than about 4 inches in diameter, maximum particle size. For thin lifts or specific applications, a lesser maximum size may be required (maximum particle size of 2/3 lift thickness, or as specified for use).

We recommend structural fill be placed over suitably prepared and engineer-verified subgrade as recommended above. We advise against placing structural fills intended for building and pavement support over existing unverified uncontrolled fills, or unsuitable soft or loose subgrades, due to the elevated risk of settlement of underlying strata. In exceptions, fills may be placed as an approved subgrade stabilization measure under the evaluation and guidance of a geotechnical professional for an express location and purpose.



5.9.2 **Installation and Compaction**

Structural fills should be properly moisture controlled or conditioned to within 3 percent of optimum moisture level for the specific material to encourage proper compaction. In the dry season, granular fills residing in stockpiles may be excessively dry and need to be wetted prior to or during use. In this event, it is advisable to proceed cautiously with water application until a moisture-conditioning program can be established. In the wet season, care should be taken to protect structural fill stockpiles from rainfall. Fills with excessive moisture levels must be removed and mixed, stored, or dried/aerated until within an acceptable range for use.

Installation of structural fill shall be done in horizontal lifts not exceeding about 8 to 10 inches maximum loose-thickness. Thin lifts will be needed for small machinery or hand-operated equipment in order to achieve compaction. Per WSDOT Standard Specifications 2-03.3(14) and our professional judgment, fills should be benched when placed on grades steeper than 3H:1V.

Structural fills shall be compacted with appropriately sized equipment to a uniformly dense and unyielding condition. For all fills placed beneath or as backfill for structures, we recommend a minimum 95% compaction be attained. A minimum compaction standard of 95% is also recommended for the upper 2.0 feet of pavement subgrades, as well as the upper 4.0 feet of utility trench backfill beneath paved areas. Beyond 2.0 feet below the base of pavement away from structures (4.0 feet at utility trenches), and for non-structural utility backfills (outside of paved areas only), a minimum 90% compaction is considered suitable. Compaction shall be based on the maximum dry density of the material, determined by laboratory testing per ASTM D-1557 test method. Field compaction testing shall be conducted as necessary to verify compaction of each lift. Compaction testing should be performed frequently as work begins to establish suitable placement/densification methods, then as needed to assure project standards are met.

5.9.3 Existing Material Suitability

On-site soils encountered in explorations consist predominantly of silty sand and locally sandy silt at shallow levels. Assuming construction in dry conditions, excavated non-organic native soils produced in cut areas are generally considered suitable for use as non-structural grading fills in landscaping areas, and as native material for trench backfill outside of the road prism (per *WSDOT SS 9-03.15*). That is, provided the material is of sufficient quality and condition to be compactable and meet other project requirements for the intended use.

Granular native soils may be suitable for use as subgrade-level fill below lightly loaded floor slabs and pavements. Site soils are moderately to highly moisture sensitive due to high fines content, and as such will only be suitable for reuse in dry weather. Native materials may need to be moisture-conditioned prior to placement. Native soils proposed for reuse on site should be stockpiled separately from unsuitable materials, and evaluated for suitability before installation by laboratory testing and/or visual means of approval. Additional testing and quality control efforts should be expected for use of native soils in comparison to imported fills.

5.9.4 Imported Material Specifications

Imported aggregate meeting plan requirements for the intended use, and the general recommendations of this report, is considered suitable for use as structural fill. For general-use structural fill, we recommend well-graded imported material meeting the specification for Gravel



Borrow (WSDOT SS 9-03.14(1)). A performance equivalent may be approved for substitution by the project engineer and geotechnical consultant.

Gravel backfills placed behind retaining walls and retaining foundations must be free-draining, and shall comply with WSDOT SS 9-03.12(2) unless otherwise specified or approved by the wall design engineer. Free-draining materials have a typical maximum of around 3% fines content (depending on material type), and thus standard structural fill may not be viable for this purpose.

If work occurs during excessively wet weather, or if water is unavoidable within excavations, it may be preferable to substitute standard structural fill with a material not affected by water presence. For this purpose, a clear angular rock such as 1-1/4" clear ballast may be considered, subject to approval by the geotechnical consultant for the proposed use. If utilized, clear rock shall be installed as recommended above and compacted to an unshifting, unyielding, and uniformly dense condition as verified by visual methods and/or proof-roll.

Controlled-density fill (CDF) may be suitable for use in substitution for structural fill in some cases. If proposed, CDF use should be reviewed by the project engineer and geotechnical consultant before its placement.

Laboratory testing should be conducted in advance of construction to evaluate and verify the proposed imported materials are suitable for use. In the event that a material does not meet the project specification, the applicable engineer and geotechnical consultant may review the results for conditional acceptance. However, the contractor should also be prepared to find an acceptable alternative material if the initial source is unsuitable.

5.10 Utility Construction

5.10.1 Utility Trenching and Excavation

Trenching and excavations for utility improvements will typically encounter topsoil and shallow glacial deposits or colluvium (locally variable sand, silty sand, and sandy silt) through a few feet depth. Upper deposits are underlain at varying depth by cemented/densic glacial soils and bedrock of the Chuckanut Formation (Sandstone, Siltstone). We have made the following inferences based on conditions encountered:

- The native upper soils are considered moderately susceptible to raveling and sloughing on average. Actual degree will vary locally by soil type. Steep trench walls may be difficult to maintain for even shallow excavations. At minimum, a contingency plan for slope layback or temporary reinforcement should be in place, especially for trenching in limited space.
- If trench work is conducted during wet weather, seepage from perched water and soil saturation may increase the likelihood of trench wall raveling/sloughing.
- Due to the potential for shallow saturation and seepage as well as inundation from upgradient transient waters into confined excavations, trenching and utility work is generally not recommended to be done in the winter season.



 Bedrock presence at shallow depth can significantly hinder the timing and progress of trenching preparations. Additional potholing is recommended to be done during construction for pre-planning purposes as the project advances.

The longitudinal extent of trenching should be kept to short intervals or segments, with pipe installation and back filling completed prior to opening new trench sections. This will limit the length of exposure time to trench wall drying or rain-wetting with the consequent sloughing that may be expected with exposure time.

It is the responsibility of the contractor to establish a safe and secure work environment for entry and work performed in utility trenches. The recommendations in the Earthwork and Excavations section of this report should be followed, as well as any state and federal safety regulations. The contractor is also responsible for monitoring the condition and safety of excavations including utility trenches over the open time. In the event of instability or signs thereof, the contractor should be prepared to modify the excavation to a more stable configuration (by using or reducing cut-slopes) or utilize temporary shoring. It shall be understood that conditions can change and local variations can occur. The above guidance is intended for general planning of trench work, and does not represent a guarantee of conditions or the success of specific approaches. Any significant variation from the above encountered during construction should be reassessed by a qualified geotechnical professional.

5.10.2 Backfill and Pipe Zone Bedding

Typical trench and pipe backfilling practices are considered appropriate for this project. As is noted above, some materials excavated during trenching for this project may be suitable as replacement trench backfill in select areas. The material should be evaluated for its suitability upon excavation but before it is planned for reuse. The following recommendations are provided for trench back fill and pipe zone bedding considerations.

- Imported gravel for pipe zone bedding should consist of aggregate material satisfying the specification requirements of WSDOT 2018 Standard Specifications 9-03.12(3).
- Unless otherwise specified by project or local municipal utility requirements, imported gravel for trench backfill below roadways and beneath paved areas should at minimum meet the specification requirements of WSDOT 2018 Standard Specifications 9-03.19. If allowed, trench backfill outside of paved and trafficked areas may consist of suitable native or other non-structural material (per WSDOT SS 9-03.15).
- Based on the interpreted suitability of native subgrades at likely utility trench depths, it will
 not be necessary to use an additional foundation layer when constructing utilities at the
 project site.
- To limit potential future settlement of pavement sections above newly installed utilities, compact the pipe bedding zone material to not less than 95% of its maximum dry density.
 If a "self-compacting" material is used (such as pea gravel), the material should be well distributed and tamped as needed to achieve an unyielding condition before backfilling.
- For trench backfill below pavements, it is preferable that the level of compaction achieved is at least 97% (no less than 95% standard minimum). However, the pipe manufacturer's



specifications for compaction of materials adjacent and above the pipe should be observed to prevent possible damage to the pipe and any connections.

We recommend against using alternative soil densification measures such as jetting or flooding as a substitute for proper mechanical backfill compaction. Utility backfills and compaction procedures should adhere to the recommendations provided in this report for Structural Fill.

Where lateral thrust blocks are to be constructed to provide lateral pipe restraint, the concrete should be cast neat to undisturbed trench wall soils to ensure that adequate lateral load support is provided by the in-situ soils. Backfill placement for support of thrust blocks is not recommended.

5.11 Contractor Responsibilities

Some variability in substrate composition should be anticipated across the study area. It is not plausible or reasonable to expect that a pre-construction investigation will identify all variations at a site, nor does the exploration program executed for the purpose of this study constitute a complete and exhaustive survey of site subsurface conditions. A reasonable level of extrapolation has been applied to the interpretations and conclusions of this report. The contractor is responsible for reviewing this information in full, and asking for clarifications, if necessary, prior to conducting work. The contractor should also conduct independent confirmation of conditions as needed to successfully plan and implement their proposed systems of construction, including but not limited to shoring and dewatering design, if required. If the opportunity to conduct additional evaluation is presented and waived by the contractor, neither the client nor Element Solutions shall be held liable for data limitations in design of construction systems and methods.

In all instances where unusual or unanticipated subsurface conditions are encountered during any stage of the site preparation or construction process, it is the responsibility of the construction contractor to notify the client and/or the engineering design team. The project team should then be prepared to provide on-site geotechnical supervision prior to further excavation, grading, or construction. Due to the compositional variability observed in shallow soils across the site and the potential for excavation and trench caving, a geotechnical engineering professional should be consulted as needed during all temporary excavations to confirm soils and excavation/trenching conditions.

All on-site soil excavation and stockpiling should be performed in accordance with industry-standard best practices and protected from erosion in a manner consistent with the approved Temporary Erosion and Sediment Control (TESC) Plan. The contractor is responsible for implementing and maintaining erosion control procedures and devices in accordance with local and state requirements.

5.12 General Critical Area Guidelines & Recommendations

The following guidelines and recommendations are intended to minimize the impacts and inherent risks associated with development within or in proximity to geologically sensitive critical areas. The information is site- and project-specific based on our understanding of the proposed development and existing conditions at this time.



5.12.1 Stormwater Management

Development drainage features and stormwater controls should be implemented in a manner that does not lead to an increased potential for erosion or instability on the site slopes, nor places downgradient properties at risk. Generally speaking, we recommend that all stormwater from new impervious surfaces be captured and managed. On-site stormwater release systems (infiltration or dispersion) for lots or roadways are not considered viable among areas on or proximally above steeply sloping topography. With exception of localized lot-scale infiltration at areas of the property fronting Viewcrest Road, and possibly pervious pavement driveways at some other lots to be determined, the site is generally considered infeasible for infiltration. The combination of small lot sizes and sloping topography also appears to limit use of individual lot dispersion systems within most of the building lots.

Project discussions indicate the primary stormwater management for the site roadways will employ subsurface storage volume (i.e. vaults, large pipes, stormtech units, etc.) for flow control. One option under consideration for disposal is to collect and route stormwater to the eastern part of the site, then convey it downhill to the southeast via a big outfall pipe for release at the coastline (above marine water level). In our opinion, this is a viable course of action from a geotechnical and geohazard protection perspective, assuming the downslope tightline is properly sited and constructed to minimize risk of failure.

A second option, which may help to avoid construction of a large outfall pipe down the steep coastal slope, is to employ upland dispersion at select areas. Dispersion is considered among forested open-space areas of relatively lower gradient topography downhill of the main development area. In our opinion, selective dispersion is also a viable strategy provided the systems are preferentially sited and adequately designed/built so that stormwater is discharged over a sufficiently large area.

Based on the findings of this study, we conclude and recommend the following criteria for proper management of new stormwater generated by lot and roadway development:

- Infiltrate stormwater only where conditions are proven to meet municipal feasibility criteria, and steep slopes are not present or in proximity. Additional lot-scale review to confirm infiltration suitability with respect to final development plans is advised.
- Dispersion or down-gradient release of collected stormwater within individual lots is generally <u>not advised</u>. Underlying properties and slope areas could be negatively affected by release of stormwater.
 - Possible exceptions include lots along the southeast perimeter of the development that contain areas of gentle downslope topography (see below).
 - Depending on final development layout, there may be other exceptions of lots viable for localized dispersion. We recommend reviewing individual lot dispersion on a per-case basis, in the context of final layout and surrounding conditions, if considered for use.
- Dispersion of collected lot and/or roadway stormwater can be considered among downhill forested areas of the site. For on-site dispersion, we recommend:
 - O Divide dispersion to utilize several areas so that stormwater release is not excessive at any one area, and for ease of design/construction among variable grades.



- o Employ systems which control and disperse outflow over a wide area (such as a trench with level-spreader). Do not use point-source outflows in upland areas.
- O Disperse among areas with lesser grades and adequate vegetation.
 - We recommend limiting dispersion to areas around 30% grade or less.
 - Avoid or minimize clearing of forest vegetation, including trees and undergrowth, around and downhill from dispersion locations.
- A minimum setback of 100 feet is recommended for engineered dispersion above the southeast coastal bluff slope.
- Based on these guidelines, areas with potential suitability for communal dispersion may include:
 - Lower gradient slope areas along the bottom of Lots 28, 29, and 30 to 32, as well as the bordering upland part of "Open Space Tract A" outside of the recommended setback.
 - Gentle mid-slope area of Lot 33, lower half of Lot 34, and adjacent ROW (to be vacated).
 - Area along east borders of Lot 35 and 36 (drains towards wetland zone).
- Element Solutions should be retained to consult on the placement and design of on-site dispersion systems, if incorporated. ES can assist in identifying optimal locations, and perform field reconnaissance for verification of suitability at proposed dispersion areas.
- All stormwater from roof runoff, pavements, and exterior drains should be tightlined from the collection points to a lot catch basin, then directed to a conveyance tightline leading to the approved dispersion facility or outlet point.
- Foundation and wall drains should be conveyed separately from other drain sources, or adjoined at a suitable down-gradient location, to prevent the backflow of water to footing drains. Given the low volume of these features, it is commonly permissible to outlet footing or wall drains at a suitably gentle and vegetated area away from the structure.
- Stormwater from upland and neighboring sources should also be properly controlled by the
 adjacent (off-site) properties. If necessary, construction of the project should also
 implement safeguards at its boundaries to lessen the potential for overland flow from
 entering the property. This may include incorporation of small swales, yard drains or
 perimeter drain systems to maintain a dry site.
- All above-grade tightlines should be composed of sturdy rigid material resistant to damage (such as PVC or welded HDPE pipe), sized adequately for the anticipated outfall volume, and anchored sufficiently to the ground to minimize the potential for damage and failure. Tightlines should be inspected periodically, and repaired or replaced as needed to maintain a safe working condition. For directed outfalls, appropriate energy reducing features should be used at the release point as necessary to minimize erosion. Examples include a perforated T-stub/spreader pipe, rock pad, or release onto exposed bedrock.



5.12.2 **Site Management During Construction**

Additional care is necessary when construction occurs on or near steep grades. For the purposes of critical area protection and erosion management, grades of 30% or over are subject to regulation under City of Bellingham Code. The following guidelines and recommendations pertain to regulated slope areas.

- Outside of structural areas, new fills on slopes should be minimized (other than as needed to backfill ancillary areas around footings, and below hardscapes). Fills placed on a slope face outside the confines of a structure add weight to the slope, and may increase the risk of instability or erosion.
- Temporary stockpiling of excavated material or fills, or storage of heavy construction materials and machinery, shall be avoided on sloping areas. Stockpile soils for import/export at the lowest gradient area available pending transport or use.
- Construction practices shall take care to disturb or impact as little area as possible. Impacted areas should be restored with top-dressing and appropriate plantings for the environment following construction. Avoid disturbance outside of the established development boundaries on each lot.
- Temporary erosion controls:
 - Systems and procedures should be put into place as appropriate for the site, project, and timeframe/season of construction. TESC measures should include downslope and sideslope clearing/disturbance limit barriers or demarcations.
 - > During periods of major excavation and during benching or excavation of rock on or near sloping grades, additional downslope safeguards should be installed as needed to prevent soil and rock fall from leaving the site.
 - The contractor is responsible for implementing and maintaining TESC throughout earthwork activities, and for working within accepted project limits to avoid unnecessary impacts to adjacent areas (especially critical areas).

5.12.3 Long-term Erosion Control and Maintenance

For long-term site care and management of critical area slopes:

- We recommend goals of low impact or vegetative enhancement be adopted for exterior areas outside building and road development zones, including preservation of existing trees and brush where possible. This will help minimize the chances of future instability on sloping areas following development. We advise planting of appropriate brushy vegetation among ancillary areas near structures and roads that are unavoidably disturbed during construction, either at the end of construction or in the future under final ownership.
- Removal of mature trees on steep grades should be limited to only those directly necessary
 to construct the project. If select trees are a concern for current or future hazard to
 structures or roads, a qualified arborist should be consulted to evaluate tree-limbing,
 topping or removal. Full removal actions should also be reviewed by a licensed geologist
 where in conflict with critical area slopes, and may require mitigative measures.



- Promoting future growth of strong-rooting brushy plants and new trees is encouraged both
 following construction and in the long term. Thick and healthy vegetation will assist in
 retaining cover soils, increase the hydrologic resistance of surface conditions, and lessen
 the risk of erosion that could result from incidental surface runoff or other overland
 drainage issues that could arise.
- Major landscaping alterations should be avoided on slopes outside of planned development areas unless properly reviewed by a geotechnical professional and found to be suitable for the location and surrounding conditions. We generally advise against placement of significant fills or terracing alterations on slopes, which could affect the downslope conditions or result in instability.
- If conditions are observed to evolve or deteriorate in the future and pose a potential
 concern for stability of the site or adjacent areas, we recommend conditions be reobserved at that time. Element Solutions should be contacted to reassess the site
 conditions, and can provide guidance for stabilization and best management practices at
 request of the property owner.




6 Closure

Thank you for the opportunity to contribute our expertise to your project. Please do not hesitate to contact us at (360) 671-9172 if you have any questions or comments regarding this report.

Sincerely,





John Gillaspy, LEG
Environmental Services Manager



Lorne Balanko, PE Senior Geotechnical Engineer

Statement of Limitations

This document has been prepared by Element Solutions for exclusive use and benefit of the Client. No other party is entitled to rely on any of the conclusions, data, opinions, or any other information contained herein. This document represents Element Solution's best professional judgment based on the information available at the time of its completion and as appropriate for the project scope of work. Services performed in developing the content of this document have been conducted in a manner consistent with that level and skill ordinarily exercised by members of the geologic engineering profession currently practicing under similar conditions. No warranty, expressed or implied, is made.

Exploration logs presented in this report represent locations and dates of field work. Conditions encountered by location may not be fully representative for other areas of the project site, and may vary depending on the timeframe of exploration. A degree of natural variation should be anticipated within native subsurface conditions; greater variation is likely where previously altered conditions or uncontrolled fills are found. If conditions are present in construction that are different than those encountered in this study, Element Solutions should be contacted to provide review and consultation, and to reevaluate our recommendations if necessary. We also recommend review of final plans and specifications by Element Solutions, as well as changes to the project scope that could impact the intent of our recommendations.

If the client elects to retain another geotechnical consultant for additional work or construction phase geotechnical support, the retained firm or individual is expected to review this report in full. They shall either verify and agree with the interpretations and recommendations provided, or offer their own recommendations. Element Solutions shall not be responsible for revised interpretations or recommendations made by others.




References


- 1) Lapen, T.J. Geologic Map of the Bellingham 1:100,000 Quadrangle, Washington. Washington State Department of Natural Resources, Division of Geology and Earth Resources Open File Report 2000-5, December 2000.
- 2) Natural Resources Conservation Service, Web Soil Survey, U.S. Department of Agriculture, http://websoilsurvey.nrcs.usda.gov/app/WebSoilSurvey.aspx, accessed online July, 2020.
- 3) Palmer, S.P., Magsino, S.L., Bilderback, E.L., Poelstra, J.L., Folger, D.S., and Niggemann, R.A. Liquefaction Susceptibility Map of Whatcom County, Washington. Washington State Department of Natural Resources, Division of Geology and Earth Resources Open File Report 2004-20, September 2000.
- 4) Wyllie, D. C., and Mah, C.W. Rock Slope Engineering Civil & Mining. 4th Edition, 2005. Taylor & Francis e-Library publication.




Appendix I

- 1) Figure 1 1:24,000-Scale Site Vicinity Map, Jones-Edgemoor Property, Bellingham, WA
- 2) Figure 2 Project Area & Lot Layout Overview Map, Jones-Edgemoor Property, Bellingham, WA
- 3) Figure 3a Topographic LiDAR Map with Percent Slope ShadingFigure 3b Project Lot Layout Map with Percent Slope Shading
- 4) Figure 4 Project Overview LiDAR Map with Major LHA Features Annotated
- 5) Figure 5 Detail LiDAR Map of Northeast Landslide Hazard Area and Buffer.

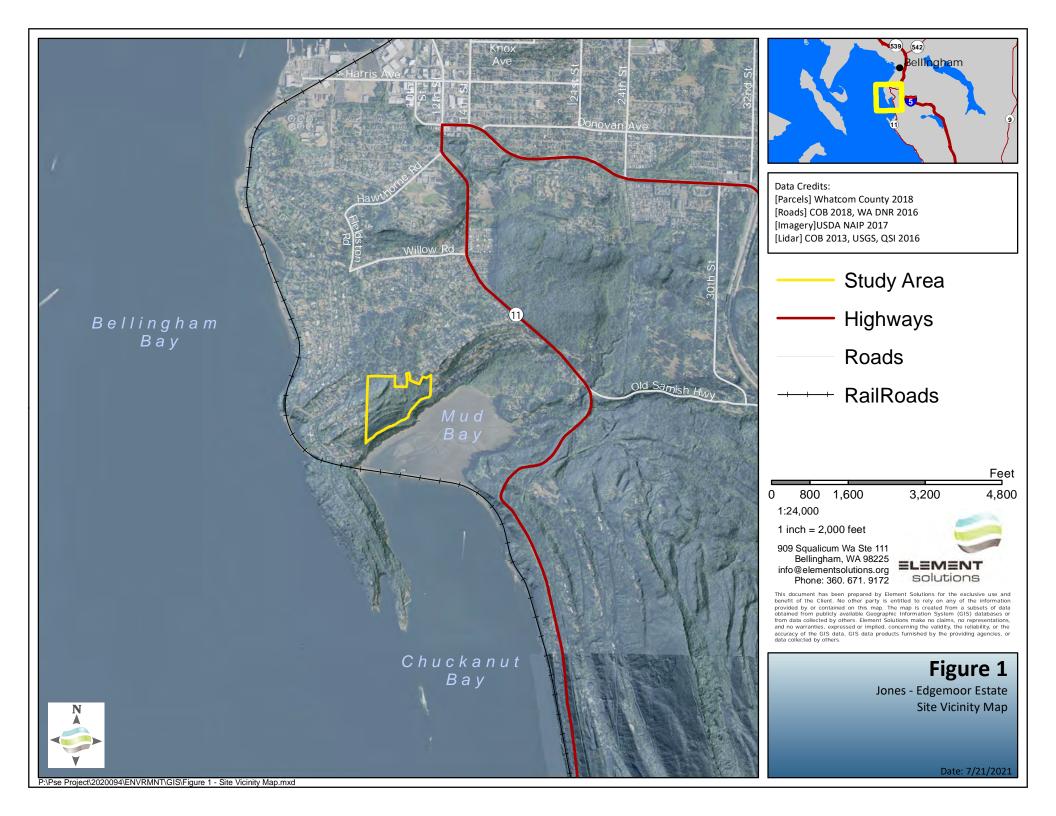

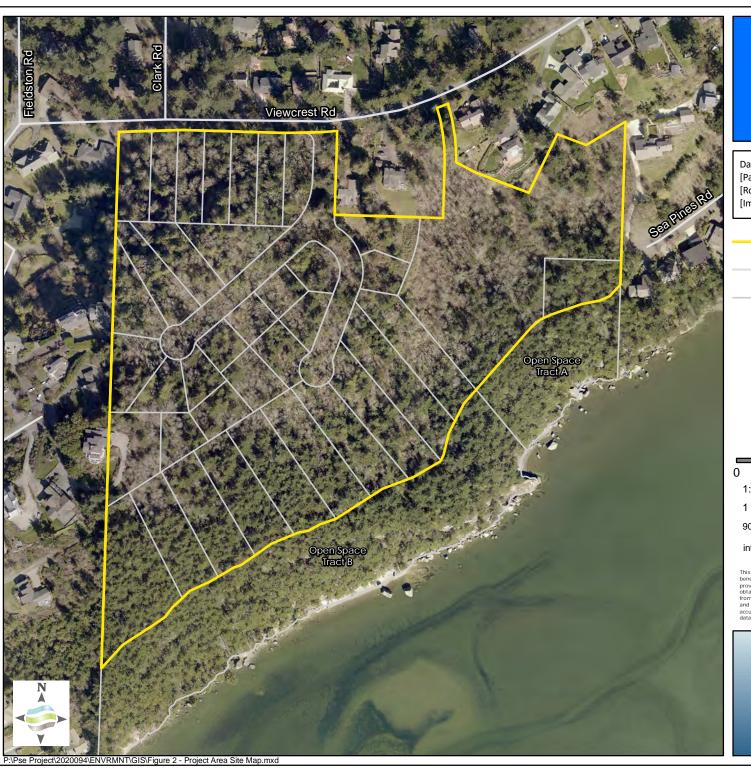



Data Credits: [Parcels] Whatcom County 2018 [Roads] COB 2018 [Imagery] COB 2019

Study Area

Roads

Lot Layout

Feet 0 250 500

1:3,000

1 inch = 250 feet

909 Squalicum Wa Ste 111 Bellingham, WA 98225 info@elementsolutions.org

fo@elementsolutions.org Phone: 360. 671. 9172





This document has been prepared by Element Solutions for the exclusive use and benefit of the Client. No other party is entitled to rely on any of the information provided by or contained on this map. The map is created from a subsets of data obtained from publicly available Geographic Information System (GIS) databases or from data collected by others. Element Solutions make no claims, no representations, and no warranties, expressed or implied, concerning the validity, the reliability, or the accuracy of the GIS data, GIS data products furnished by the providing agencies, or data collected by others.


Figure 2

Jones - Edgemoor Estate Project Area and Lot Layout

Date: 2/25/2022

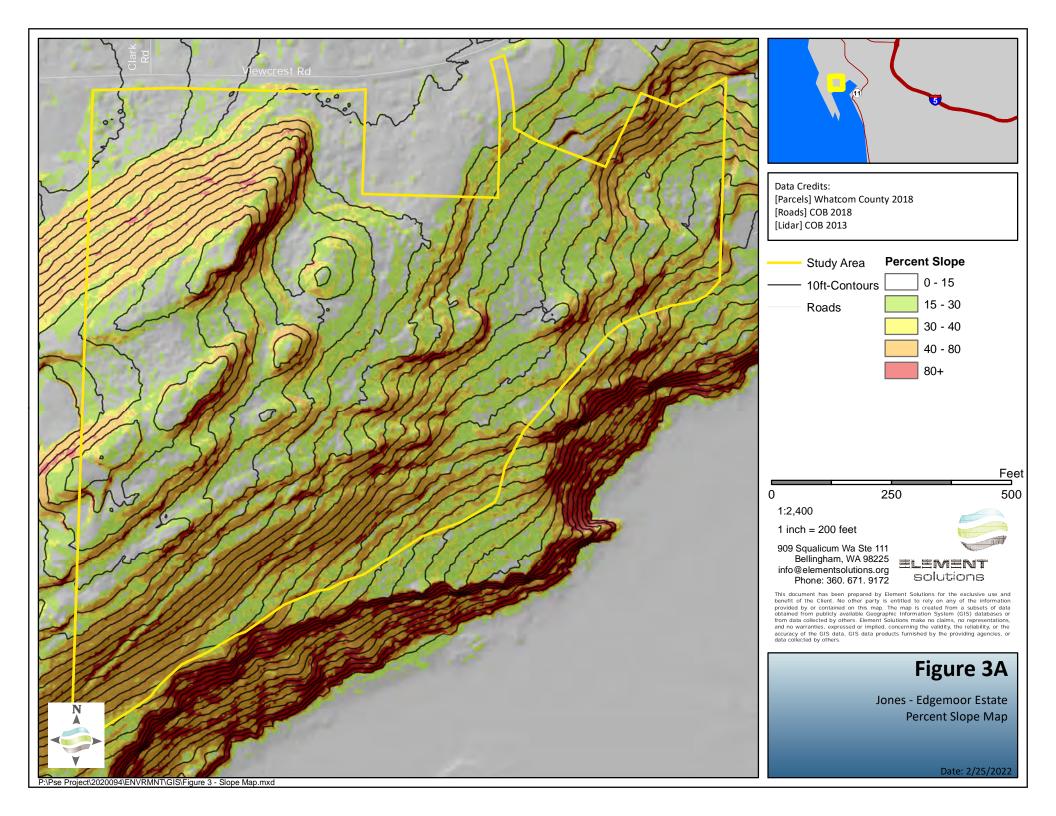


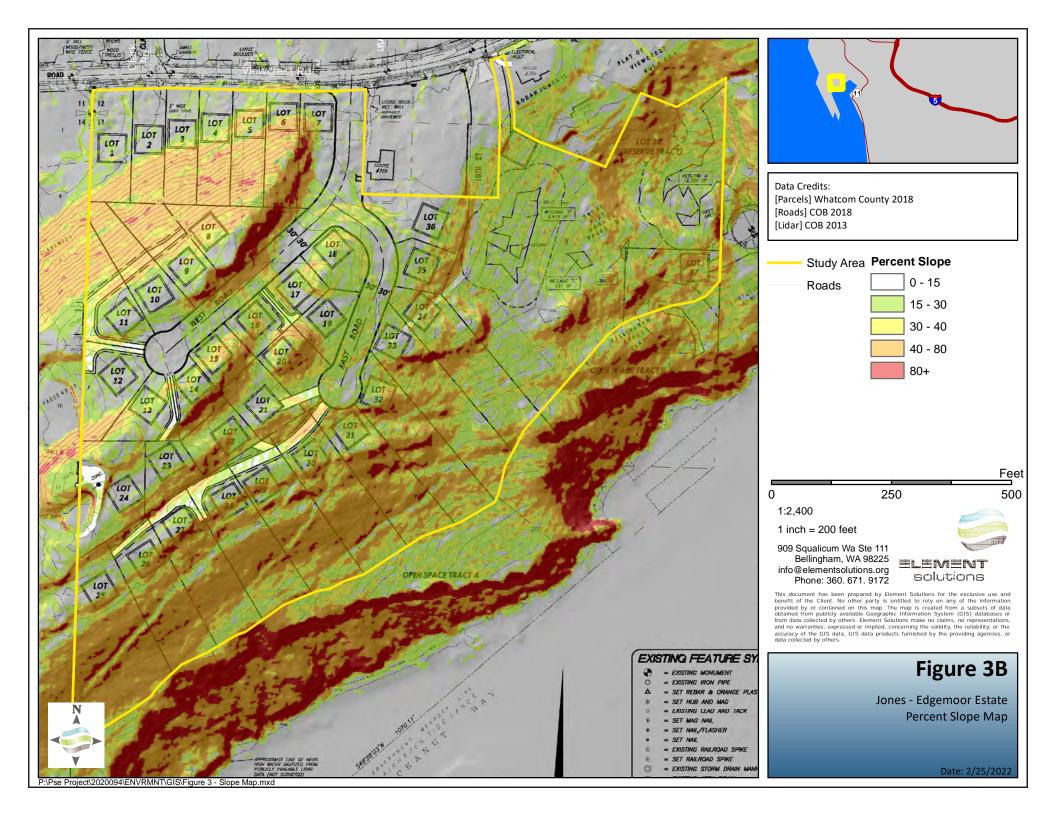

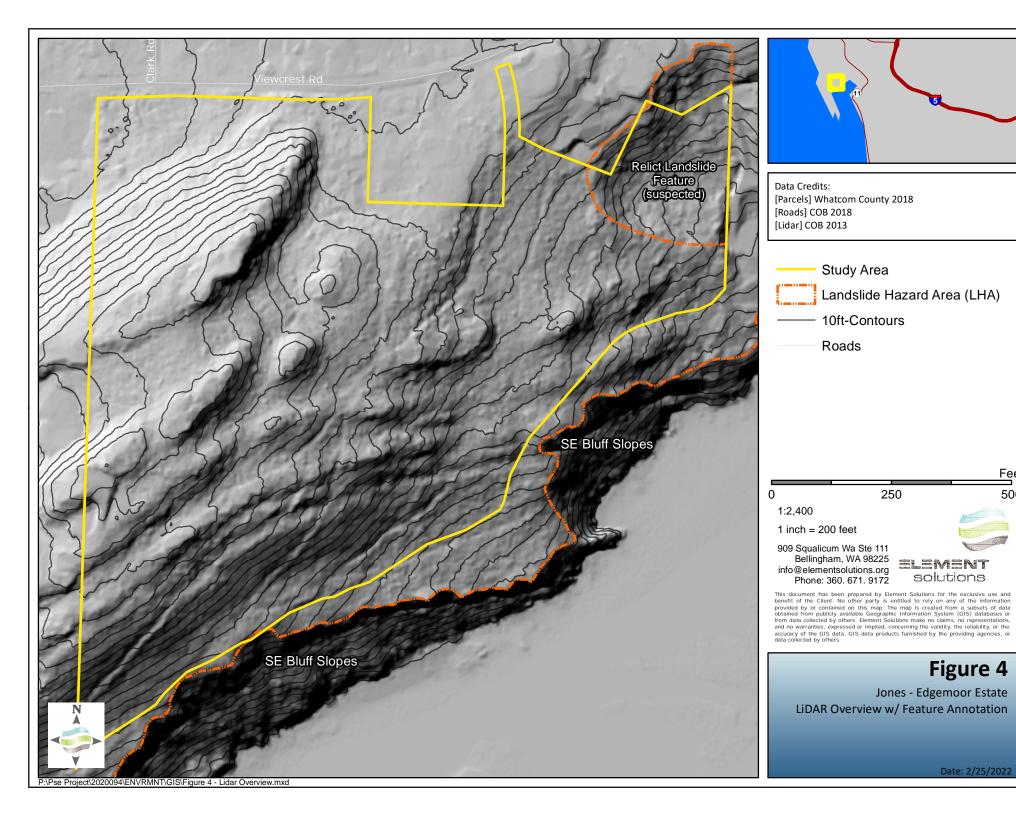


Feet

500

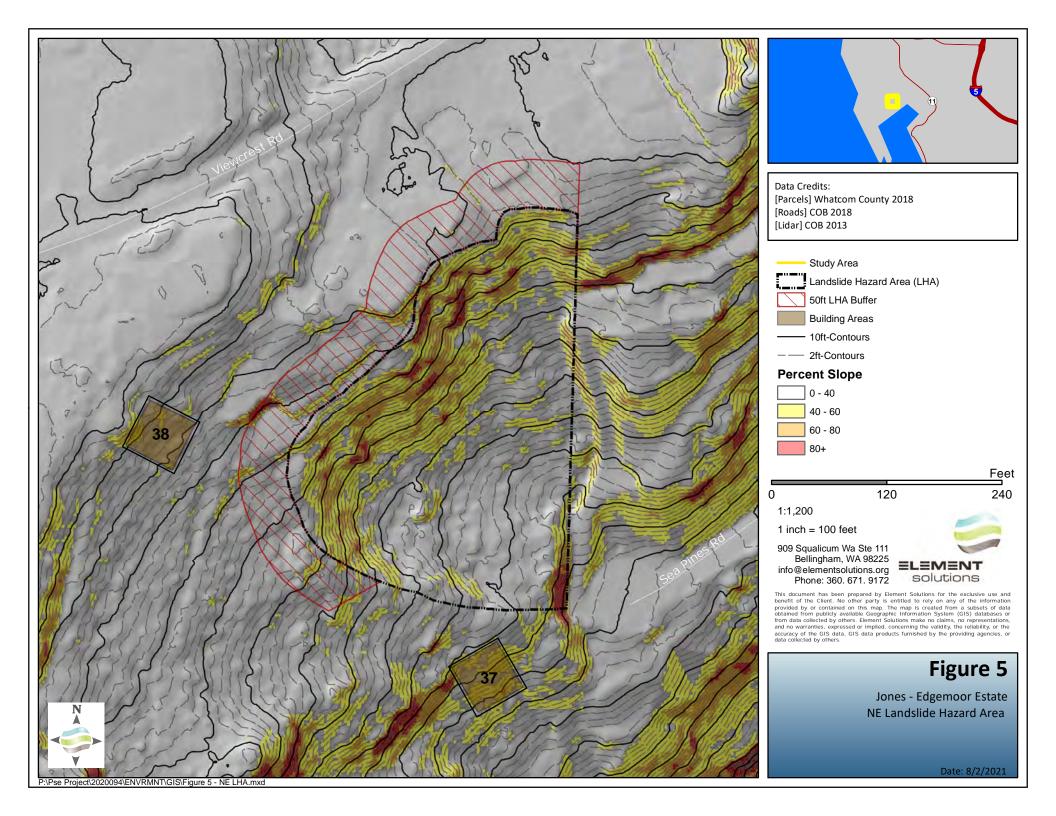

Appendix II

- 1) Figure 6 Project Map with Test Pit Locations
- 2) Test Pit Logs, TP1 to TP26 June 30 and July 1, 2020
- 3) Laboratory Testing Reports, GeoTest Services Inc., Project No. 20-0587. July 16, 2020
- 4) Laboratory Testing Report, Northwest Agricultural Consultants, Report No. 52022-1-1. July 21, 2020
- 5) Exhibit A Field Photos of Exploration Conditions, June 30 and July 1, 2020
- 6) Figure 7 Project Map with Measured Depths to Bedrock by TP Location
- 7) Figure 8 Sea Pines Work Area Map with Test Pit & Hand Auger Locations
- 8) Exploration Logs Sea Pines Area, TP1 to TP2, HA-1 to HA-2 November 13, 2020
- 9) Exhibit B Field Photos of Sea Pines Site Conditions & Explorations, November 13, 2020

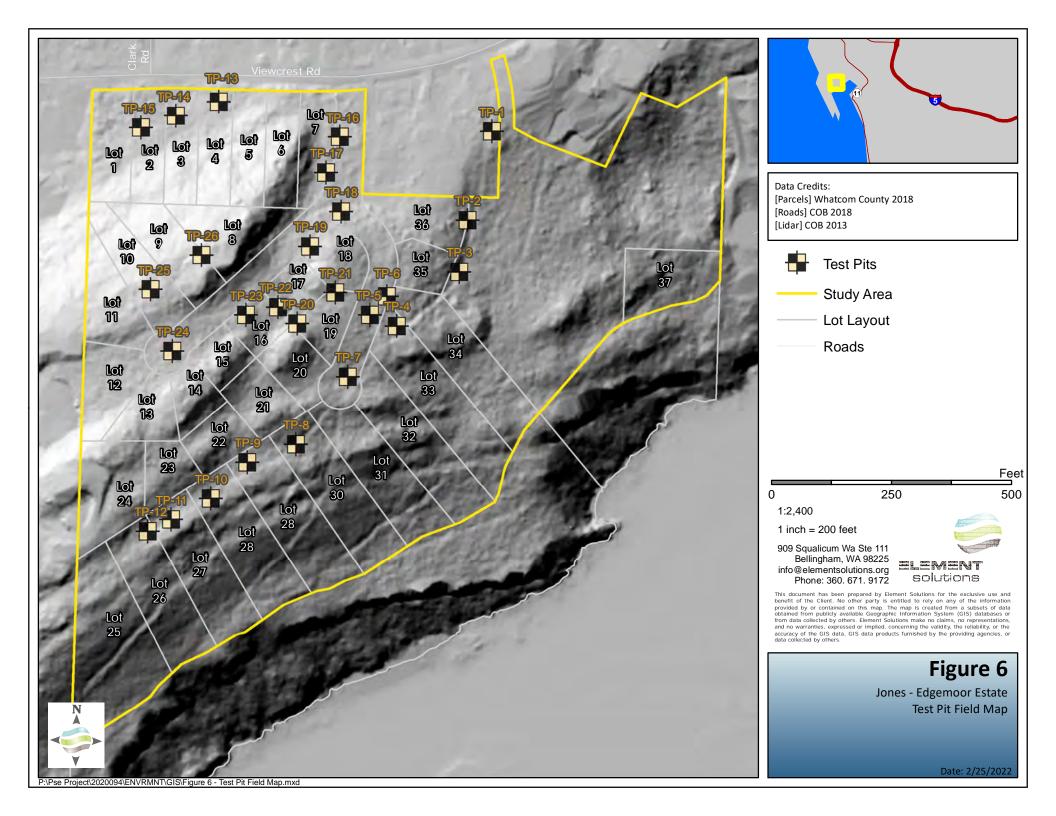

Element Solutions 909 Squalicum Way, Suite 111 Bellingham, WA 98225 Telephone: (360) 671-9172


TEST PIT NUMBER TP1 PAGE 1 OF 1

				671-468		
CLIENT	Ann (C Jone	es, Far	mily LP		PROJECT NAME Edgemoor Property
PROJE	CT NUM	IBER	2020	094		PROJECT LOCATION Viewcrest Road, Bellingham, WA
DATES	TARTE	D _6/3	30/20			GROUND ELEVATION 252' NAVD 88 TEST PIT SIZE 15 sqft
EXCAV	ATION (CONT	RACTO	OR Rya	n Bradley	GROUND WATER LEVELS:
EXCAV	ATION I	МЕТН	OD Y	anmar co	ompact excavator	AT TIME OF EXCAVATION
LOGGE	D BY	RC			CHECKED BY JG	
NOTES	No gr	oundv	vater o	r free wa	ter seepage observed.	AFTER EXCAVATION
DEPTH (ft)	SAMPLE	U.S.C.S.	GRAPHIC LOG			MATERIAL DESCRIPTION
0.0			7 <u>1 1</u> 5. 7 <u>1</u>	(OL) ORGANIC SILT; dark brown;	soft; cohesive, non-plastic; damp; root material present. [Topsoil]
		OL	1/ . 1/1/			
31-			70.7	0.7		251
1				(ML) SILT WITH SAND; ~50-60%	fines; dark grayish brown; soft to medium stiff; cohesive; low to
<u> </u>				r	non-plastic; damp; dark orange oxi	dation staining ~3-3.5'; chunks of asphalt present. [Uncontrolled Fill]
-						
		ML				
2.5						
				3.5		248
			X X X X	(nd cobbles; ~30-40% fines; tan to light grayish brown; medium dense,
						n; non-plastic; damp; sand is medium to fine; moderate to light, orange epth; gravel and cobbles are rounded; occasional boulders and minor
					coal present. [Glacial Drift]	······································
<u> </u>						
5.0		SM				
<u> </u>						
	GB					
	OB				Sample at 6': 31% Fines	
				6.5	'	245
		SM		d		•20-30-% fines; grayish brown; dense; moderate cohesion; non-plastic; ie; gravel is rounded and mostly fine; cemented and blocky at TD. 245
						Bottom of test pit at 7.0 feet.
i 2						
il						

Element Solutions 909 Squalicum Way, Suite 111 Bellingham, WA 98225

TEST PIT NUMBER TP2 PAGE 1 OF 1

-				e: (360) 671-9172 671-4685	
CLIE	ENT Ann		. ,		PROJECT NAME Edgemoor Property
PRC	DJECT NUN	/IBER	20200	094	PROJECT LOCATION Viewcrest Road, Bellingham, WA
DAT	E STARTE	D 6/3	30/20	COMPLETED _	_6/30/20
EXC	AVATION	CONT	RACTO	OR Ryan Bradley	GROUND WATER LEVELS:
EXC	AVATION	METH	OD <u>Y</u>	anmar compact excavator	AT TIME OF EXCAVATION
LOG	GED BY _	RC		CHECKED BY	JG AT END OF EXCAVATION
NOT	TES Seep	age ar	nd cavii	ng at approximately 3' bgs.	4hrs AFTER EXCAVATION 3.00 ft / Elev 234.00 ft
-2020.GPJ -0 DEPTH -0 (#)	SA SA	U.S.C.S.	GRAPHIC LOG		MATERIAL DESCRIPTION
1-7		٥.	1/2 . 1/2	(OL) ORGANIC SIL	ILT; dark brown; soft; cohesive, non-plastic; moist; root material present. [Topsoil]
9-30		OL	1/ 1/1/	0.5	226
SIBENTLEY/GINT/PROJECTS/JONES-EDGEMOOR_TESTPIT_LOGS (- GB	SP- SM		medium dense to d moderate orange m	GRADED SAND WITH SILT, some gravel and cobbles; ~10-20% fines; tan to gray; dense; non cohesive; non-plastic; moist to saturated at depth; sand is medium to fine; mottling throughout, decreasing around 3'; heavy orange oxidation staining ~2'; seepage fusal on rock. [Glacial Outwash]
GENERAL BH / TP / WELL - GINT STD US LAB.GDT - 2/26/21 12:02 - C:\USERS\RCOOPER\DOCUMENTS\BENTLEY\GINT\PROJECTS\JONES-EDGEMOOR_TESTPIT_LOGS_6-30_7-1-2020.GFU O				4.0 SANDSTONE BED	DROCK; tan; very dense. [Chuckanut Formation (Padden Member)] Bottom of test pit at 4.0 feet.



TEST PIT NUMBER TP3 PAGE 1 OF 1

-		Tel	ephone	n, WA 9 e: (360) ⊧671-46	671-9172			
CLIEN	T Ann		, ,				PROJECT NAME Edgemoor Property	
					COMPLETED 6/30			
EXCA	/ATION	CONT	RACT	OR R	van Bradley		GROUND WATER LEVELS:	
EXCA	/ATION	METH	IOD Y	anmar	compact excavator		AT TIME OF EXCAVATION	
LOGGI	ED BY _	RC			CHECKED BY _JG	i		
NOTES	3 <u>No gr</u>	ound	vater o	r free w	vater seepage observed.		AFTER EXCAVATION	
O DEPTH	SAMPLE	U.S.C.S.	GRAPHIC LOG				MATERIAL DESCRIPTION	
		OL		1.3	(OL) ORGANIC SILT; o	dark brown; so	ft; cohesive, non-plastic; moist; root material present. [Topsoil]	227.7
2.5		SM		2.5	cohesion; non-plastic; r	moist; sand is	cobbles, a little clay; ~20-30% fines; gray; medium dense; low medium to fine; heavy orange mottling throughout; gravel and lders present. [Glacial Drift]	226.5
		SM		3.5			rayish brown; medium dense to dense; moderate cohesion; low to er 0.5', cemented and blocky near TD; refusal on rock. [Glacial Till]	225.5
					SANDSTONE BEDRO	CK; tan; very o	dense. [Chuckanut Formation (Padden Member)] Bottom of test pit at 3.5 feet.	

GENERAL BH / TP / WELL - GINT STD US LAB.GDT - 2/26/21 12:02 - C./USERS/RCOOPER/DOCUMENTS/BENTLEY/GINT/PROJECTS/JONES-EDGEMOOR_TESTPIT_LOGS_6-3/3_7-1-2/20:0.6PJ




TEST PIT NUMBER TP4 PAGE 1 OF 1

1 4% (000) 011 10	00		
CLIENT Ann C Jones, Family LP		PROJECT NAME Edgemoor Property	
PROJECT NUMBER 2020094		PROJECT LOCATION Viewcrest Road, Bellingham, WA	
DATE STARTED 6/30/20	COMPLETED _6/30/20	GROUND ELEVATION 255' NAVD 88 TEST PIT SIZE 15 sqft	
EXCAVATION CONTRACTOR Ry	an Bradley	GROUND WATER LEVELS:	
EXCAVATION METHOD Yanmar	compact excavator	AT TIME OF EXCAVATION	
LOGGED BY RC	CHECKED BY JG	AT END OF EXCAVATION	
NOTES No groundwater or free w	ater seepage observed.	AFTER EXCAVATION	
SAMPLE U.S.C.S. GRAPHIC LOG		MATERIAL DESCRIPTION	
$OL \begin{bmatrix} \frac{1}{\sqrt{1}}, \frac{1}{\sqrt{1}} \\ \frac{1}{\sqrt{1}}, \frac{1}{\sqrt{1}} \end{bmatrix} 0.3$	(OL) ORGANIC SILT; brown; sof	ft; cohesive, non-plastic; moist; refusal on rock. [Topsoil]	254.7
	SANDSTONE BEDROCK: tan: v	ery dense [Chuckanut Formation (Padden Member)]	

Bottom of test pit at 0.3 feet.


GENERAL BH / TP / WELL - GINT STD US LAB.GDT - 2/26/21 12:02 - C./USERS/RCOOPER/DOCUMENTS/BENTLEY/GINT/PROJECTS/JONES-EDGEMOOR_TESTPIT_LOGS_6-3/0_7-1-2/20:0.6PJ



TEST PIT NUMBER TP5 PAGE 1 OF 1

		Fax	: (360)	671-4685				
CLIEN	IT Ann (C Jone	es, Far	nily LP	PROJECT NAME Edgemoor Property			
PROJ	ECT NUM	IBER	2020	094	PROJECT LOCATION Viewcrest Road, Bellingham, WA			
DATE	STARTE	D _6/3	30/20	COMPLETED 6/30/20	GROUND ELEVATION 267' NAVD 88 TEST PIT SIZE 15 sqft			
EXCA	VATION (CONT	RACT	OR Ryan Bradley	GROUND WATER LEVELS:			
EXCA	VATION I	METH	OD Y	anmar compact excavator	AT TIME OF EXCAVATION			
LOGG	ED BY	RC		CHECKED BY JG				
NOTE	S No gr	oundv	vater o	r free water seepage observed.	AFTER EXCAVATION			
O DEPTH (ft)	SAMPLE	U.S.C.S.	GRAPHIC LOG		MATERIAL DESCRIPTION			
1		OL	7 7 7	[Topsoil]	oft; cohesive, non-plastic; moist; abundant root material present.	266.5		
	(SM) SILTY SAND, some gravel and cobbles; ~25-35% fines; gray to tan; medium dense to dense; low to moderate cohesion; non-plastic; damp; sand is medium to fine; light, orange colored mottling evenly distributed throughout; gravel and cobbles are rounded; refusal on rock. [Glacial Drift]							
				SANDSTONE BEDROCK; tan; very of	dense. [Chuckanut Formation (Padden Member)] Bottom of test pit at 2.5 feet.			

GENERAL BH / TP / WELL - GINT STD US LAB.GDT - 2/26/21 12:02 - C./USERS/RCOOPER/DOCUMENTS/BENTLEY/GINT/PROJECTS/JONES-EDGEMOOR_TESTPIT_LOGS_6-30_7-1-2020.GPJ



TEST PIT NUMBER TP6 PAGE 1 OF 1

	CLIEN	T Ann (C Jone	es, Fam	ily LP)	PROJECT NAME Edgemoor Property			
		ECT NUM								
						COMPLETED 6/30/20				
						yan Bradley				
E	EXCAVATION METHOD Yanmar compact excavator									
L	OGGED BY RC CHECKED BY JG									
١	NOTES	No gr	oundv	vater or	free v	water seepage observed.	AFTER EXCAVATION			
6-30_7-1-2020.GPJ	0.0 (ft)	SAMPLE	Q U.S.C.S.	GRAPHIC LOG		(OL) ORGANIC SILT; dark brown;	MATERIAL DESCRIPTION soft; cohesive, non-plastic; damp to dry; root material present. [Topsoil]			
TS\JONES-EDGEMOOR_TESTPIT_LOGS_6	-	GB	SM				nd cobbles; ~20-30% fines; tan to yellowish brown; medium dense to lamp; sand is fine; gravel and cobbles are angular; refusal on rock.	265.5		
DECT	2.5	-			2.5	SANDSTONE BEDROCK: tan: ven	y dense. [Chuckanut Formation (Padden Member)]	263.5		
GENERAL BH / TP / WELL - GINT STD US LAB.GDT - 2/26/21 12:02 - C.\USERS\RCOOPER\DOCUMENTS\BENTLEY\G\INT\PROJECTS\UONES-EDGEMOOR_TESTPIT_LOGS_6-30_7-1-2020.GPJ							Bottom of test pit at 2.5 feet.			




TEST PIT NUMBER TP7 PAGE 1 OF 1

		(360) 671	1-4685	
CLIENT Ann	C Jone	s, Family	LP	PROJECT NAME _Edgemoor Property
PROJECT NU	MBER	2020094		PROJECT LOCATION Viewcrest Road, Bellingham, WA
DATE START	ED <u>6/</u> 3	30/20	COMPLETED 6/30/20	GROUND ELEVATION 253' NAVD 88 TEST PIT SIZE 15 sqft
EXCAVATION	CONT	RACTOR	Ryan Bradley	GROUND WATER LEVELS:
EXCAVATION	METH	OD Yann	nar compact excavator	AT TIME OF EXCAVATION
LOGGED BY	RC		CHECKED BY _JG	AT END OF EXCAVATION
NOTES No g	roundv	ater or fre	e water seepage observed.	AFTER EXCAVATION
SAMPLE	U.S.C.S.	GRAPHIC LOG		MATERIAL DESCRIPTION
08	OL	7/ 3/1/	(OL) ORGANIC SILT; dark brown	; soft; cohesive, non-plastic; damp; root material present. [Topsoil]
φ 20 – –		0.5		252.
FEUGEMOOK IESITAL FOR	SM		cohesion; non-plastic; damp; san	
		2.0	SANDSTONE BEDROCK; tan; ve	ery dense. [Chuckanut Formation (Padden Member)]
GENERAL BH / IP / WELL - GIN I STD US LAB.GDJ - 2/26/27 12:02 - C: USERS/RCOOPER/DOCUMEN I SIBEN I LEYGIN I/PROJECT SUONES-EDGEMOOK, TESTPTI LOGS.				

Element Solutions 909 Squalicum Way, Suite 111 Bellingham, WA 98225 Telephone: (360) 671-9172


TEST PIT NUMBER TP8 PAGE 1 OF 1

		Fax	: (360) 671-	4685		
CLIEN	T Ann	C Jone	es, Family L	<u>_P</u>	PROJECT NAME Edgemoor Property	
PROJ	ECT NUM	/IBER	2020094		PROJECT LOCATION Viewcrest Road, Bellingham, WA	
DATE	STARTE	D 6/	30/20	COMPLETED _6/30/20	GROUND ELEVATION 258' NAVD 88 TEST PIT SIZE 15 sqft	
EXCA	VATION	CONT	RACTOR _	Ryan Bradley	_ GROUND WATER LEVELS:	
EXCA	VATION	METH	OD Yanma	ar compact excavator	AT TIME OF EXCAVATION	
LOGG	ED BY _	RC		CHECKED BY JG	AT END OF EXCAVATION	
NOTE	S No gr	oundv	vater or free	water seepage observed.	AFTER EXCAVATION	
-7-1-2020.GPJ -C DEPTH -C (ft)	SAMPLE	U.S.C.S.	GRAPHIC LOG	(OL) ORGANIC SILT: dark brown: s	MATERIAL DESCRIPTION soft; cohesive, non-plastic; damp; root material present. [Topsoil]	
		OL	\(\frac{1}{12} \cdot \frac{3}{12} \cdot \frac{1}{12} \cdot \frac{1}{12	. ,		257.2
ENERGENICON TEC.T		SM	2.0	dense; low to moderate cohesion; n throughout; gravel and cobbles are	d cobbles, a little clay; ~40-50% fines; brown to grayish brown; medium on-plastic; moist; sand is medium to fine; light, orange colored mottling rounded; occasional boulders present. [Glacial Drift]	256.0
EKDOCUMENI SIBENI LETAGINI IPRODECI SUCURES EDGEMOOK, TESTITI LOGS, 6-36, 71-2020, 5-37, 71-2020	GB			(SC) CLAYEY SAND, some gravel, moderate cohesion; medium plastic gravel content from ~4'-6'; occasion Sample at 4': 20% Fines; Atterberg		
7.5		SC	6.5	Sample at 4 . 20% Fines, Atterberg	LIIIIIIS. LL = 31, PL = 23, P1 = 20	251.5
7.5		SM	8.0		el; ~30-50% fines; grayish brown; dense; low to moderate cohesion; to fine; blocky and cemented; refusal in very dense weathered rock.	250.0
GENERAL				SANDSTONE BEDROCK; tan; very	dense. [Chuckanut Formation (Padden Member)] Bottom of test pit at 8.0 feet.	



TEST PIT NUMBER TP9 PAGE 1 OF 1

			671 - 46 (85	
CLIENT Ann					PROJECT NAME Edgemoor Property
PROJECT NU	MBER	2020	094		PROJECT LOCATION Viewcrest Road, Bellingham, WA
DATE START	ED _6/3	30/20		COMPLETED 6/30/20	GROUND ELEVATION 272' NAVD 88 TEST PIT SIZE 15 sqft
EXCAVATION	CONT	RACT	OR Ry	an Bradley	GROUND WATER LEVELS:
EXCAVATION	METH	OD _Y	′anmar d	compact excavator	
LOGGED BY	RC			CHECKED BY JG	
NOTES No	groundv	vater c	r free wa	ater seepage observed.	AFTER EXCAVATION
O DEPTH (ft)	U.S.C.S.	GRAPHIC LOG			MATERIAL DESCRIPTION
	01	1/2 · 1/2		(OL) ORGANIC SILT; dark	brown; soft; cohesive, non-plastic; moist; root material present. [Topsoil]
	OL	17 - 3 17	0.5		271.5
				(ML) SANDY SILT; ~60-700 colored mottling throughout	% fines; grayish brown; stiff; cohesive; low to non-plastic; damp; light, orange t; occasional boulders present; roots stop at ~2.3'. [Glacial Drift]
	ML				
2.5			2.5		269.5
GE	SM				gravel and cobbles; ~20-30% fines; orange brown; dense; low to moderate p; sand is medium to fine; transitions to weathering rind before refusal on rock.
GE GE				Sample at 4': 22% Fines	
			4.5	Campio at 1. 2270 1 mos	267.5
- 1202 - 2703 1 200 - 2703 1 20			7.0	SANDSTONE BEDROCK;	tan; very dense. [Chuckanut Formation (Padden Member)] Bottom of test pit at 4.5 feet.




TEST PIT NUMBER TP10 PAGE 1 OF 1

			Fax	c (360) 67	71-4685		
	CLIEN	T Ann	C Jon	es, Family	y LP	PROJECT NAME Edgemoor Property	
	PROJ	ECT NUM	/IBER	2020094	4	PROJECT LOCATION Viewcrest Road, Bellingham, WA	
	DATE	STARTE	D 6/	30/20	COMPLETED 6/30/20	GROUND ELEVATION 279' NAVD 88 TEST PIT SIZE 15 sqft	
	EXCA	VATION	CONT	RACTOR	Ryan Bradley	GROUND WATER LEVELS:	
	EXCA	VATION	METH	I OD Yan	mar compact excavator	AT TIME OF EXCAVATION	
	LOGG	ED BY	RC		CHECKED BY JG		
	NOTE	S Nogr	ound		ee water seepage observed.		
GENERAL BH / TP / WELL - GINT STD US LAB.GDT - 2/26/21 12:03 - C:\USERSIRCOOPERIDOCUMENTSIBENTLEYIGINT\PROJECTS\UONES-EDGEMOOR_TESTPIT_LOGS_6-30_7-1-2020.GPJ	0.0 DEBLH (#)	S No gr	U.S.C.S.	REAPHIC LOG CAPPING CA	(OL) ORGANIC SILT; dark brown; site (SM) SILTY SAND, some gravel; ~: cohesion; non-plastic; damp to dry; Sample at 3': 21% Fines	MATERIAL DESCRIPTION soft; cohesive, non-plastic; moist; root material present. [Topsoil] 20-30% fines; tan to yellowish brown; medium dense to dense; low sand is fine; gravel is angular; refusal on rock. [Highly Reworked Rock] y dense. [Chuckanut Formation (Padden Member)] Bottom of test pit at 3.5 feet.	278.6
GENERAL BH / TP / WELL - GINT STD US LAB.GDT - 2/26/21 12:03 - C:\USERS\RCOOPER\DOC							



TEST PIT NUMBER TP11

			WA 98225		PAGE 1 OF	F 1
		elephone: (ax: (360) 6	(360) 671-9172			
CLIENT					PROJECT NAME Edgemoor Property	
			94		PROJECT LOCATION Viewcrest Road, Bellingham, WA	
			COMPLETED _			
			R _Ryan Bradley			
			nmar compact excavator			
LOGGED		-		JG		
			ree water seepage observ			
NOTES _	140 groun	dwater or i	ree water seepage observ	reu.	AFTER EXCAVATION	
-2020.GPJ -2020.GPJ -2020.GFJ -2020.GFJ	SAMPLE	GRAPHIC			MATERIAL DESCRIPTION	
1-1-0.0	0	L 1/ 1/ 1/ 0.	(OL) ORGANIC SIL	T; dark brown; s	oft; cohesive, non-plastic; moist; root material present. [Topsoil]	
E-9		_ / 2 0.		a little alove - 20		289.6
GENERAL BH / TP / WELL - GINT STD US LAB.GDT - 2/26/21 12:03 - C:\USERS\RCOOPER\DOCUMENTS\BENTLEY\GINT\PROJECTS\UONES-EDGEMOOR_TESTPIT_LOGS_6-30_7-7-1-2020.GPJ C	SI	VI	cohesion; non-plasi on rock. [Glacial D i	tic; damp; sand is	-40% fines; light brown to grayish; medium dense; low to moderate is medium to fine; moderate, orange colored mottling to ~1.5'-3'; refusal	287.0
3461		[[.:].:]3.		ROCK; tan; very	dense. [Chuckanut Formation (Padden Member)]	287.0
					Bottom of test pit at 3.0 feet.	
S/BEI						
EN EN						
N N						
ND N						
OPE						
SASS						
SERS						
NO N						
5:03						
21 13						
2/26						
- TOS						
LAB.						
Sn a						
TST						
<u>N</u>						
WELL						
\ d						
BH/						
ERAL						
E E						



TEST PIT NUMBER TP12 PAGE 1 OF 1

		Fax	epnone :: (360)	671 - 46	685			
CLIEN	T Ann	C Jone	es, Far	nily LP		PROJECT NAME _Edgemoor Property		
PROJE	ECT NUN	1BER	2020	094		PROJECT LOCATION Viewcrest Road, Bellingham, WA		
DATE	STARTE	D <u>6/</u>	30/20		COMPLETED 6/30/20	GROUND ELEVATION 292' NAVD 88 TEST PIT SIZE 15 sqft		
EXCA	/ATION	CONT	RACTO	OR R	yan Bradley			
EXCA	/ATION	METH	OD Y	'anmar	compact excavator			
LOGG	ED BY _	RC			CHECKED BY _JG	AT END OF EXCAVATION		
NOTES	S <u>No gr</u>	oundy	vater o	r free w	vater seepage observed.	AFTER EXCAVATION		
	щ	S.	ੂ					
DEPTH (ft)	SAMPLE	U.S.C.	GRAPHIC LOG			MATERIAL DESCRIPTION		
	SA). 	GR					
0.0								
		OL	1. 1.1. 1.1. 1.1.		(OL) ORGANIC SILT; dark brown	r; soft; cohesive, non-plastic; moist; root material present. [Topsoil]		
			7.7.7	0.4	(CM) CILTY CAND a little alove	30-40% fines; light brown to grayish; medium dense; low to moderate	291.6	
		SM			cohesion; non-plastic; damp; san	d is medium to fine; moderate, oʻrange colored mottling from ~2'-3.3'; ore refusal on rock. [Glacial Drift]		
2.5								
; 	GB							
					Sample at 3': 28% Fines			
				3.5	OANIDOTONE REPROSICA		288.5	
					SANDSTONE BEDROCK; tan; ve	ery dense. [Chuckanut Formation (Padden Member)] Bottom of test pit at 3.5 feet.		

GENERAL BH / TP / WELL - GINT STD US LAB.GDT - 2/26/21 12:03 - C./USERS/RCOOPER/DOCUMENTS/BENTLEY/GINT/PROJECTS/JONES-EDGEMOOR_TESTPIT_LOGS_6-30_7-1-2020.GPJ

TEST PIT NUMBER TP13 PAGE 1 OF 1

			, ,	671-4685				
	IT Ann			_			· · ·	—
1							Viewcrest Road, Bellingham, WA	
1							238' NAVD 88 TEST PIT SIZE 15 sqft	
EXCA	VATION	CONT	RACT	OR Ryan E	Bradley			
1					pact excavator		CAVATION	
LOGG	ED BY _	RC			CHECKED BY JG	AT END OF EXC	AVATION	
NOTE	S No gr	oundy	vater o	r free water	seepage observed.	AFTER EXCAVA	TION	—
DEPTH (ft)	SAMPLE	U.S.C.S.	GRAPHIC LOG			MATERIAL DESCRIF	PTION	
0.0			1.4.7. A	(0)	\ 0.D.0.1111.0.011.7			
2.5		OL	7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7	coł	L) ORGANIC SILT, some gravel nesive, non-plastic; moist; root m	and cobbles; dark brown to aterial present, disturbed -	o orange brown; soft to medium stiff; some buried garbage. [Topsoil]	
<u>-</u>			\$ <u>\$\frac{1}{2} \frac{1}{2} \f</u>	3.0	D) DOODLY CDADED CDAVEL	MITH CAND, some sobble	es; <10% fines; brown; medium dense;	235.0
	GB	GP		nor	n-cohesive; non-plastic; moist. [6]	Glacial Outwash]		233.5
5.0		SM			 A) SILTY SAND WITH GRAVEL derate cohesion; low to non-plas 		to gray; medium dense to dense ~6'; low to Glacial Drift]	
- 105.dkg	GB			Sal	mple at 6': 28% Fines			231.5
		SM		(SI	/I) SILTY SAND, some gravel; ~. non-plastic; damp to dry; gravel i	20-30% fines; light gray to g s fine; cemented and block	gray; dense; low to moderate cohesion; low y; refusal in hardpan till. [Glacial Till]	231.0
5		!	1 - 1- 11-			Bottom of test pit at 7		
FINAL DIT / WELL								

TEST PIT NUMBER TP14 PAGE 1 OF 1

					671-4685		
		IT Ann (•		
	PROJ	ECT NUM	IBER	2020		PROJECT LOCATION Viewcrest Road, Bellingham, WA	
					COMPLETED 6/30/20	GROUND ELEVATION 228' NAVD 88 TEST PIT SIZE 15 sqft	
					OR Ryan Bradley		
					anmar compact excavator		
		ED BY _			CHECKED BY JG		
	NOTE	S No gr	oundv	vater o	r free water seepage observed.	AFTER EXCAVATION	
1-2020.GPJ	O DEPTH O (ft)	SAMPLE	U.S.C.S.	GRAPHIC LOG		MATERIAL DESCRIPTION	
MOOR_TESTPIT_LOGS_6-30_7-1			OL		present. [Topsoil]	range brown; soft; cohesive, non-plastic; damp; abundant root material	226.5
R\DOCUMENTS\BENTLEY\GINT\PROJECTS\JONES-EDGE	2.5					s; ~20-30% fines, variable; light grayish brown; medium dense; large boulders present. [Glacial Outwash]	224.0
2/26/21 12:03 - C:\USERS\RCOOPER\DOC	5.0		SM		cohesion; low to non-plastic; dam		222.0
STD US LAB.GDT -			SM		(SM) SILTY SAND, some gravel; to non-plastic; damp to dry; grave	~30-40% fines; light gray to gray; dense; low to moderate cohesion; low el is fine; cemented and blocky; refusal in hardpan till. [Glacial Till]	
GINTS				<u>101410</u>	7.0	Bottom of test pit at 7.0 feet.	221.0
ENERAL BH / TP / WELL - C							

TEST PIT NUMBER TP15 PAGE 1 OF 1

		Fax	:: (360)	671-4685					
CLIEN	T Ann	C Jone	es, Fam	nily LP					
PROJI	ECT NUM	/IBER	20200	94	PROJECT LOCATION Viewcrest Road, Bellingham, WA				
DATE	STARTE	D 6/	30/20	COMPLETED 6/30/20	GROUND ELEVATION 223' NAVD 88 TEST PIT SIZE 15 sqft				
EXCA	VATION	CONT	RACTO	R Ryan Bradley	GROUND WATER LEVELS:				
EXCA	VATION	METH	OD Ya	anmar compact excavator	AT TIME OF EXCAVATION				
LOGG	ED BY _	RC		CHECKED BY JG	AT END OF EXCAVATION				
NOTE	S <u>No gr</u>	oundv	vater or	free water seepage observed.	AFTER EXCAVATION				
-2020.GPJ O DEPTH O (ft)	SAMPLE	U.S.C.S.	GRAPHIC LOG		MATERIAL DESCRIPTION				
2 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0		OL		(OL) ORGANIC SILT; dark browr present. [Topsoil]	n to orange brown; soft; cohesive, non-plastic; damp; root material				
				(SW) WELL GRADED SAND WI'non-cohesive; non-plastic; moist; Outwash]	TH GRAVEL, some cobbles; <10% fines; grayish brown; medium dense; gravel and cobbles are well-rounded; refusal on large boulder. [Glacial				
		SW							
/97/7 -			:::::::]6	3.0	217				
25					Bottom of test pit at 6.0 feet.				
GENERAL BH / TP / WELL - GIN I S TD US LAB.GDT - 2/26/21 12:03 - C.\USERS\RCOP 0 0									

		909 Bell Tele	ingham, \	m Way, Suite 111 WA 98225 360) 671-9172	TEST PIT NUMBER TP16 PAGE 1 OF 1
CLIEN	IT Ann		es, Family		PROJECT NAME Edgemoor Property
			202009		
				COMPLETED _7/1/20	
					GROUND WATER LEVELS:
				mar compact excavator	
	ED BY _			CHECKED BY JG	
NOTE	S No gr	oundv	vater or fr	ee water seepage observed.	AFTER EXCAVATION
DEPTH (ft)	SAMPLE	U.S.C.S.	GRAPHIC LOG		MATERIAL DESCRIPTION
0.0			17 · 77 · 17		bbles; dark brown to dark reddish orange brown; soft; cohesive, non-plastic; bbles are rounded to well-rounded. [Topsoil]
TESTPIT_LOGS_6-		OL	6 76 7 76 7 76		
NOC.			1.5		252.
SIBENTLEY/GINTI/PROJECTS/JONES-EDGEMOOR_TESTPIT_LOGS_6-30_7-1-2020.GPJ	GB	GP- GM		brown to orange brown; mediur Outwash] Sample at 3': 5% Fines	GRAVEL WITH SILT AND SAND, some cobbles; <10% fines, variable; n dense; non-cohesive; non-plastic; moist; some boulders present. [Glacial
PER\DOCUMENT	0.0	SC- SM	4.5	very dense; low to moderate co weathering rind before refusal o	hesion; low plasticity; damp; cemented and blocky; transitions to
000	─__GB_		<i>// / / / / / / / / / / / / / / / / / /</i>	Sample at 4.5': 39% Fines; Atte	erberg Limits: LL=21, PL=16, PI=5
RSN				SANDSTONE BEDROCK; tan;	very dense. [Chuckanut Formation (Padden Member)] Bottom of test pit at 4.5 feet.
GENERAL BH / TP / WELL - GINT STD US LAB.GDT - 2/26/21 12:03 - C.\USERSIRCOOPER\DOCUMENTS\ I					

Element Solutions 909 Squalicum Way, Suite 111 Bellingham, WA 98225

TEST PIT NUMBER TP17 PAGE 1 OF 1

			ohone: (360 (360) 671-4				
CLIENT	Ann C		` ')		PROJECT NAME Edgemoor Property	
DATE ST	TARTED	7/1/	20	COMPLETED	7/1/20	GROUND ELEVATION 258' NAVD 88 TEST PIT SIZE 15 sqft	
EXCAVA	ATION C	ONTR	ACTOR R	yan Bradley		GROUND WATER LEVELS:	
EXCAVA	ATION M	ETHO	D Yanmaı	r compact excavator		AT TIME OF EXCAVATION	
LOGGED	BY R	С		CHECKED BY	_JG		
NOTES	No grou	undwa	ater or free v	water seepage obser	ved.		
DEPTH (ft)	SAMPLE	U.S.C.S.	GRAPHIC LOG			MATERIAL DESCRIPTION	
0.0				(OL) ORGANIC SI material present, c	LT, some cobbles obbles are rounde	; dark brown to orange brown; soft; cohesive, non-plastic; moist; root ed to well-rounded. [Topsoil]	
		<u>!</u>	. <u> </u>				
2.5		SP	1.8			H SILT; ~10-20% fines, variable; tan to gray; medium dense; me boulders present. [Glacial Outwash]	256.2
			3.0				255.0
	:	SM		low to moderate co	phesion; non-plast	o fine gravel; ~30-40% fines; light gray to gray; dense to very dense; ic; damp; weathered in upper 1', cemented and blocky near TD; refusal on rock. [Glacial Till]	
		:	4.5	SANDSTONE BEE	DDCK: top: you	dense. [Chuckanut Formation (Padden Member)]	253.5
				SAINDS I VINE BEL	DINOUN, Iall, Very	Bottom of test pit at 4.5 feet.	
í							

TEST PIT NUMBER TP18 PAGE 1 OF 1


			: (360) 6					
			es, Famil					
1			202009		PROJECT LOCATION Viewcrest Road, Bellingham, WA			
				COMPLETED _7/1/20				
1				Ryan Bradley				
1			OD Yar	nmar compact excavator	-			
	ED BY _			CHECKED BY JG				
NOTE	S No gr	oundv	vater or fr	ree water seepage observed.	AFTER EXCAVATION			
S020.GPJ O DEPTH O (ft)	SAMPLE	U.S.C.S.	GRAPHIC LOG		MATERIAL DESCRIPTION			
<u> </u>			1/2 1/2		les; dark brown to orange brown; soft; cohesive, non-plastic; moist; root			
		OL	7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7	material present; cobbles are rour	naea to well-rounaea. [Topsoll]			
5 -			2.0		263.0			
EKDOCUMENI SIBENI LETAGINI IPRODECI SUCURES EDGEMOOK, TESTITI LOGS, 6-36, 71-2020, 5-37, 71-2020		SM	4.0	dense; low to moderate-cohesion;	and cobbles; ~20-40% fines, variable; brown to orange brown; medium; non-plastic; damp to moist; gravel clasts are rounded. [Glacial Drift]			
	GB	SP- SM			ND WITH SILT; ~10% fines; tan to gray; dense to very dense; ansitions to weathering rind before refusal on intact rock. [Highly			
5.0			5.0		260.0			
				SANDSTONE BEDROCK; tan; ve	ery dense. [Chuckanut Formation (Padden Member)] Bottom of test pit at 5.0 feet.			
GENERAL BH / 1P / WELL - GIN I S ID US LAB.GDI - ZIZ6/Z1 1Z:03 - C:\USERSKCOOP - 2 2 2 2 2 2 2 2 2								

TEST PIT NUMBER TP19 PAGE 1 OF 1

) 671-46						
CLIEN	NT Ann	C Jone	es, Fa	mily LP				•		
								Viewcrest Road, Bellinghar		_
								278' NAVD 88 TEST PIT	SIZE 15 sqft	
EXCA	VATION	CONT	RACT	OR Ry	an Bradley		_ GROUND WATER LEVE	ELS:		
EXCA	VATION	METH	OD _	anmar (compact excavato	r	_ AT TIME OF EXC	AVATION		
LOGG	SED BY _	RC			CHECKED BY	Y JG	_ AT END OF EXC	AVATION		
NOTE	S No gr	oundy	vater o	or free w	ater seepage obse	erved.	_ AFTER EXCAVAT	TION		
O DEPTH (ft)	SAMPLE	U.S.C.S.	GRAPHIC LOG				MATERIAL DESCRIP	TION		
		OL		2.0	(OL) ORGANIC S root material pres		orange brown; soft; cohes	ive, non-plastic; damp to mo		276.0
2.5		SM			dense; low to mo		on-plastic; moist; some ligh	/ariable; brown to orange br nt gray silt lensing with oranดู	own; medium ge redox	
 		SP- SM		4.0	(SP-SM) POORL non-cohesive; no Reworked Rock]	n-plastic; dry; trans	WITH SILT; ~10% fines; to titions to weathering rind be	an to gray; dense to very de fore refusal on intact rock.	nse; [Highly	274.0
5.0			1544	5.0	SANDSTONE BE	DROCK; tan: verv	dense. [Chuckanut Forma	tion (Padden Member)]		273.0
						,, ,	Bottom of test pit at 5.			

TEST PIT NUMBER TP20 PAGE 1 OF 1

			•	671-468					
CLIENT	Ann C	C Jone	es, Fa	mily LP			PROJECT NAME Edg	emoor Property	_
								Viewcrest Road, Bellingham, WA	
								<u>288' NAVD 88</u> TEST PIT SIZE <u>15 so</u>	qft
EXCAV	ATION (CONT	RACT	OR Ryar	Bradley		GROUND WATER LEVI	ELS:	
EXCAV	ATION I	METH	OD _	anmar co	mpact excavator		AT TIME OF EXC	EAVATION	
LOGGE	ED BY _	RC			CHECKED BY JG		AT END OF EXC	AVATION	
NOTES	No gro	oundy	vater c	r free wat	er seepage observed.		AFTER EXCAVA	TION	
o DEPTH o (ft)	SAMPLE	U.S.C.S.	GRAPHIC LOG				MATERIAL DESCRIP	PTION	
0.0			7 <u>1 1</u> 87 <u>1</u>				range brown; soft; cohes	ive, non-plastic; moist; abundant root	
		OL		n n	naterial present. [Topsoil]				286.5
2.5		SM		(5	SM) SILTY SAND, little grand in the grand in	obbles; ~30-40% fines; lig ange oxidation around ~2	ght grayish brown; medium dense; low 2.5'-3.5'. [Glacial Drift]	284.5	
		ML	1.1.4.	(I n	ທL) SANDY SILT, some fi on-plastic; moist; orange ເ	ine gravel; colored mo	~40-60% fines, variable; ttling throughout. [Glacia	light gray to gray; stiff; cohesive; low to I Drift]	
5.0				5.0	SM) SII TY SAND some r	medium to t	fine gravel· ~30-40% fine	s; light gray to gray; dense to very dense	283.0
1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1		SM		lc h	ow to moderate cohesion; ardpan till. [Glacial Till]	non-plastic	; damp; weathered in upp	per ~1', cemented and blocky; refusal in	
			<u>1919-19</u>	7.0			Bottom of test pit at 7.	.0 feet.	281.0



TEST PIT NUMBER TP21 PAGE 1 OF 1

			Tele	ingham, W <i>A</i> ephone: (36 : (360) 671-	0) 671-9172		1 01 1	
	CLIEN	T Ann			P	PROJECT NAME _Edgemoor Property		
- 1					•			
- 1						GROUND ELEVATION 282' NAVD 88 TEST PIT SIZE 15 sqft		
- 1	EXCAVATION CONTRACTOR Ryan Bradley							
- 1								
					ar compact excavator			
		ED BY _			CHECKED BY _JG			
	NOTES	No gr	ounav	vater or tree	water seepage observed.	AFTER EXCAVATION		
2020.GPJ	0.0 DEPTH 0.0 (ff)	SAMPLE	U.S.C.S.	GRAPHIC LOG		MATERIAL DESCRIPTION		
1T_LOGS_6-30_7-1-;			OL	1/2 1/2	(OL) ORGANIC SILT; dark brown present. [Topsoil]	n to reddish brown; soft; cohesive, non-plastic; moist; root material		
ECTS\JONES-EDGEMOOR_TESTP	2.5		SM	<u>\$\frac{\fir}{\fin}}}}}}}}{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\fir}}}}}}{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\fir}{\fir}}}}}}{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac{\frac</u>	(SM) SILTY SAND, some gravel of very dense; low cohesion; non-pla (weathered sandstone); refusal of	and cobbles; ~20-30% fines; tan to yellowish brown; medium dense to astic; damp; sand is medium to fine; gravel and cobbles are angular n rock. [Highly Reworked Rock]	281.0	
SINT\PROJ				3.0			279.0	
GENERAL BH / TP / WELL - GINT STD US LAB.GDT - 2/26/21 12:03 - C.\USERS\RCOOPER\DOCUMENTS\BENTLEY\GINT\PROJECTS\JONES-EDGEMOOR_TESTPIT_LOGS_6-30_7-1-2020.GPJ					SANDSTONE BEDROCK; tan; ve	ery dense. [Chuckanut Formation (Padden Member)] Bottom of test pit at 3.0 feet.		

TEST PIT NUMBER TP22 PAGE 1 OF 1

		(360) 67	1-4685	
CLIENT Ann		_		
PROJECT NU	MBER	2020094		PROJECT LOCATION Viewcrest Road, Bellingham, WA
DATE STARTE	ED <u>7/</u>	/20	COMPLETED _7/1/20	GROUND ELEVATION 290' NAVD 88 TEST PIT SIZE 15 sqft
EXCAVATION	CONT	RACTOR	Ryan Bradley	GROUND WATER LEVELS:
EXCAVATION	METH	OD Yann	nar compact excavator	AT TIME OF EXCAVATION
LOGGED BY	RC		CHECKED BY JG	AT END OF EXCAVATION
NOTES No g	roundw	ater or fre	ee water seepage observed.	AFTER EXCAVATION
O DEPTH (ft)	U.S.C.S.	GRAPHIC LOG		MATERIAL DESCRIPTION
0.0	OL		(OL) ORGANIC SILT; dark brown t [Topsoil]	o brown; soft; cohesive, non-plastic; moist; root material present.
		1.5		288
0.0 0.0	SM			I cobbles; ~30-40% fines; light grayish brown; medium dense; low to imp to moist; clasts are rounded; occasional boulders present. [Glacial
 	SM	3.5	cohesion; non-plastic; damp; some	el; ~20-30% fines; gray; dense to very dense; low to moderate light, orange colored redox mottling around interface with overlying ons to weathering rind before refusal on rock. [Glacial Till]
5.0		5.0	SANDSTONE BEDROCK; tan; ver	y dense. [Chuckanut Formation (Padden Member)]
5.0				Bottom of test pit at 5.0 feet.

TEST PIT NUMBER TP23 PAGE 1 OF 1

			671-4685		
CLIENT Ann		, ,			PROJECT NAME Edgemoor Property
PROJECT NU	MBER	2020	094		
DATE STARTI	ED <u>7/</u>	1/20		COMPLETED 7/1/20	GROUND ELEVATION 305' NAVD 88 TEST PIT SIZE 15 sqft
EXCAVATION	CONT	RACT	OR Ryan	Bradley	GROUND WATER LEVELS:
				mpact excavator	
LOGGED BY	RC			CHECKED BY JG	
NOTES No g	NOTES No groundwater or free water seepage observed.				AFTER EXCAVATION
O DEPTH (ft)	U.S.C.S.	GRAPHIC LOG			MATERIAL DESCRIPTION
0.0	OL	7 1/2 1/2 1/2 1/2 1	`	DL) ORGANIC SILT; brow	vn; soft; cohesive, non-plastic; moist; root material present. [Topsoil]
(SM) SILTY SAND, little gravel and					avel and cobbles; ~30-40% fines; light grayish brown; medium dense; low to lastic; damp to moist; some light, orange colored redox mottling ~2'-3'; clasts
 	SM		ur	phesion; non-plastic; dam	302.0 fine gravel; ~20-30% fines; gray; dense to very dense; low to moderate ap; some light, orange colored redox mottling around interface with overlying; transitions to weathering rind before refusal on rock. [Glacial Till]
			4.5 S.	ANDSTONE BEDROCK	tan; very dense. [Chuckanut Formation (Padden Member)]
					Bottom of test pit at 4.5 feet.

TEST PIT NUMBER TP24 PAGE 1 OF 1

			: (360) 6				
1	IT Ann (
	ECT NUM				PROJECT LOCATION Viewcrest Road, Bellingham, WA		
				COMPLETED <u>7/1/20</u>			
				Ryan Bradley			
				nmar compact excavator			
	LOGGED BY RC CHECKED BY JG NOTES No groundwater or free water seepage observed.						
NOTE	S No gr	oundv	vater or f	ree water seepage observed.	AFTER EXCAVATION		
-2020.GPJ O DEPTH O (ft)	SAMPLE	U.S.C.S.	GRAPHIC LOG		MATERIAL DESCRIPTION		
0.00		OL		moist; root material present.	cobbles and gravel; dark brown to reddish brown; soft; cohesive, non-plastic; [Topsoil]		
2		SP- SM			SAND WITH SILT AND GRAVEL, some large cobbles; ~5-10% fines; e; non-cohesive; non-plastic; moist; some boulders present. [Glacial Drift]		
	GB		4.	Sample at 4': 8% Fines	22		
		SM	5.	non-plastic; damp; cemented	dium to fine gravel; ~20-30% fines; gray; dense to very dense; low cohesion; and blocky; refusal on rock. [Glacial Till]		
71 12				SANDSTONE BEDROCK; ta	n; very dense. [Chuckanut Formation (Padden Member)] Bottom of test pit at 5.5 feet.		
GENERAL BH / TP / WELL - GIN I S ID US LAB.GDI - 2/26/21 12:03 - C.\USERS\RCOP 0							

Element Solutions 909 Squalicum Way, Suite 111 Bellingham, WA 98225

TEST PIT NUMBER TP25 PAGE 1 OF 1

V		Tele Fax	ephone : (360)	: (360) 671-9172 671-4685			
CLIE	CLIENT Ann C Jones, Family LP					PROJECT NAME Edgemoor Property	
PRO.	JECT NUI	MBER	20200)94		PROJECT LOCATION Viewcrest Road, Bellingham, WA	
DATE	STARTE	D _7/	1/20	COMPLETE	D 7/1/20	GROUND ELEVATION 332' NAVD 88 TEST PIT SIZE 15 sqft	
EXC	AVATION	CONT	RACTO	Ryan Bradley		GROUND WATER LEVELS:	
EXC	XCAVATION METHOD Yanmar compact excavator OGGED BY RC CHECKED BY JG					AT TIME OF EXCAVATION	
	_						
NOTI	ES No gr	roundv	vater or	free water seepage ob	served.	AFTER EXCAVATION	
-2020.GPJ O DEPTH O (ft)	SAMPLE	U.S.C.S.	GRAPHIC LOG			MATERIAL DESCRIPTION	
LOGS 6-30 7-1-		OL	17 7 17 17 7 17 17 7 17	, ,	SILT; dark brown;	soft; cohesive, non-plastic; moist; root material present. [Topsoil]	331.2
MENTS/BENTLEY/GINTYPROJECTS/JONES-EDGEMOOR_TESTPIT.	- - - GB	SP		(SP) POORLY-	np to moist; transiti	5% fines; yellowish brown; medium dense to very dense; non-cohesive; ons to weathering rind before refusal on rock. [Eluvium]	328.0
GENERAL BH / TP / WELL - GINT STD US LAB.GDT - 2/26/21 12:03 - C:\USERS\RCOOPER\DOCUMENTS\BENTLE\G\GNT\PROJECTS\UONES-EDGE\MONE_TESTPIT_LOGS_6-30_7-1-2020.GFU O			12 (2 - 2 - 2 - 2 - 2 - 2 - 2 - 2 - 2 - 2		3EDROCK; tan; ver	y dense. [Chuckanut Formation (Padden Member)] Bottom of test pit at 4.0 feet.	328.0

Element Solutions 909 Squalicum Way, Suite 111 Bellingham, WA 98225

TEST PIT NUMBER TP26 PAGE 1 OF 1

	Telephone: (36 Fax: (360) 671-			
CLIENT Ann C	Jones, Family L		PROJECT NAME _Edgemoor Property	
PROJECT NUM	BER 2020094		PROJECT LOCATION Viewcrest Road, Bellingham, WA	
DATE STARTE	D _7/1/20	COMPLETED _7/1/20	GROUND ELEVATION 340' NAVD 88 TEST PIT SIZE _15 sqft	
	CONTRACTOR _			
EXCAVATION N	 ∕∕IETHOD Yanma	ar compact excavator		
LOGGED BY _F		CHECKED BY JG		
		water seepage observed.		
O DEPTH (ft)	U.S.C.S. GRAPHIC LOG		MATERIAL DESCRIPTION	
	OL 1/2 34 1/2 0.5	(OL) ORGANIC SILT; dark brown	n; soft; cohesive, non-plastic; moist; root material present. [Topsoil]	
	OL 1/2 1/2/10.5			339.5
	SP	(SP) POORLY-GRADED SAND; very dense ~3.5'; non-cohesive; rock. [Eluvium]	<5% fines; yellowish brown; loose to medium dense becoming dense to non-plastic; damp to moist; transitions to weathering rind before refusal on	
	4.0	SANDSTONE BEDROCK: tan: v	very dense. [Chuckanut Formation (Padden Member)]	336.0
			Bottom of test pit at 4.0 feet.	
:				



July 16, 2020

Job Number: 20-0587

Job Name: Jones-Edgemoor Estates

Client: Element Solutions

Address: Whatcom County, WA

As requested, GeoTest Services, Inc. performed materials testing services at our Bellingham, WA laboratory for the project noted above. The testing was performed in accordance with the applicable ASTM/AASHTO test methods. Please see the attached laboratory reports and summary of the test results listed in the chart below:

Sample Number: 1166

Test(s) Performed:	Pass / Fail	Comments:
Sieve - ASTM C136/C117	N/A	
Hydrometer - ASTM D422	N/A	


We appreciate the opportunity to be of service to you on this project. If you have any questions regarding the results of the test(s) performed, methods used, or require any other assistance, please don't hesitate to contact the undersigned.

Sincerely,


David Bufalini, Supervising Lab Technician


daveb@geotest-inc.com


360.410.8170 (c)

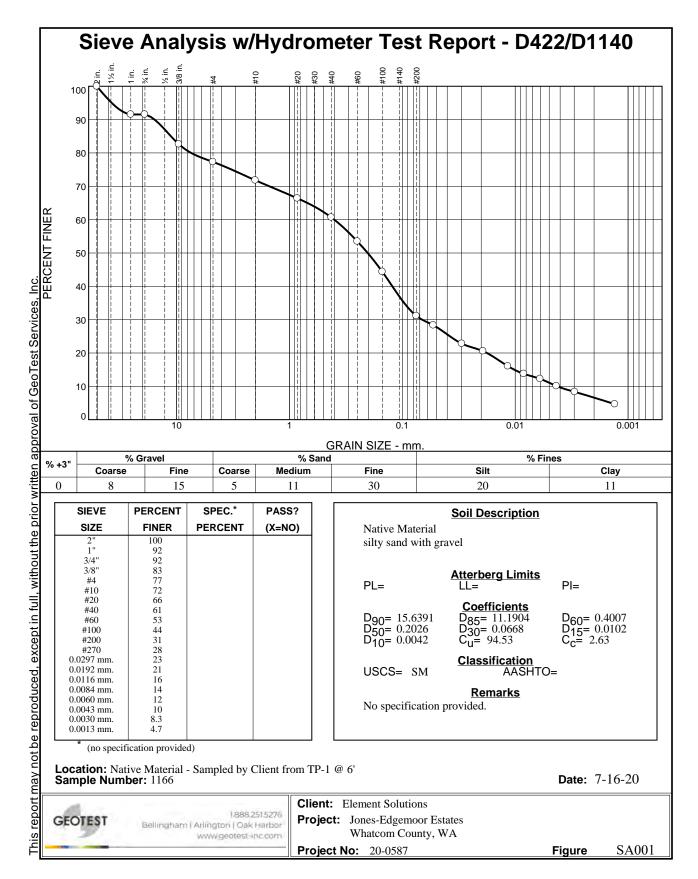


Tested By: DK Checked By: DB

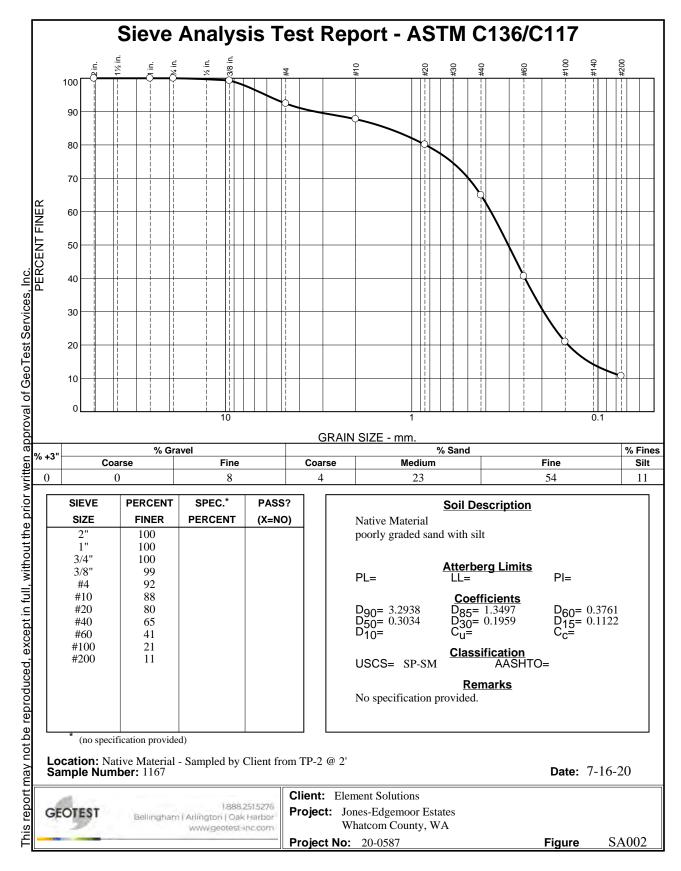

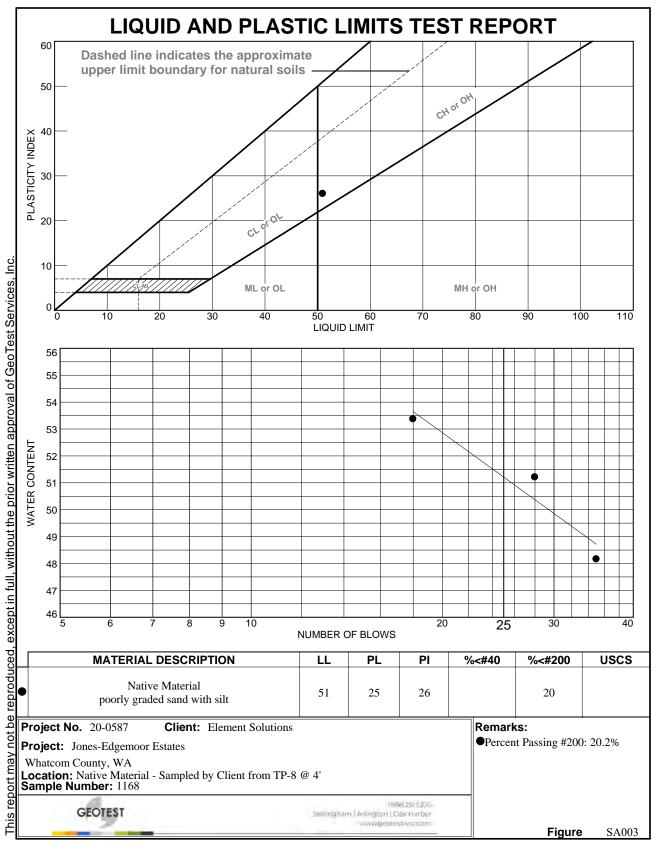

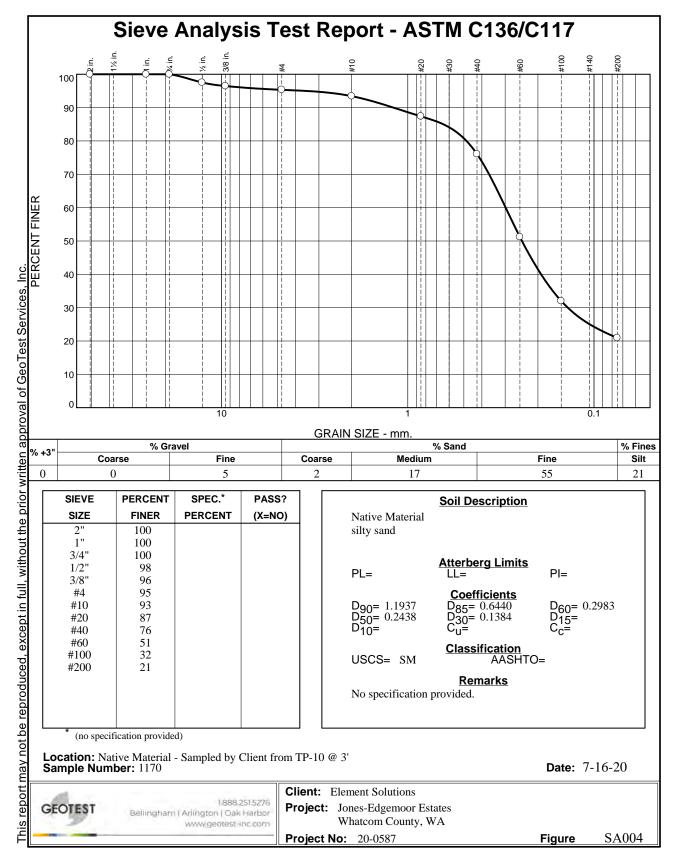

Tested By: DK Checked By: DB

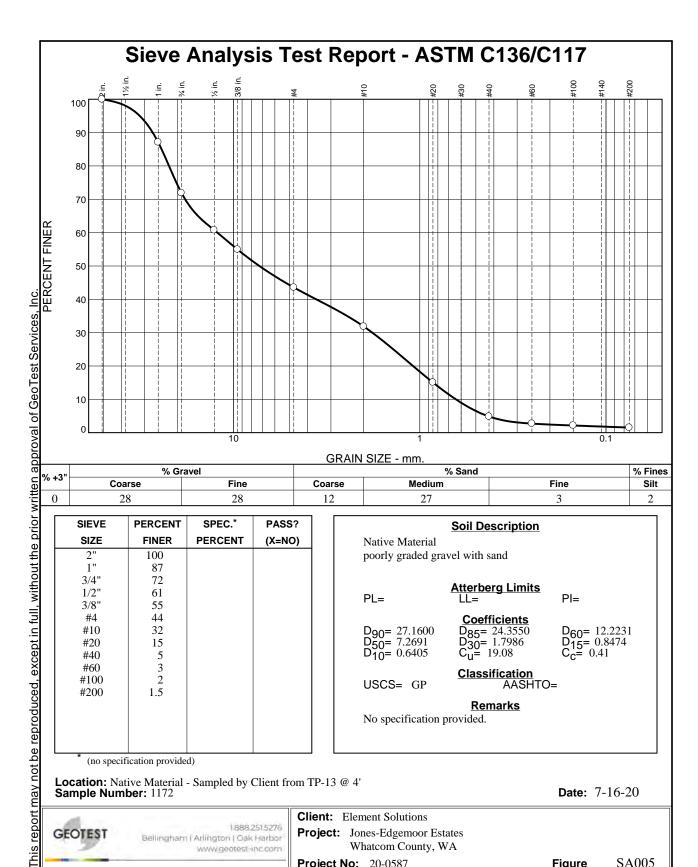

Location: Native Material - Sampled by Client from TP-13 @ 4' Sample Number: 1172

1.888.251.5276 GEOTEST Bellingham | Arlington | Oak Harbor www.geotest-inc.com

Tested By: DK

Client: Element Solutions Project: Jones-Edgemoor Estates Whatcom County, WA


Date: 7-16-20

Figure


SA005

Project No: 20-0587

Checked By: DB

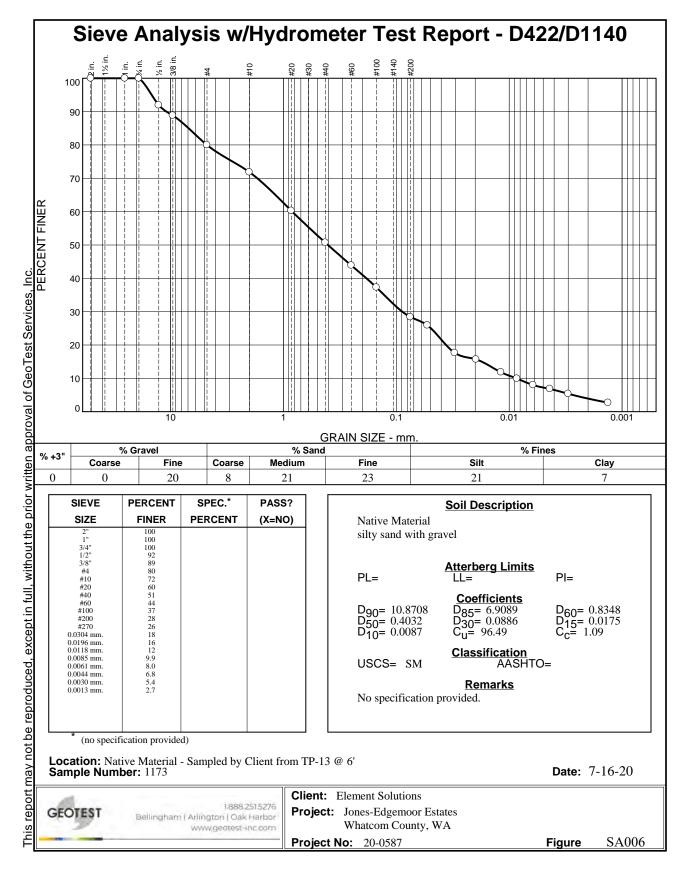

Tested By: DK Checked By: DB

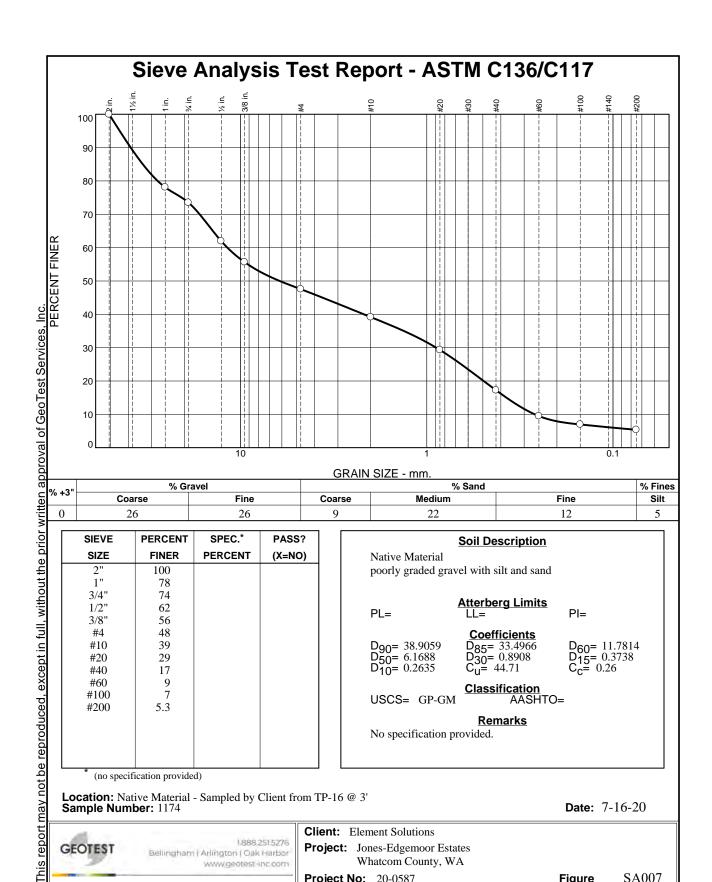

Location: Native Material - Sampled by Client from TP-16 @ 3' Sample Number: 1174


Date: 7-16-20 **Client:** Element Solutions


1.888.251.5276 GEOTEST Bellingham | Arlington | Oak Harbor www.geotest-inc.com

(no specification provided)

Project: Jones-Edgemoor Estates Whatcom County, WA

SA007 **Project No: 20-0587 Figure**

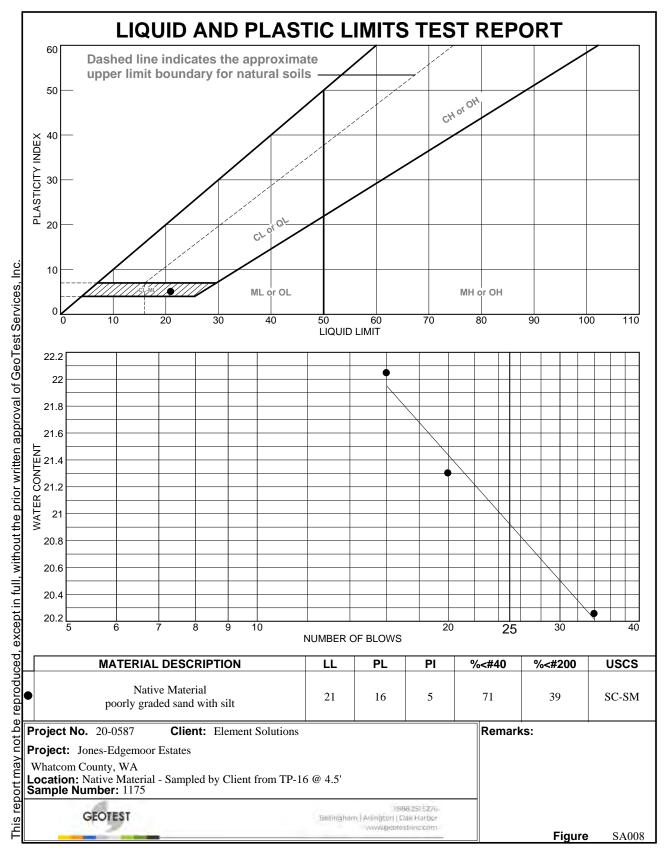

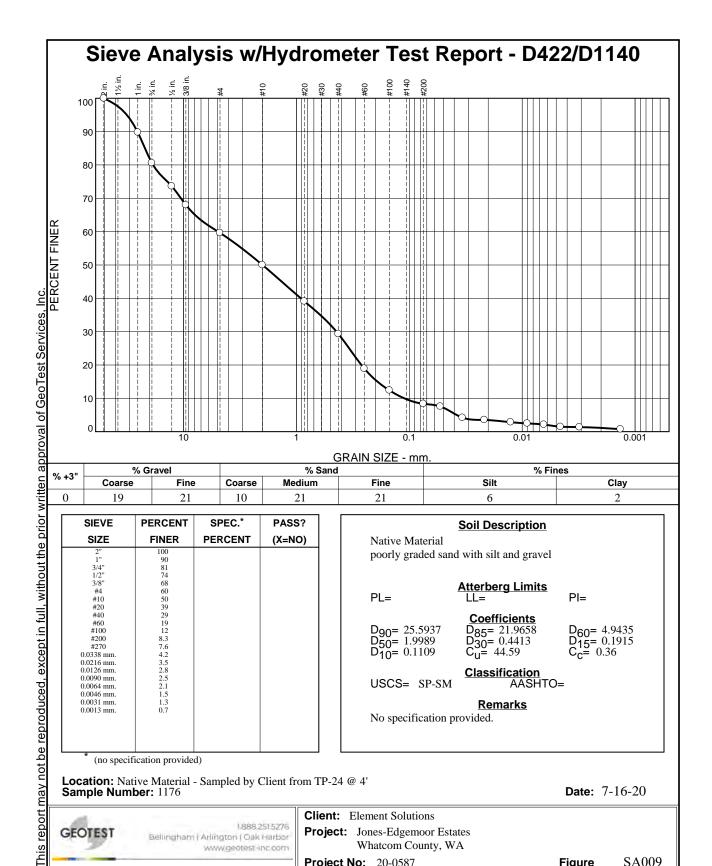

Project No: 20-0587

SA009

Figure

20-0587



PERCENT PASSING #200

PROJECT: Jones-Edgemoor Estates JOB #: ADDRESS: Whatcom County, WA REPORT #: MR001

PERMIT #: 7-16-2020 DATE:

CLIENT: **Element Solutions** PAGE #: 1 of 1

CONTRACTOR: N/A LAB #: 1169, 1171, 1177

Material Use: **Native Material**

Specification: N/A

Laboratory Test Data:

GeoTest Lab #	Source	Test Reference	% Passing #200
1169	TP-9 @ 4'	ASTM C117	22.1
1171	TP-12 @ 3'	ASTM C117	27.8
1177	TP-25 @ 2.5'	ASTM C117	2.34

Comments:

Copies: Element Solutions

This report shall not be reproduced except in full, without the written approval of GeoTest Services, Inc. (2-15-11)



2545 W Falls Avenue Kennewick, WA 99336 509.783.7450 www.nwag.com lab@nwag.com Element Solutions 1812 Cornwall Ave. Bellingham, WA 98225



Report: 52022-1-1 **Date:** July 21, 2020 **Project No:** 2020094

Project Name: Jones Edgemoor Estate

Sample ID	Organic Matter	Cation Exchange Capacity
TP-1 @ 6.0'	1.77%	11.6 meq/100g
TP-13 @ 4.0'	1.50%	3.9 meq/100g
TP-24 @ 4.0'	1.44%	6.2 meq/100g
Method	ASTM D2974	EPA 9081



Photo 1: TP1 Subsurface; Fill over Glacial Drift and Till



Photo 2: TP2; Excavated Boulder



Photo 3: TP5; Redox Staining in Shallow Soil



Photo 4: TP8 Location; Excavated Glacial Drift



Photo 5: TP9; Oxidized Soil Horizon



Photo 6: TP13; Thick Organic over Glacial Outwash and Dense Till



Photo 7: TP15; Thick Organic over Glacial Outwash




Photo 8: TP17; Dense Glacial Till at Base of Pit



Photo 9: TP23; Glacial Drift over Dense Till




Photo 10: TP25; Sandy Eluvium Over Dense Sandstone Bedrock

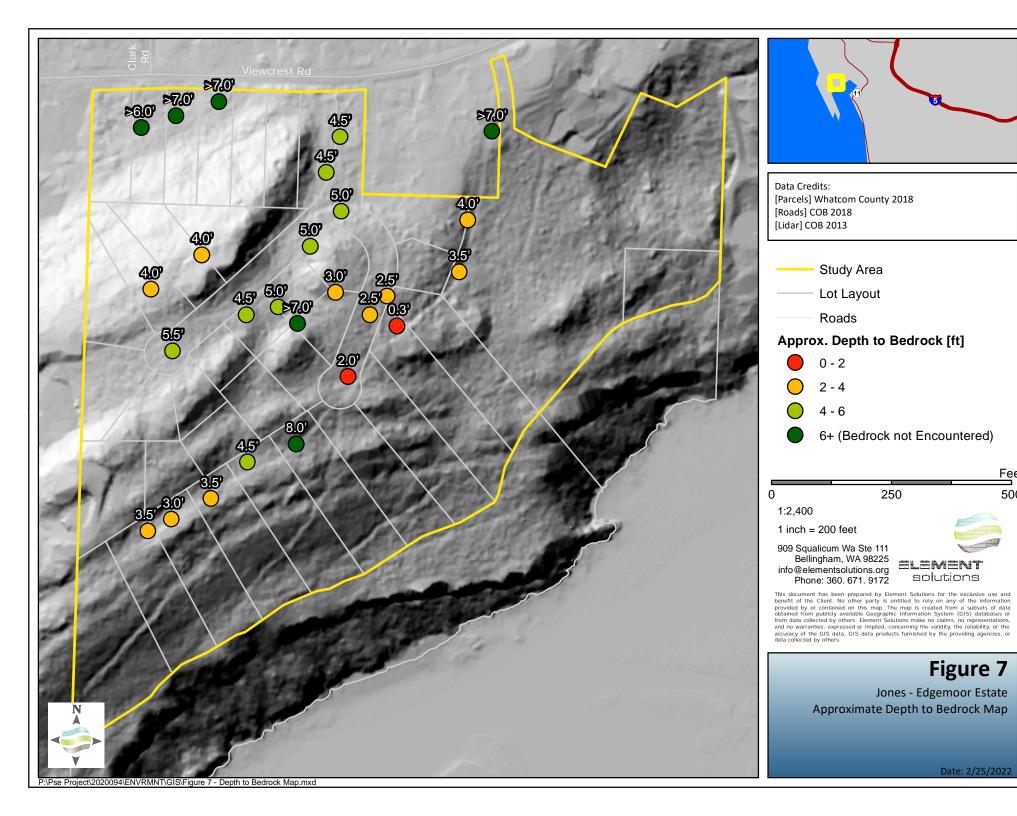

Feet

500

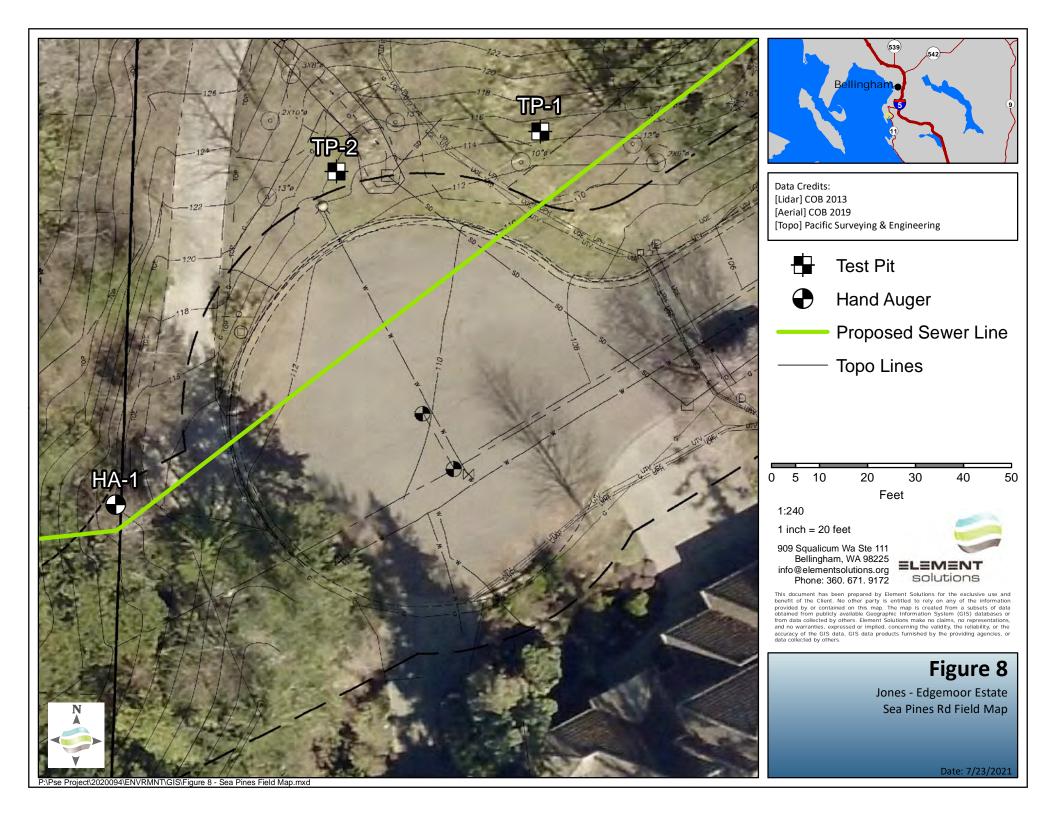



BORING NUMBER HA-1

PAGE 1 OF 1

CLIENT Ann C Jones,	Family LP	PROJECT NAME _Edgemoor Property	
PROJECT NUMBER _20	020094	PROJECT LOCATION 315 Sea Pines Road, Bellingham, WA	
DATE STARTED 11/13	3/20 COMPLETED 11/13/20	GROUND ELEVATION 117' NAVD 88 HOLE SIZE 1.5 sqft	
DRILLING CONTRACTO	DR N/A	GROUND WATER LEVELS:	
DRILLING METHOD H	and auger	AT TIME OF DRILLING	
LOGGED BY RC	CHECKED BY JG	AT END OF DRILLING	
NOTES No groundwate	er or free water seepage observed.	AFTER DRILLING	
0.0	POO	MATERIAL DESCRIPTION	
OL (31/1)	$\overset{2}{\overset{\Lambda}{\bigcirc}}_{0.2}$ (OL) ORGANIC SILT, mixed with san	nd; dark brown; soft; cohesive, non-plastic; moist. [Topsoil]	116.8
SM		0-20% fines; orange brown to tan; medium dense to dense; dry; transitions to weathering rind before refusal on rock. [Reworked	116.0
	SANDSTONE BEDROCK; orange bro Formation (Padden Member)]	own to tan; very dense; medium to fine grained. [Chuckanut	110.0

BORING WAS ADVANCED HORIZONTALLY INTO THE SLOPE.

Bottom of borehole at 1.0 feet.

GENERAL BH / TP / WELL - GINT STD US LAB. GDT - 2/26/21 12:09 - C:\USERS\RCOOPER\DOCUMENTS\BENTLEY\GINT\PROJECTS\UONES-SEA, PINES_TESTPIT_LOGS_11-13-2020.GPJ



BORING NUMBER HA-2 PAGE 1 OF 1

	Telephone: (360) Fax: (360) 671-4) 671-9172 685		
CLIENT Ann C	Jones, Family LP		PROJECT NAME Edgemoor Property	
PROJECT NUM	BER _2020094		PROJECT LOCATION 315 Sea Pines Road, Bellingham, WA	
DATE STARTED	1 11/13/20	COMPLETED _11/13/20	GROUND ELEVATION 110' NAVD 88 HOLE SIZE 1.5 sqft	
DRILLING CON	TRACTOR N/A		GROUND WATER LEVELS:	
DRILLING METI	HOD <u>Hand auger</u>		AT TIME OF DRILLING	-
LOGGED BY _F	RC	CHECKED BY _JG	AT END OF DRILLING	
NOTES No gro	oundwater or free v	water seepage observed.	AFTER DRILLING	
O DEPTH (ft) (ft) SAMPLE	U.S.C.S. GRAPHIC LOG		MATERIAL DESCRIPTION	
	OF 37.6 3	(OL) ORGANIC SILT; dark brown	; soft; cohesive, non-plastic; moist; root material present. [Topsoil]	100.1
2.5	SM	brown; medium dense; low to mod	ravel, and occasional cobbles; ~20-40% fines; grayish brown to orange derate cohesion; non-plastic; moist to damp; small amount of orange rounded and mostly fine; fines increase with depth. [Glacial Drift]	109.4
	4.2		Detterm of horseles at 4.0 feet	105.8
			Bottom of borehole at 4.2 feet.	

Element Solutions 909 Squalicum Way, Suite 111 Bellingham, WA 98225 Telephone: (360) 671-9172 Fax: (360) 671-4685

TEST PIT NUMBER TP-1

PAGE 1 OF 1

	_		` '	0) 07 1-4000				
	IT Ann C							
	ECT NUN							
DATE	STARTE	D <u>11</u>	/13/20	COMPLETED 11/13/20 GROUND ELEVATION 115' NAVD	88 TEST PIT SIZE 15 sqft			
EXCA	VATION	CONT	RACT	TOR Kyle Lukes GROUND WATER LEVELS:				
EXCA	VATION I	METH	OD _E	Excavator/back hoe AT TIME OF EXCAVATION				
LOGG	ED BY _	RC		CHECKED BY JG AT END OF EXCAVATION	<u>-</u>			
NOTE	S Seepa	age ol	oserve	ed between ~2.5'-3.5' bgs. AFTER EXCAVATION				
DEPTH (ft)	SAMPLE	U.S.C.S.	GRAPHIC LOG	MATERIAL DESCRIPTION				
0.0			1 <u>1</u>	(OL) ODCANIC CILT: ded brown active abosing your plantic mainty and market	otorial process (Tanasil)			
IES-SEA_PINES_TESTPIT_LOGS_11-13-2		OL		(OL) ORGANIC SILT; dark brown; soft; cohesive, non-plastic; moist; root m				
NOPER/DOCUMENTS/BENTLEY/GINT/PROJECTS/JON		SC- SM		(SC-SM) SILTY CLAYEY SAND, some gravel and cobbles; ~30-50% fines; lenses are gray with orange mottling; medium dense; cohesive; low-plastici observed between approximately 2.5'-3.5' bgs from the north, west, and sor fine grained; cobbles and gravel are sub-rounded to rounded. [Glacial Drift]	ty; moist to wet, seepage uth pit walls; sand is medium to			
GENERAL BH / TP / WELL - GINT STD US LAB.GDT - 2/26/21 12:09 - C:\USERSIRCOOPER\DOCUMENTS\BENTLEY\GINT\PROJECTS\JONES-SEA_PINES_TESTPIT_LOGS_11-13-2020.GPJ C		SM		4.0 (SM) SILTY SAND, some fine gravel and cobbles; ~20-40% fines; gray to cohesive; non-plastic; damp; small amount of orange mottling; sand is med sub-rounded to rounded and mostly fine; bedrock visible at 5.5' bgs on sout refusal on rock. [Glacial Drift]	ium to fine grained; gravel is			
RAL			1. 4 · 1 /	SANDSTONE BEDROCK; dark gray to black; very dense; medium to fine g				
SE NE				(Padden Member)] Bottom of test pit at 6.8 feet.				

Element Solutions 909 Squalicum Way, Suite 111 Bellingham, WA 98225 Telephone: (360) 671-9172

TEST PIT NUMBER TP-2 PAGE 1 OF 1

		Fax: (3	360) 671-4	1) 671-9172 4685		
CLIENT	Ann C		Family Li		PROJECT NAME Edgemoor Property	
PROJEC	T NUME	BER _2	020094		PROJECT LOCATION _315 Sea Pines Road, Bellingham, WA	
DATE ST	TARTED	11/13	3/20	COMPLETED _11/13/20	GROUND ELEVATION 116' NAVD 88 TEST PIT SIZE 15 sqft	
EXCAVA	ATION C	ONTRA	ACTOR K	Kyle Lukes	GROUND WATER LEVELS:	
EXCAVA	ATION M	ETHOD	Excava	ator/back hoe	AT TIME OF EXCAVATION	
LOGGED	OGGED BY RC CHECKED BY JG			CHECKED BY JG	AT END OF EXCAVATION	
NOTES	Seepa	ge obse	erved betw	veen ~1.2'-2.5' bgs on N & E pit walls.	AFTER EXCAVATION	
O DEPTH O (ft)	SAMPLE		907	(OL) ODGANIG CII T. dorlo braviro	MATERIAL DESCRIPTION	
2			71 1/V	(OL) ORGANIC SILT; dark brown; so	off; cohesive, non-plastic; moist; root material present. [Topsoil]	
			0.5			115.5
2.5		SC SSM	6.1	loose to medium dense; cohesive; lo seepage observed between ~1.2'-3.0 amount of orange mottling throughou rounded; some caving around 4'-5' of	ne gravel and cobbles; ~30-50% fines; orange brown to gray brown; w-plasticity; moist to wet, partially saturated in upper region of unit, by bgs on northern (upland) and eastern pit walls; low to moderate at sand is medium to fine; cobbles and gravel are sub-rounded to a south (downslope) wall of pit. [Glacial Drift]	109.9
		SM	6.0	cemented and blocky; refusal in hard	orange mottling; gravel is sub-rounded to rounded and mostly fine; lpan till. [Glcial Till]	400.4
		<u> [3]</u>	6.6		Bottom of test pit at 6.6 feet.	109.4
į						



Photo 1: TP1



Photo 3: TP2 Seepage from North Pit-Wall



Photo 5: TP2 Location & Site Restoration



Photo 2: TP1 Location



Photo 4: TP2 Caving on South Pit-Wall



Photo 6: HA-1 Location

Appendix III

- 1) Figure 9 Project Overview LiDAR Map with Shading and Geologic Hazard Areas Annotated
- 2) Exhibit C Field Photos of Geohazard Slope Features and Rock Exposures
- Figure 10a Stereonet of Bedrock Structures Northwest Hill Cliff Face
 Figure 10b Stereonet of Bedrock Structures West-Central Rock Outcrops

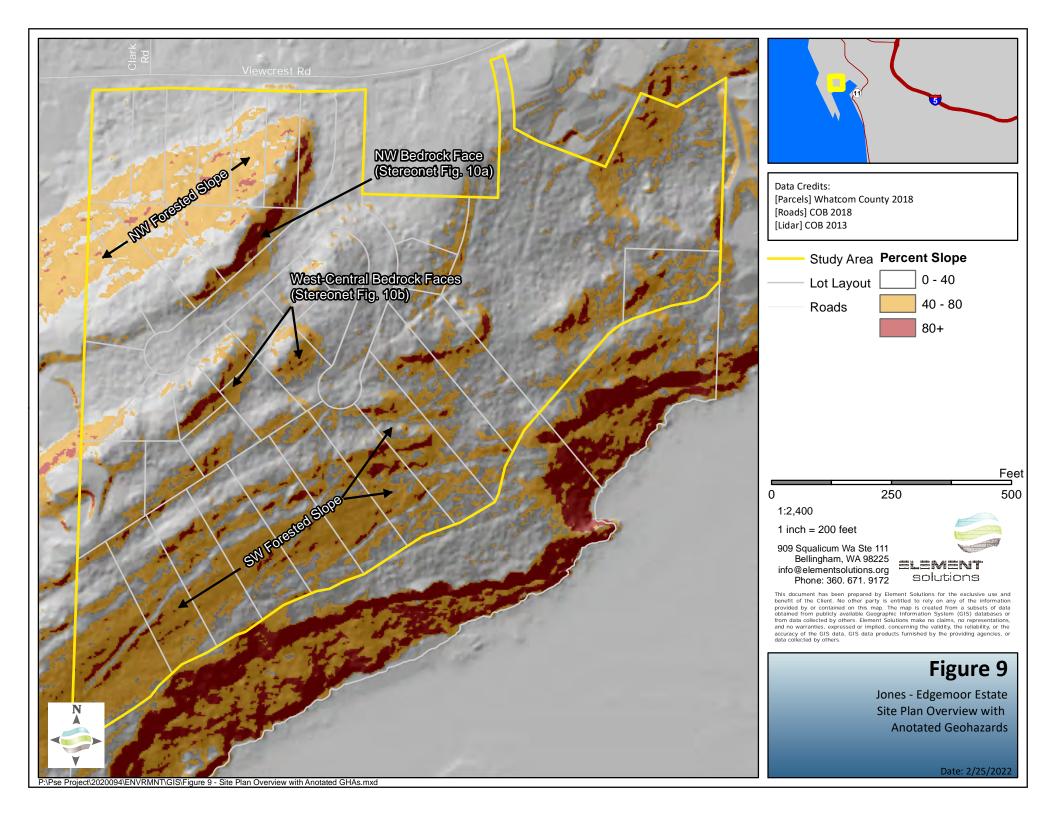




Photo 1: Northern Part of NW Bedrock Face



Photo 3: Northern Part of NW Bedrock Face



Photo 5: NW Forested Slope



Photo 2: Southern Part of NW Bedrock Face



Photo 4: Northern Part of NW Bedrock Face



Photo 6: Central Area of NW Bedrock Face



Photo 7: West-Central Bedrock Faces; West Outcrop




Photo 8: West-Central Bedrock Faces; West Outcrop




Photo 9: West-Central Bedrock Faces; West Outcrop, Northern Slope Area



Photo 10: Conglomerate Bedrock Exposure; SW Project Area

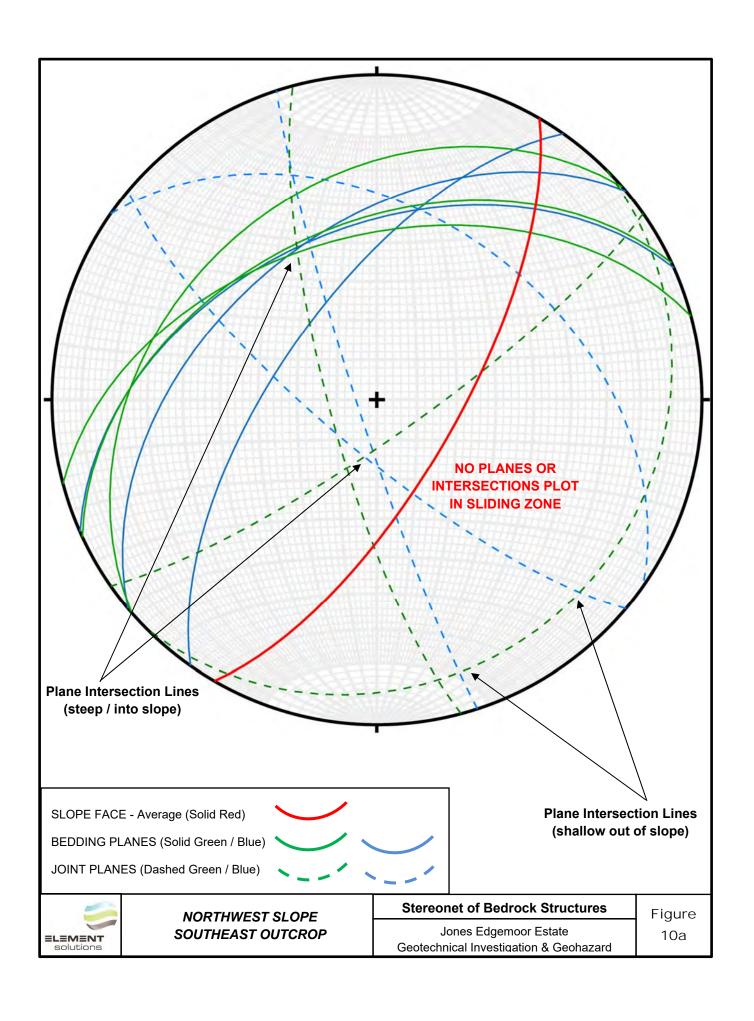

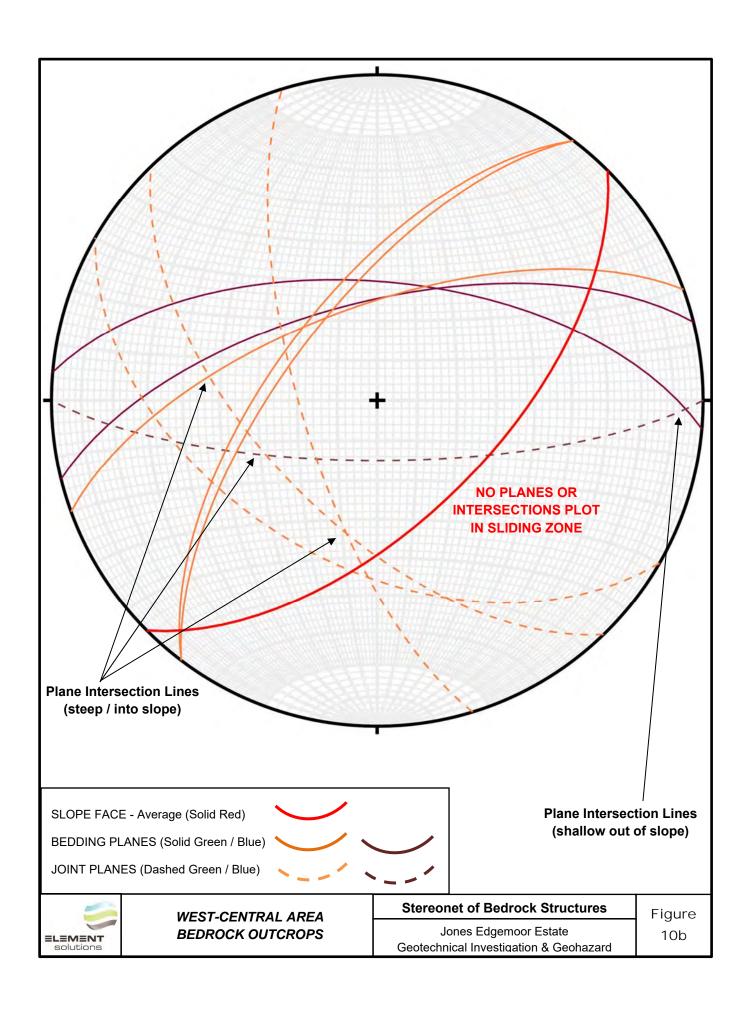



GEOLOGIC FEASIBILITY INVESTIGATION FOR THE ANN JONES FAMILY REPRESENTATIVES CHUCKANUT BAY PROPERTY

DECEMBER 31, 2009

EXECUTIVE SUMMARY

The Ann Jones LP family representatives retained Pacific Surveying and Engineering to perform a reconnaissance-level geologic investigation of the subject property located at the north end of Chuckanut Bay to identify the feasibility of potential future development of the property. The investigation included collection and limited evaluation of existing information, meeting with the City of Bellingham Critical Areas Ordinance regulatory official, brief field inspection, and presentation of findings and recommendations in a summary report. In summary, the subject property contains areas with steep topography and development will have to consider site-specific engineering designs and mitigative measures for portions of the property.

In its current condition, the site infiltrates most of the precipitation it receives and there is little offsite movement of surface water. No evidence of surface water was observed in the west and central portion of the site, however minor surfacing of ground water via seeps was observed in the eastern portion of the site. It is hypothesized that groundwater migrates roughly perpendicular to the primary southward slope by moving laterally in the eastward direction along subsurface geologic structures. A time lapse created by the distance groundwater must travel before day-lighting likely attenuates peak discharges of surface water following high precipitation events, thus the observed seeps likely discharge at fairly uniform rates throughout the wet season. Surface water was only observed organizing into stream flow in two locations on site, one of which was modified by recent development off of Sea Pines Drive, the other occurred where groundwater was day-lighted by a recently uprooted tree. Future development of the site could impact the current hydrologic condition. Existing residential development located near the northeast corner of the subject property has likely increased the presence of surface water on site immediately downhill of those developments. Changes in hydrology can alter the probability, frequency and magnitude of mass wasting (landslide) activity.

Possible evidence of historic mass wasting (landslide) activity was also observed at the eastern portion of the property, whereas the steep slopes along the southeastern portion of the property did not show obvious signs of historic slope instability or movements with the exception of rock falls adjacent to cliff outcrops and minimal slope creep.

Following a development plan, additional and more detailed geotechnical evaluation for specific designs and locations will be needed. Geotechnical investigations will need to assess erosion, landslide potential, and seismic hazards and subsurface conditions. Future development may potentially impact slope stability and surface erosion.

Site Description

The study area is an amalgamation of several properties that are owned by various members of the Ann Jones family adjacent to Chuckanut Bay (Figure 1). The site is currently undeveloped and forested primarily with a wide variety of second growth timber, shrubs and herbaceous plant species, but Douglas Fir, Big Leaf Maple, Red Alder and Western Red Cedar dominate the tree canopy. Air photos indicate that the most of the site was logged in the late 1960's to mid-1970's. It is possible that a quarry existed east of the topographic high point of the property but this was not verified. No other historic uses of the property are known, however pre-historic uses by native peoples have been documented. Residential development adjacent to the project site has occurred over the past century, significantly so in the past two decades.

The site is located on a landform consisting of Paleocene aged Chuckanut Formation (TKc) bedrock outcrops that have been folded, uplifted and eroded (Easterbrook, 1976; Figures 2 & 3). Chuckanut Formation geology consists of sandstone, conglomerate, shales, and locally sub-bituminous coals. Pleistocene glacial advances impacted the project area by causing erosion and mantling portions of the site with sediment. Holocene activity at the site has been dominated by development of soils, while erosion and mass wasting at the site are interpreted to be minor. Soils present at the site include: Chuckanut loam (Unit 26), Everett-Urban land complex (Unit 52), and Nati loam (Unit 110) (NRCS 2009, Figure 4).

The site has considerable variations in topography and includes flat, low to moderate sloping terrain, steep terrain and cliffs (Figure 5). The site topography has been locally altered or modified by historic road building, timber harvest activities, and adjacent residential development (primarily unconsolidated fill and debris piling). The majority of the site drains to Chuckanut Bay, however the northwest portion of the site drains toward Bellingham Bay.

Geologic Hazards Defined

Landslide Hazard

Landslide hazard areas are defined by the Washington Administrative Code (WAC) and the City of Bellingham Critical Areas Ordinance (CAO) as those areas potentially subject to risk of mass movement due to a combination of geologic, topographic, and hydrologic factors. Specific landslide designations relevant to the subject site, as defined by the WAC and CAO, include:

- 1. Areas with all three of the following characteristics:
 - Slopes steeper than 15 percent; and

- Hillsides intersecting geologic contacts with a relatively permeable sediment overlying a relatively impermeable sediment or bedrock; and
- Springs or ground water seepage.
- 2. Any area with a slope of forty percent or steeper and with a vertical relief of ten or more feet except areas composed of consolidated rock
- 3. Slopes parallel or subparallel to planes of weakness in subsurface materials
- 4. Areas depicted as landslide hazards by the City folio maps. Portions of the site have been identified has having High Landslide Potential (Fox et al, 1991) in that they have slopes greater than 30%, slopes exceeding 80%, and slopes greater than 15% that may be potentially unstable because of other factors (Figure 6).

The characteristics and frequency of landslides are dependent on several variables, including soil type, permeability and depth, slope, groundwater conditions, seismic occurrence, disturbances, and other factors. Several categories of landslides are possible at the subject site. These include: slides (rotational and translational), flows (debris flow, earth flow, mud flow, rock flow), falls and topples (Varnes, 1978)

Common in the Pacific Northwest on steep slopes are episodic earth slides (shallow-rapid slides) where a precipitation event is the dominant trigger mechanism. Typically, shallow-rapid mass wasting events occurs within the weathered soils or colluvial sediment that over lay relatively low-permeability soils or bedrock. In certain conditions, dense glacial sediments can experience mass wasting such as earth flows or earth slumps on steeper slopes and the potential for these types of events is exacerbated by groundwater. Soil creep is also common on steep slopes.

Bedrock stability is based on bedding and jointing within the rock. Chuckanut Formation sandstone can weather very quickly to soil or can be interbedded with less competent rock (e.g. shales) and is also commonly jointed and therefore susceptible to rock fall and topples.

Erosion Hazard

Erosion hazard areas are defined by the CAO as those areas containing soils which, according to the United States Department of Agriculture Soil Conservation Service Soil Classification System, may experience severe to very severe erosion. Erosion hazard potential can be increased during the clearing and earthwork phase of construction when disturbed soils are exposed to weather, disturbance and traffic.

The National Resources Conservation Service Soil Survey of Whatcom County soils map indicates that the site soils have a low to high hazard of water erosion, but have moderate to severe erosion hazard during excavations. Soils with higher percentages of fines have a higher susceptibility to erosion in the disturbed state, particularly on steeper slopes.

Seismic Hazard

Seismic hazard areas are defined by the CAO as those areas subject to severe risk of damage as a result of earthquake induced ground shaking, slope failure, settlement, or soil liquefaction. Seismic induced slope failure and rock fall are possible at the site. Settlement and liquefaction risks are likely low.

The Puget Sound region is seismically active as documented by the Pacific Region Seismic Network. Several significant earthquakes have been historically experienced in the project vicinity, including the 1872 North Cascades event and the 1906 Rosario Strait event. Recent discovery of Holocene fault surface ruptures near Kendall and Glacier also demonstrate the presence of significant seismic events. There are no known faults mapped at the site.

Field Observations

The reconnaissance-level field investigation occurred on December 4th, 2009 and was conducted by Paul Pittman of PSE who was accompanied by Elizabeth Binney of Pacific Ecological Consultants. The fieldwork included traverses of portions of the project area to observe geology, topography, geomorphology, surface water expressions, and evidence of erosion and mass wasting.

The site was observed to consist of ridge or cliff forming units of Chuckanut Formation Sandstone, locally overlain with glacial deposits that included numerous granitic erratics and was very dense and compact and interpreted to be till. Locally thick soil horizons (approximately 1-foot) were also encountered at several locations at the site where low gradient topography or topographic swales between parallel bedrock outcrops occurred. Field observations suggest that the soils on the project site have a relatively low susceptibility to erosion in an undisturbed state because of dense vegetation, but that alteration of these conditions could significantly increase the erosion potential.

Areas of slopes greater than 40 percent were observed on site. Much of the southern portion of the property and other local areas qualifies as having potential landslide hazard (Figure 5). In addition to steep topography, several vertical or near vertical bedrock cliffs were observed across the site. The bedding of the Chuckanut Formation dips approximately 40 degrees toward the north. Where the slopes face southerly, this means that the bedding dips into the slope. Where the

slopes face northerly (the ridge crest in the northwest portion of the site), dip slopes may occur, however none were observed exposed due to soil formation or glacial sediment mantling. Jointing of the Chuckanut Formation is common and evidence of topples and falls were observed at many of the cliff forming outcrops. No evidence of massive rotational or translational slope stability failures were observed during the field reconnaissance with the exception of a possible earth slump located at the eastern property margin (Figure 7). The interpretation of a possible earth slump is supported by the topographic expression (steep, arcuate scarps above a hummocky bench flanked by abrupt lateral topographic ridges perpendicular to bedrock ridges) and the presence of numerous seeps in converging topography. Additional analysis would be needed to confirm this hypothesis.

No historic evidence of mass wasting at the site were observed in the photo record (1963, 1975, 1988, 1997, 1998, 2002, 2004, and 2008). In summary, the steep slopes of the site appeared to exhibit historic stability, with the exception of rock fall/topple, and even evidence of soil creep was minimal.

Development on or above steep slopes could impact slope stability by changing surface or groundwater flow on the slopes. In addition, risk of landslides could be impacted by construction near or on steep slopes because of grading disturbance or additional load application from structures such as buildings, road fill embankments, topographic alterations or retaining walls.

In its current condition, the site infiltrates most of the precipitation it receives and there is little offsite movement of surface water. No evidence of surface water was observed in the west and central portion of the site, however minor surfacing of ground water via seeps was observed in the eastern portion of the site (Figure 7). It is hypothesized that groundwater migrates roughly perpendicular to the primary southward slope by moving laterally in the eastward direction by following subsurface geologic structures. A time lapse created by the distance groundwater must travel before day-lighting likely attenuates peak discharges of surface water following high precipitation events, thus the observed seeps likely discharge at fairly uniform rates throughout the wet season. Surface water was only observed organizing into stream flow in two locations on site, one of which was modified by recent development off of Sea Pines Drive, the other occurred where groundwater was day-lighted by a recently uprooted tree. Existing residential development located near the northeast corner of the subject property has likely increased the presence of surface water on site immediately downhill of those developments and a survey conducted by Leonard, Boudinot & Skodje (LBS, 2004) showed a drain from an adjacent property owner discharging water on site. This drain, and at least one other were observed at the northeast corner of the site. numerous trees in the area where seeps and possible slope instability were observed have been cut down. The removal of these trees can negatively impact both the hydrology and slope stability at that location.

Currently the site is well vegetated and the potential for erosion is low since most water arriving to the ground is infiltrated. However, the soil has significant fines such that it is considered susceptible to erosion when disturbed on slopes. A total of eight Test Plots across the site were collected and documented by Elizabeth Binney on December 4th and her assessments will be included within her wetland report. Grading (cuts into native soil, and placement of fill soils with slope geometries) increases the potential for erosion exists during construction and until the site has healed. Additionally, interception, changes in soil permeability (compaction) or development that interrupts or causes the surfacing of groundwater can alter the site hydrology that may increase erosion and landslide hazard potential.

Conclusions

In summary, geologic hazards at the site exist and include landslide, erosion and seismic hazards. Development of the property will likely include regulations imposed by the City of Bellingham's Critical Areas Ordinance. It is noted that those regulations are scheduled for an update in 2012. Depending upon the scale of the development, a SEPA checklist may also need to be submitted. It is also noted that the Shorelines Jurisdiction extends 200 feet horizontally landward from the line of Mean Higher High Water (MHHW).

Some types of development could impact the site hydrology and thus affect the landslide and erosion hazard potential. Because of the step slopes and existing groundwater conditions, modifications of groundwater or surface water flow may impact the potential size and frequency of mass wasting events. The fine-grained soils found on site are susceptible to soil erosion resulting from the movement of heavy equipment or site grading. As these plans are developed, the geologic hazards will need to be assessed in light of the proposed changes. For planning level conceptualizations, design considerations should include managing surface and ground water changes and impacts, steep topography and cliffs, excavation of bedrock, over excavation of soils, and construction/disturbance related erosion.

There are portions of the site where development may be technically possible, but the engineering, mitigation and assessment needs will dramatically increase the investment for that development. These areas likely include slopes steeper than 40%, cliffs, areas where seepage or possible landslides exist, and areas within the Shorelines Jurisdiction. Any future significant development proposal will likely trigger requirement of a full geotechnical assessment as evidenced by similar sites and projects in this vicinity.

Recommendations

Once a design concept or plan is formalized for the site, we recommend the following additional geotechnical information be collected:

- extensive review of geotechnical assessments for areas adjacent to the proposed project site;
- exploration and detailed mapping of surfaces, outcrops, and slopes in area of proposed development(s);
- subsurface exploration and characterization in proposed roadway/utility corridors; and
- slope or hazard setback staking.

This report was submitted by:

Pacific Surveying and Engineering

Paul D. Pittman, L.E.G. Environmental Services Manager



Statement of Limitations

This document has been prepared by Pacific Surveying and Engineering Services, Inc. (PSE) for the exclusive use and benefit of the Ann Jones and her family representatives. No other party is entitled to rely on any of the conclusions, data, opinions, or any other information contained in this document.

This document represents PSE's best professional judgment based on the information available at the time of its completion and as appropriate for the project scope of work. Services performed in developing the content of this document have been conducted in a manner consistent with that level and skill ordinarily exercised by members of the geologic engineering profession currently practicing under similar conditions. No warranty, expressed or implied, is made.

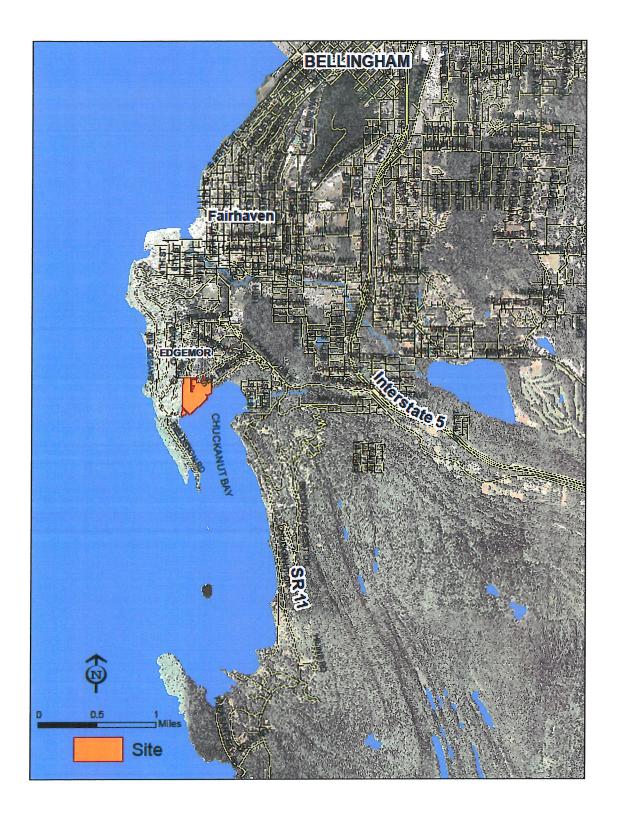


FIGURE 1: Vicinity map

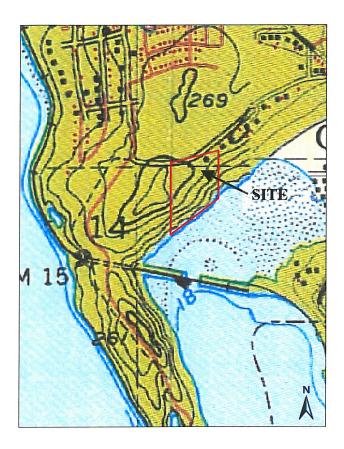


FIGURE 2: The geology of the site is mapped as Chuckanut Formation (TKc) (Easterbrook 1976). Numerous outcrops of sandstone were at the site. The more resistant and massive beds often form substantial cliffs throughout the site. Bedding strike was roughly N80E (260 degrees) and dipped to the north at approximately 40 degrees. The site is located near or within the hinge of a large anticline that plunges to the northwest (See Figure 3).

The site was also affected by Pleistocene glaciations and deposits of till and drift mantle much of the site. Thickness of the glacial deposits appear to vary from several inches to possibly several feet. Holocene soils were observed to have developed and can be quite thick (over 1.5 feet observed) locally, especially in the swales occurring between resistant bedrock ridges.

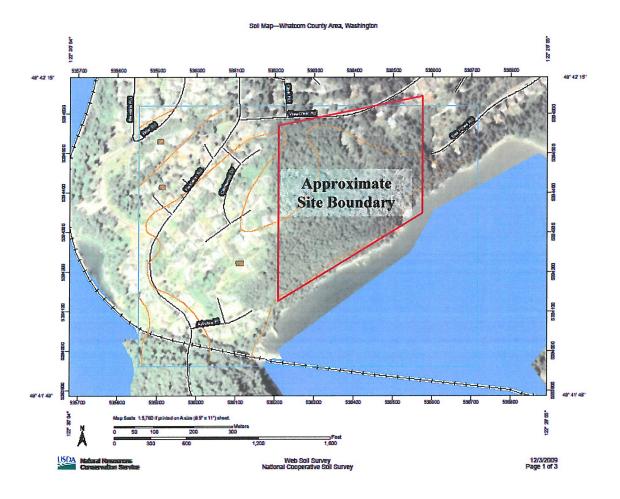


FIGURE 4: Natural Resources Conservation Services Soil Map Study (from Web Soil Survey, Version 6, Sep 22, 2009). Units present at the site include Nati Loam (Unit 110), Chuckanut Loam (Unit 26), and Everett-Urban Land Complex (Unit 52).

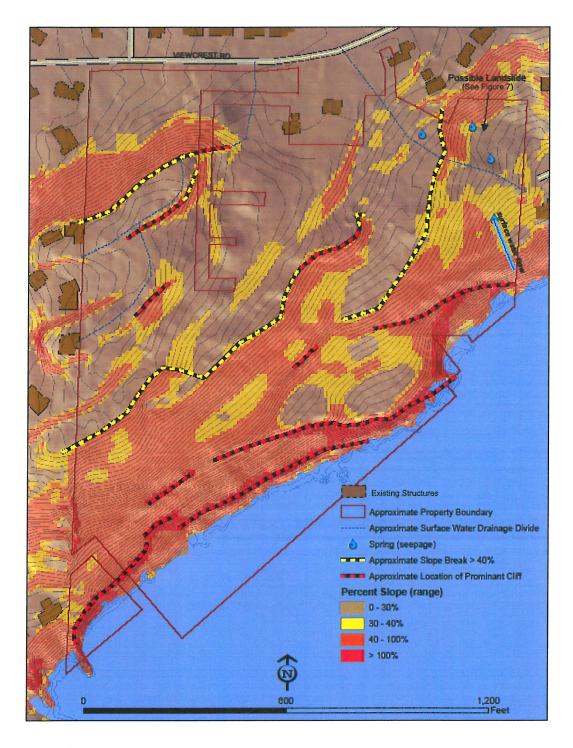


FIGURE 5: Slope assessment. Contours (5-foot interval) and Percent-Slope raster were generated from 2004 photogrammetry (City of Bellingham). The reconnaissance-level field investigation was conducted December 4th, 2009. The reference to the possible landslide is discussed in the Figure 7.

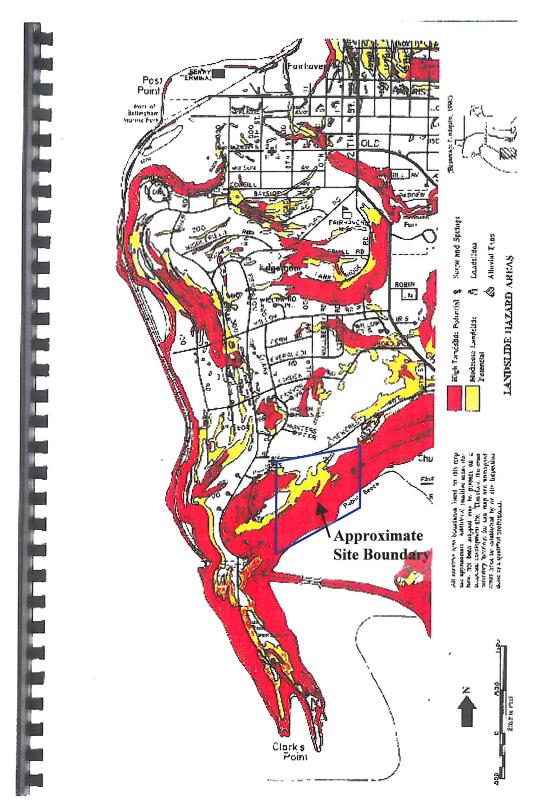


FIGURE 6: Fox et al 1991 "Geologic Hazards Area; Map Folio"

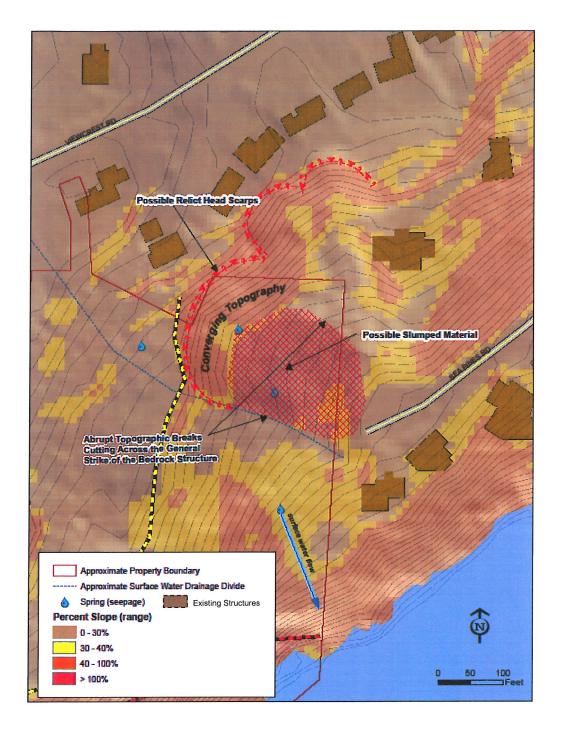


FIGURE 7: Geomorphology and field indicators suggest that this might be a relict earth-flow or slump-type landslide. Additional studies are recommended for this location if development was proposed on or adjacent to this landform.

PHOTOS: By P. Pittman taken December 4th, 2009



Photo looking uphill at a Chuckanut Formation sandstone bedrock outcrop creating a vertical cliff face approximately 10 feet in height.



Photo of a bedrock cliff showing evidence of "toppling" of blocks that failed along jointing planes. The blocks did not travel beyond 20 feet down-slope from the outcrop from which they originated.



Photo showing a location in which minor soil creep was observed on slopes nearing 100%. In general, the site exhibited few locations with evidence of soil creep. The location of this photo is just above the beach 300 feet southwest of the southeast property corner.



Photo documenting the source of seepage that developed into stream flow for a distance of approximately 160 feet before being infiltrated. This water source did not reach the beach as surface water. The seepage started in a shallow depression created by tip up of an approximately 24-inch diameter Western Red Cedar.

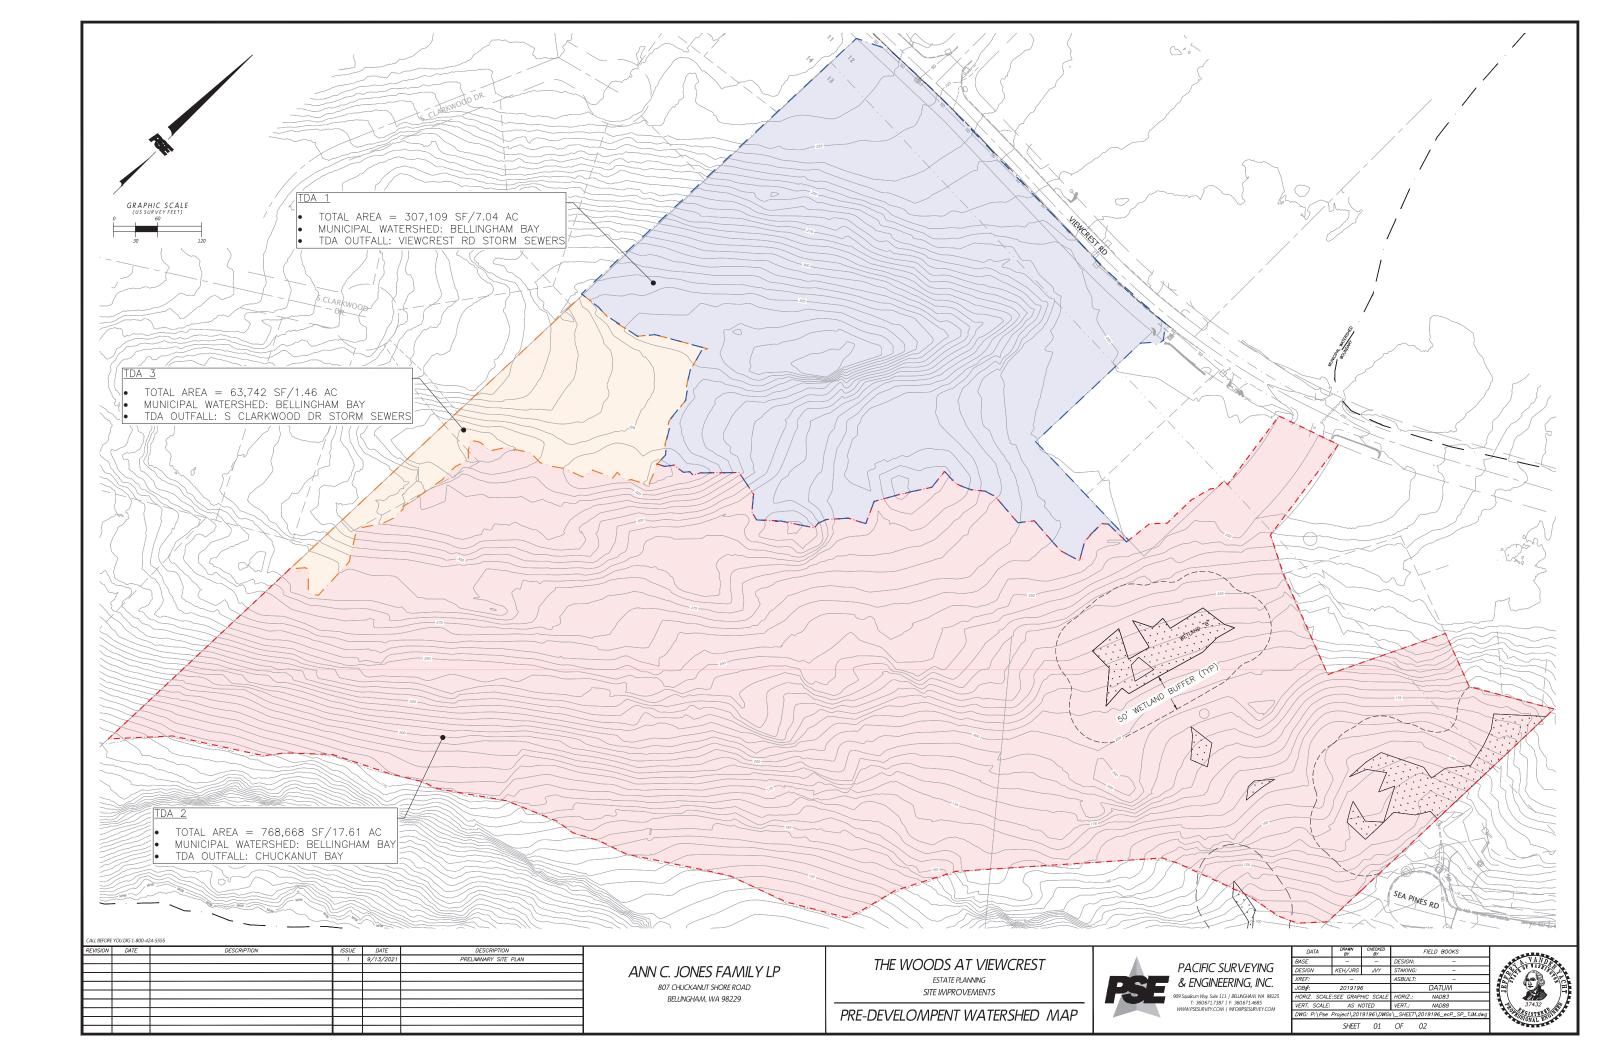



Photo looking down-slope across the topographic "bench" occurring below a steep "arcuate" topographic feature. Seepage was abundant in this location and the site was inhabited with small diameter alder, horsetail, and blackberry. This landform may be a slump or earthflow feature. Felling of trees occurred at this site likely in the past year or two.



Photo looking up the steeper arcuate topography that may be a scarp formed from downward movement of the mass shown in the previous image (See Figure 7).

8.4 BASIN MAP



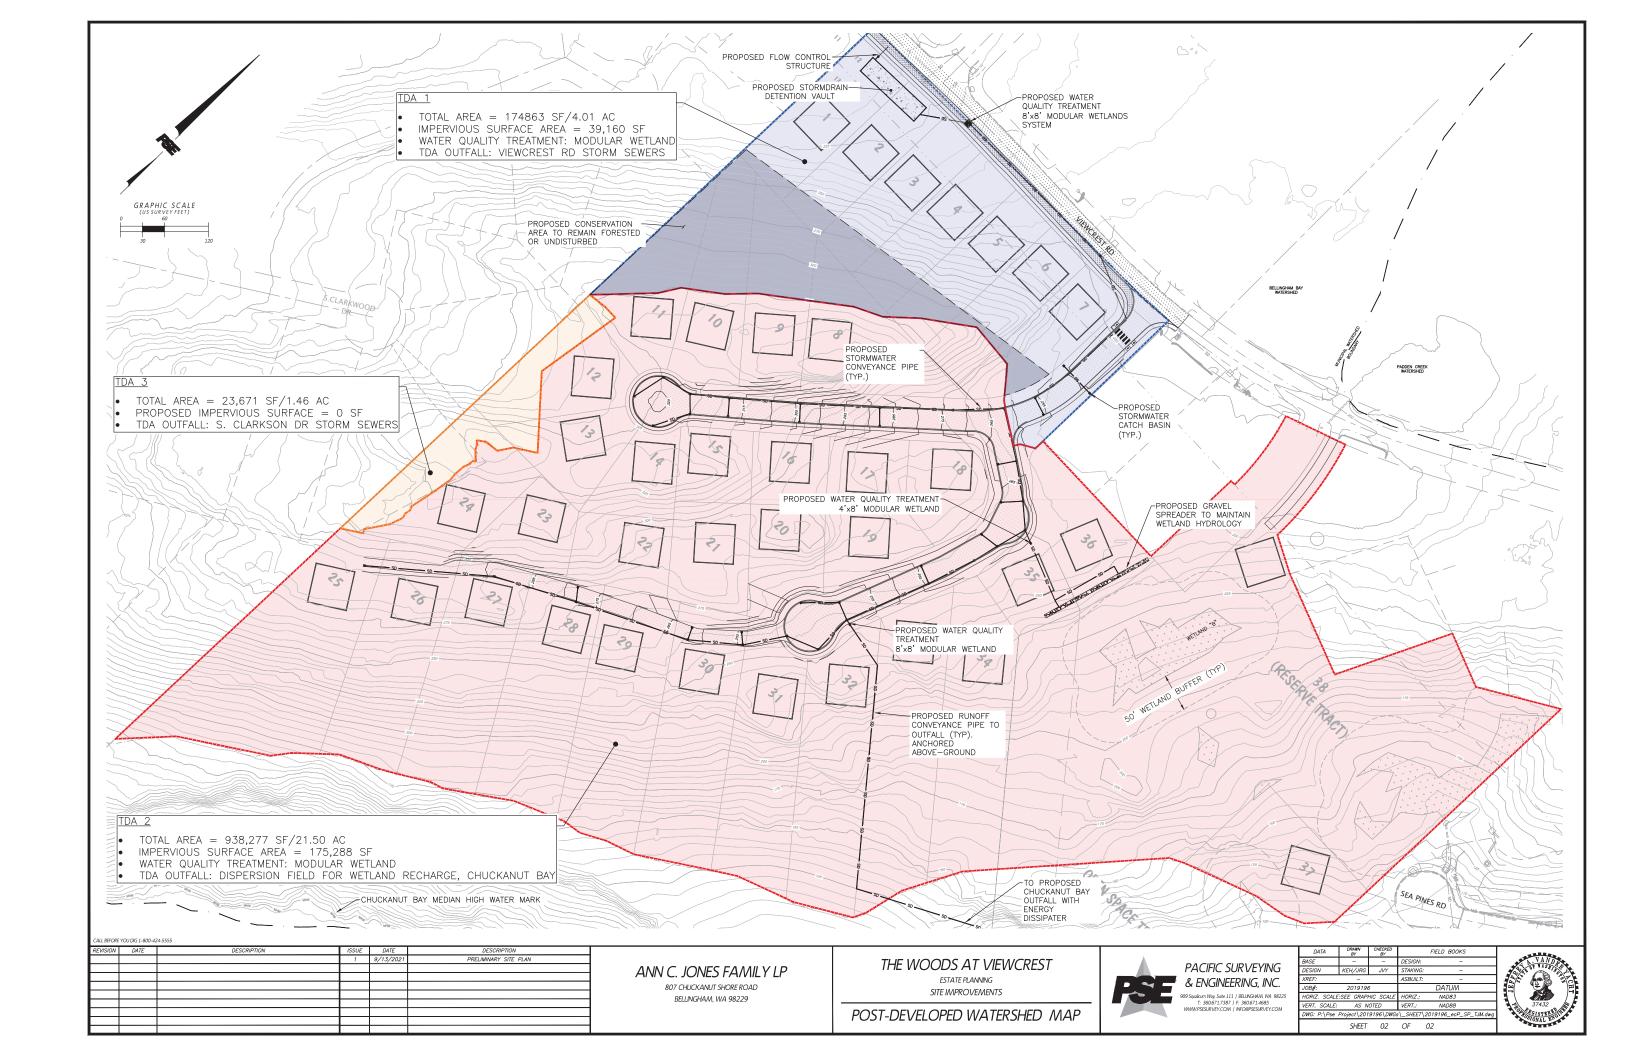

8.5 DRAWINGS

THE WOODS AT VIEWCREST PRELIMINARY PLAT

NTS

BRIZA CT

FAIRHAVEN AVE

RAINIER AVE

SITE

PROJECT

SOUTH

1500

1300

BROAD

S COLLEGE

LAKE SAMISH RD

RIDGE

500 Z

600

/ 4

EVERGLADE

B.N.

LINDEN RD

CHUCKANUT BAY

CLARK'S POINT

WILLOW CT S

BROAD ST

CHUCKABUT BAY

TEDD KBEAR COVE

ROBIN LN

LEGAL DESCRIPTION:

LOT B, AS DELINEATED ON ROGAN JONES 2 SHORT PLAT, ACCORDING TO THE SHORT PLAT RECORDED APRIL 10, 1992, UNDER AUDITOR'S FILE NO. 920410201, RECORDS OF WHATCOM COUNTY, WASHINGTON; EXCEPT THAT PORTION LYING WITHIN THE BOUNDARIES OF THE TRACT OF LAND DESCRIBED IN DEED TO DARRELL G. KAPP, ET UX., RECORDED JUNE 15, 1973, UNDER AUDITOR'S FILE NO. 1140332.

SITUATE IN WHATCOM COUNTY, WASHINGTON.

PARCEL 2:

THE EAST 750 FEET OF THE NORTH 700 FEET OF GOVERNMENT LOT 1, SECTION 13, TOWNSHIP 37 NORTH, RANGE 2 EAST W.M.; EXCEPT LOT 3, BLOCK 16, AMENDED MAP OF SOUTH FAIRHAVEN, IN THE CITY OF FAIRHAVEN, WASHINGTON, ACCORDING TO THE PLAT THEREOF, RECORDED IN VOLUME 4 OF PLATS, PAGE 49, AND THAT PORTION OF QUINALT STREET ON THE NORTH AND THAT PORTION OF THE VACATED ALLEY ON THE SOUTH WHICH INURED TO SAID LOT 3 UPON THE VACATION THEREOF; FURTHER EXCEPT THAT PORTION LYING WITHIN ROGAN JONES 2 SHORT PLAT RECORDED UNDER AUDITOR'S FILE NO. 920410201;

FURTHER EXCEPT THAT PORTION DECRIBED IN DEEDS TO THE CITY OF BELLINGHAM, RECORDED UNDER AUDITOR'S FILE NO. 1136193, TO DARRELL G. KAPP AND SUSAN KAPP; RECORDED UNDER AUDITOR'S FILE NO. 1140332, TO LARRY DUTTON AND LINDA DUTTON; RECORDED UNDER AUDITOR'S FILE NO. 1190072; AND TO PATRICIA A. FARIS, RECORDED UNDER AUDITOR'S FILE NO. 1245873; FURTHER EXCEPT 40-FOOT WIDE CHUCKANUT AVENUE AS SHOWN ON THE PLAT OF ROGAN JONES 2 SHORT PLAT.

SITUATE IN WHATCOM COUNTY, WASHINGTON.

THAT PORTION OF THE OSUTHWEST QUARTER OF THE SOUTHWEST QUARTER OF SECTION 12, TOWNSHOP 37 NORTH, RANGE 2 EAST, W.M., LYING SOUTH OF VIEWCREST ROAD AND WEST OF THE WEST LINE OF THAT CERTAIN TRACT OF LAND DESCRIBED IN DEED TO PATRICIA A. FARIS, RECORDED MARCH 23, 1977, UNDER AUDITOR'S FILE NO. 1245873.

SITUATE IN WHATCOM COUNTY, WASHINGTON.

PARCEL 4:

LOTS, BLOCKS, VACATED STREETS AND ALLEYS IN THE AMENDED MAP OF SOUTH FAIRHAVEN, IN THE CITY OF FAIRHAVEN, WASHINGTON, ACCORDING TO THE PLAT THEREOF, RECORDED IN VOLUME 4 OF PLATS, PAGE 49, DESCRIBED AS FOLLOWS:

BLOCKS 2, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 16 AND 17; ALL OF BLOCKS 3, EXCEPT LOT 1 AND LOT 2; TOGETHER WITH ALL ALLEYS IN THE ABOVE—DESCRIBED BLOCKS VACATED BY RESOLUTION OF THE CITY COUNCIL OF BELLINGHAM, WASHINGTON, RECORDED JULY 19. 1912, UNDER AUDITOR'S FILE NO. 159473, AND ALL STREETS AND PARTS OF STREETS VACATED BY THE SAID RESOLUTION, EXCEPT THE SOUTHEASTERLY HALF OF CHUCKANUT AVENUE ABUTTING ON LOTS 1 AND 2, BLOCK 3.

FURTHER EXCEPT THE EAST 750 FEET OF THE NORTH 700 FEET OF GOVERNMENT LOT 1, SECTION 13, TOWNSHIP 37 NORTH, RANGE 2 EAST, W.M.

FURTHER EXCEPT THAT PORTION, IF ANY, LYING WITHIN LOTS OR BLOCKS 113, 114 AND 115, FAIRHAVEN TIDELANDS, OWNED BY THE CITY OF BELLINGHAM.

SITUATE IN WHATCOM COUNTY, WASHINGTON.

PLAT AND CONSULTANT DATA:

LOCATION: PROPERTY LIES WITHIN THE EDGEMOOR NEIGHBORHOOD OF BELLINGHAM, WA APPROXIMATELY 1.5 MILES WEST OF I-5

ANN JONES FAMILY LP, ELIZABETH ANN JONES, SUSAN HANNEN JONES, AND ROGAN KINGSBURY JONES

PACIFIC SURVEYING & ENGINEERING, INC. JEFF VANDERYACHT, PE 909 SQUALICUM WAY, SUITE 111 BELLINGHAM, WA 98225

SURVEYOR: PACIFIC SURVEYING & ENGINEERING, INC. ADAM MORROW, PLS 909 SQUALICUM WAY, SUITE 111

PERMITTING CONSULTANT: AVT CONSULTING 1708 F STREET BELLINGHAM, WA 98225 (360) 527-9445

BELLINGHAM, WA 98225 (360) 671-7387

WETLANDS BIOLOGIST: NORTHWEST ECOLOGICAL SERVICES COLLIN VAN SLYKE. PWS 2801 MERIDIAN ST BELLINGHAM, WA 98225 (360) 734-9484

HABITAT BIOLOGIST: RAEDEKE ASSOCIATES, INC. AND REW ROSSI, B.S. 2111 N. NORTHGATE AVE STE 219 SEATTLE, WA 98103 (206) 525-8122

ELEMENT SOLUTIONS JOHN GILLASPY, LEG 909 SQUALICUM WAY, SUITE 111 BELLINGHAM, WA 98225 (360) 671-9172

GEOTECHNICAL:

ARCHAEOLOGIST: DRAYTON ARCHAEOLOGY GARTH L. BALDWIN, M.A. PO BOX 782 BLAINE, WA 98231 (360) 739-3921

(425) 889-6747

TRAFFIC ENGINEER: TRANSPORTATION ENGINEERING NORTHWEST JEFF HAYNIE. P.E. 11400 SE 8TH STREET, SUITE 200 BELLEVUE, WA 98004


ZONING: ED GEMOOR NEIGHBORHOOD AREA 7 (RESIDENTIAL SINGLE)

MINIMUM LOT SIZE: 10,021 SF AVERAGE LOT SIZE: 21,413 SF (NOT INCLUDING RESERVE TRACT) NUMBER OF LOTS: 38 (INCLUDING RESERVE TRACT)

TOTAL UPLAND PROPERTY AREA: 34.01 AC

ROAD RIGHT OF WAY AREA: 76,489 SF

CALL BEFORE YOU DIG 1-800-424-5555

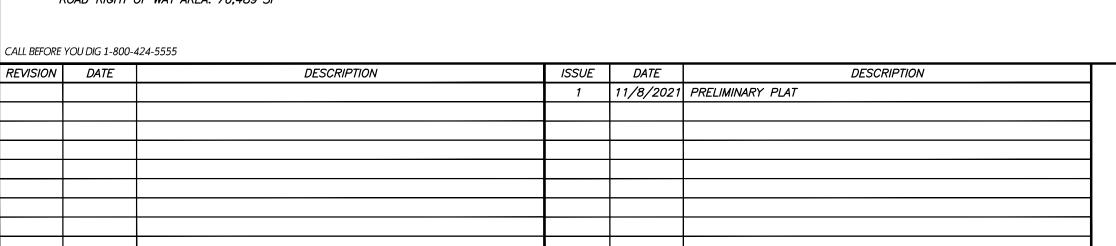

ANNE C. JONES FAMILY LP

807 CHUCKANUT SHORE ROAD BELLINGHAM, WA 98229

THE WOODS AT VIEWCREST

FOR ANNE C. JONES FAMILY LP 807 CHUCKANUT SHORE ROAD BELLINGHAM. WA 98229

SITUATE IN A PORTION OF THE SW 1/4 OF THE SW 1/4 OF SECTION 12, AND THE NW 1/4 OF THE NW 1/4 OF SECTION 13, TOWNSHIP 37 NORTH, RANGE 2 EAST, CITY OF BELLINGHAM, WHATCOM COUNTY, WASHINGTON

PACIFIC SURVEYING & ENGINEERING, INC. 909 Squalicum Way, Suite 111 | BELLINGHAM, WA 982 T: 360.671.7387 | F: 360.671.4685 WWW.PSESURVEY.COM | INFO@PSESURVEY.COM

PROJECT

LOCATION

DATA	DRAWN BY	CHECKED BY		FIELD BOOKS	
BASE	TJM	ASM	DESIGN:	XXX	
DESIGN			STAKING:		
XREF:	N/A		ASBUILT:		
DWG: 20191	96_svX_PR	PEPLAT.dwg		DATUM	
HORIZ. SCALE	.: N _/	⁄A		DATON	
VERT. SCALE:	N _/	⁄A	HORIZ.:	N/A	
JOB#:	201919	5	VERT.:	N/A	
	SHEET	1	OF	7	



	= EXISTING EDGE OF ASPHALT
	= EXISTING EDGE OF CONCRETE
	= EXISTING EDGE OF GRAVEL ROAD
	= EXISTING CURB
	= EXISTING SIDEWALK
	= EXISTING EDGE OF MASONRY PAVERS
=======	= EXISTING STORM CULVERT
SD	= EXISTING STORM DRAIN LINE
———— SS ————	= EXISTING SANITARY SEWER GRAVITY LINE
w	= EXISTING WATER LINE
OHE	= EXISTING OVERHEAD ELECTRIC LINES
OHE/OCM	= EXISTING OVERHEAD ELECTRIC & COMMUNICATION LINES
UGE	= EXISTING UNDERGROUND POWER
OCM	= EXISTING OVERHEAD COMMUNICATIONS LINE
G	= EXISTING UNDERGROUND GAS LINE
· · TOP · ·	= EXISTING TOP OF SLOPE LINE
· · TOE · ·	= EXISTING TOE OF SLOPE LINE
120	= EXISTING GRADE INDEX CONTOUR
118	= EXISTING GRADE INTERVAL CONTOUR
·>> ·	= EXISTING FLOW LINE
	= EXISTING WETLAND LINE
	= EXISTING EDGE OF TREES
	= EXISTING EDGE OF LANDSCAPED AREA
x	= EXISTING BARBED WIRE FENCE

EXISTING FEATURE SYMBOL LEGEND

= EXISTING MONUMENT

 \bigcirc = EXISTING IRON PIPE **△** = SET REBAR & ORANGE PLASTIC CAP

■ = SET HUB AND MAG

○ = EXISTING LEAD AND TACK ⊕ = SET MAG NAIL

• = SET NAIL

= EXISTING STORM DRAIN MANHOLE

□ = EXISTING AREA DRAIN

□ = EXISTING CATCH BASIN

= EXISTING SANITARY SEWER MANHOLE

 \boxplus = EXISTING WATER METER

□ = EXISTING FIRE HYDRANT

(R) = EXISTING IRRIGATION BOX

= EXISTING BOLLARD

(STOP) = EXISTING STOP SIGN M = EXISTING MAILBOX

⊕ = EXISTING TEST HOLE

--- = EXISTING POWER POLE

-O-drp = EXISTING POWER POLE W/DROP

otin = EXISTING YARD LIGHT

= EXISTING FIBER-OPTIC/COMM. PEDESTAL/RISER

■ = EXISTING TELEPHONE PEDESTAL/RISER

= EXISTING PINE/SPRUCE TREE

= EXISTING FIR TREE # = EXISTING FRUIT TREE

• = EXISTING ALDER TREE

= EXISTING MAPLE TREE

= EXISTING BUSH

= EXISTING STUMP

15"ø = DIAMETER OF EXISTING TREE

SHEET INDEX:

SHEET 1 - LEGAL DESCRIPTION; PLAT/CONSULTANT DATA; VICINITY MAP; LINE & SYMBOL LEGEND; SHEET INDEX

SHEET 2 - EXISTING CONDITIONS MAP


SHEET 3 - PROPOSED PLAT LAYOUT

SHEET 4 - PROPOSED LOTS AND ROADS W/ EXISTING CONDITIONS SHEET 5 - PROPOSED ROADS AND STORMDRAIN PLAN

SHEET 6 - PROPOSED ROAD PROFILES

SHEET 7 - PROPOSED WATER AND SANITARY SEWER PLAN



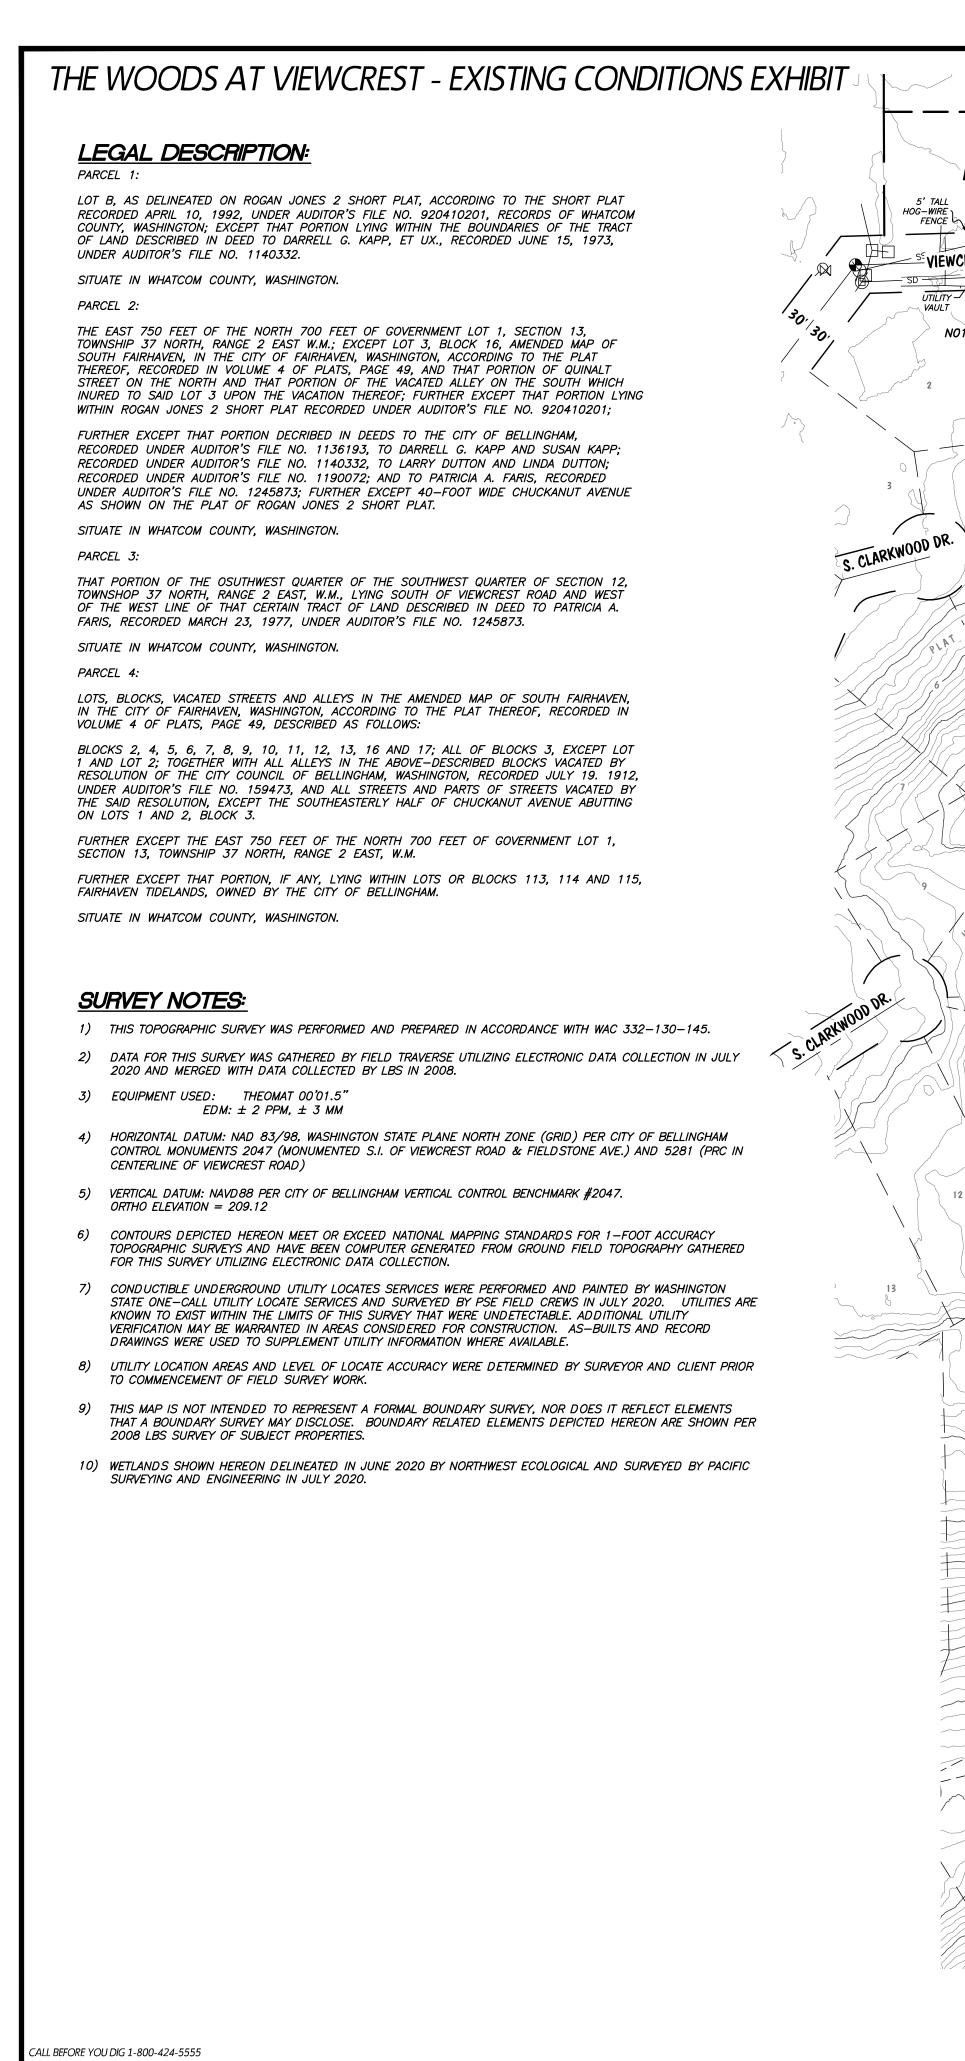

DESCRIPTION

ISSUE DATE

1 | 10/5/2021 | PRELIMINARY PLAT — EXISTING CONDITIONS EXHIBIT (FOR REVIEW)

REVISION DATE

R=1069.06' PERMISSIVE ENCROACHMENT L=140.96' LETTER DATED 05/06/2016 -*△=7°33′16″* R=460.00' L=154.92' EN88°15'07"E W L43H W N88'19'13"W 262.44' TP#370212 030004 0000 LOOSE ROCK L=117.33' ?' WIDE ELIZABETH, SUSAN, ROGAN RET. WALL $\Delta = 18^{\circ}10'06''$ & JONES FAMILY LP *47.72*′ N88*12'35"W PERMISSIVE ENCROACHMENT _N88°22'59"W 215.02' S. CLARKWOOD DR. BRION & BOURLIER - PERMISSIVE -ENCROACHMENT LETTERS DATED 04/22/2002 & 08/23/2004 TP#370213 075542 0000 ANN C. JONES FAMILY, LP FAIRHAVEN STREET (UN-IMPROVED) WETLAND 'C' 991 SF N88°12'35"W 150.00 N88°12'35"W 150.00 PERMISSIVE ENCROACHMENT BAKER ST. (UN-IMPROVED) - *115.00*' N88*12'35"W AGREEMENT PER HIGH WATER DIGITIZED FROM PUBLICLY AVAILABLE LIDAR DATA (NOT SURVEYED) GRAPHIC SCALE (US SURVEY FEET) 1 inch = 100 feet DESCRIPTION

BRICK PILLAR WITH ADDRESS

L4 \$88*14'13"W 45.33 L5 \$N1*32'07"E 67.83 L6 \$S1*47'25"W 40.00 L7 \$88*12'35"E 75.00 L8 \$S1*47'25"W 20.00 L9 \$S1*47'25"W 40.00 L10 \$N1*52'36"E 110.67 L11 \$N88*12'35"W 6.87 L12 \$N88*12'35"W 26.82 L13 \$50*17'22"W 50.00 L14 \$50*17'22"W 74.09 L15 \$N1*34'55"E 47.61 L16 \$N62*19'43"W 56.09				PARCEL OWNERSHIF	>			
### B 3702145185120000 LUDINIC & MULLINEY		TAX PARCEL	NO.	OWNERSHIP			ADDRESS	
C 3702145204950000 SCIOLTO LLC 405 S CLARKWOOD DR D 3702145214710000 FREDRIKSSON REV TRUST 415 S CLARKWOOD DR E 37021452144000000 HARRIS TRUST 417 S CLARKWOOD DR F 3702145213740000 HOLCOME FAMILY TRUST 417 ARBUTUS PL H 3702145184050000 HOLCOME FAMILY TRUST 417 ARBUTUS PL H 37021515480190000 HECHT 635 FIELDSTON RD I 3702120050150000 WAN BROCKLIN & SWIECKIKI 664 CLARK RD J 3702120280190000 DAWS 663 CLARK RD J 3702120280190000 NELSON 409 VEWCREST RD M 3702120490180000 MALKASON FAMILY TRUST 401 VEWCREST RD N 370212040030000 MALKASON FAMILY TRUST 401 VEWCREST RD J 3702120720300000 MARRINER & OWEN 355 VEWCREST RD J 3702120720300000 MARRINER & OWEN 355 VEWCREST RD J 370212072030000 MARRINER & OWEN 355 VEWCREST RD J 370212072030000 MARRINER & OWEN 355 VEWCREST RD J 3702120920100000 BEER 354 VEWCREST RD J 370212090320000 LONNER REVOCABLE TRUST 350 VEWCREST RD J 3702121400120000 LONNER REVOCABLE TRUST 350 VEWCREST RD J 3702121140120000 SUMI 340 VEWCREST RD J 3702121140120000 DAWS 338 VEWCREST RD J 3702121140120000 SUMI 340 VEWCREST RD J 3702121140030000 BEROWNE 315 SEA PINES RD J 3702121140030000 BRION REV TRUST/TR J 356 VEWCREST RD J 370212140030000 BRION REV TRUST/TR J 358 VEWCREST RD J 370212060060000 BRION REV TRUST/TR J 358 VEWCREST RD J 370212060060000 BRION REV TRUST/TR J 358 VEWCREST RD J 3702130605800000 BRION REV TRUST/TR J 368 VEWCREST RD J 3702130735780000 BOURLIER NO SITE ADDRESS J 3702130605800000 BRION REV TRUST/TR J 368 VEWCREST RD J 3702130735780000 BOURLIER NO SITE ADDRESS J 3702130735780000 BRION REV TRUST/TR J 368 VEWCREST RD J 3702130735780000 BRION REV TRUST/TR J 368 VEWCREST RD J 3702130735780000 BRION REV TRUST/TR J 368 VEWCREST RD J 3702130735780000 BRION REV TRUST/TR J 368 VEWCREST RD J 3702130735780000 BRION REV RUST/TR J 368 VEWCREST RD J 3702130735780000 BRION REV RUST/TR J 368 VEWCREST RD J 3702130735780000 BRION REV RUST/TR J 368 VEWCREST RD J 3702130735780000 BRION REV RUST/TR J 388 VEWCREST RD J 3702130735780000 BRION REV RUST/TR J 388 VEWCREST RD J 3702120800600000 BRION REV RUST/TR J 3	Α	37021451852	00000	THOMPSON		402	? VIEWCRES	T RD
D 3702145214710000 FREDRIKSSON REV TRUST	В	37021451851	20000	LUDWIG & MULLAVEY		403 S	CLARKWO	OD DR
E 3702145214480000 HARRIS TRUST	С			SCIOLTO LLC		405 S	5 CLARKWO	OD DR
Total Tribut T	D			FREDRIKSSON REV TRU	ST	415 5	CLARKWO	OD DR
Martiley	Ε			HARRIS TRUST		417	S CLARKWC	OOD DR
H 3702115480190000	F	37021451840	50000	HOLCOMB FAMILY TRUS	5T	417	7 ARBUTUS	PL
3702120050150000	G	37021452137	40000	HARTLEY		41.	4 ARBUTUS	
3702120200190000	Н	37021154801	90000	HECHT		635	FIELDSTON	I RD
M 3702120280190000 OLSEN		37021200501	50000	VAN BROCKLIN & SWIEC	ICKI	66	64 CLARK I	 RD
New Color	J	37021202001	90000	DAVIS		66	63 CLARK I	 RD
M 3702120490180000 KUHN 405 VIEWCREST RD N 3702120600180000 MALKASON FAMILY TRUST 401 VIEWCREST RD 0 3702120690500000 PALEY TRUST/TR 357 VIEWCREST RD 0 3702120720300000 MARRINER & OWEN 355 VIEWCREST RD 0 3702120730730000 BARBONE 353 VIEWCREST RD 0 3702120920100000 BEER 354 VIEWCREST RD 1 3702121000120000 LONNER REVOCABLE TRUST 350 VIEWCREST RD 1 37021211801900000 DAVIS 336 VIEWCREST RD 1 37021211801900000 DAVIS 336 VIEWCREST RD 2 37021211801900000 DAVIS 336 VIEWCREST RD 3 37021211801900000 BROWNE 315 SEA PINES RD 2 3702131375250000 SCOTT 324 SEA PINES RD 3 3702130665800000 BRION REV TRUST/TR 358 VIEWCREST RD 41 3702130785780000 BOURLIER 356 VIEWCREST RD 5 N1/32/37/80 45.33 6 SIT ADDRESS <t< td=""><td>K</td><td>37021202801</td><td>90000</td><td>OLSEN</td><td></td><td>413</td><td>VIEWCREST</td><td>T RD</td></t<>	K	37021202801	90000	OLSEN		413	VIEWCREST	T RD
N 3702120600180000 MALKASON FAMILY TRUST 401 WEWCREST RD 0 3702120690500000 PALEY TRUST/TR 357 VIEWCREST RD P 3702120720300000 MARRINER & OWEN 355 VIEWCREST RD Q 3702120730730000 BARBONE 353 VIEWCREST RD S 3702120890320000 LAVALLEY TRUST/TR 351 VIEWCREST RD S 370212090100000 BEER 354 VIEWCREST RD T 3702121180190000 LONNER REVOCABLE TRUST 350 VIEWCREST RD U 3702121180190000 DAVIS 338 VIEWCREST RD W 3702121190270000 POEHLMAN 336 VIEWCREST RD X 37021219002000000 BROWNE 315 SEA PINES RD X 3702120600060000 BRION REV TRUST/TR 358 VIEWCREST RD A1 3702120740090000 BRION REV TRUST/TR NO SITE ADDRESS B1 3702130765780000 BRION REV TRUST/TR NO SITE ADDRESS C1 3702130735780000 BRION REV TRUST/TR NO SITE ADDRESS B1 37021307357800000 BRION REV TRUST/TR NO SI	L	37021203801	90000	NELSON		409	VIEWCREST	T RD
Name		37021204901	80000	KUHN		405	VIEWCREST	T RD
P	N	37021206001	80000	MALKASON FAMILY TRUS	ST ST	401	VIEWCREST	T RD
Residence 353 Viewcrest RD	0			PALEY TRUST/TR		357	VIEWCRES	T RD
Q 3702120730730000 BARBONE 353 VIEWCREST RD R 3702120890320000 LAVALLEY TRUST/TR 351 VIEWCREST RD S 3702120920100000 BEER 354 VIEWCREST RD I 3702121140120000 LONNER REVOCABLE TRUST 350 VIEWCREST RD U 3702121140120000 SUNI 340 VIEWCREST RD V 3702121190270000 POEHLMAN 336 VIEWCREST RD X 3702121400030000 BROWNE 315 SEA PINES RD X 3702131375250000 SCOTT 324 SEA PINES RD Z 3702120600000000 BRION REV TRUST/TR 358 VIEWCREST RD A1 3702130735780000 BOURLIER NO SITE ADDRESS B1 3702130735780000 BOURLIER NO SITE ADDRESS C1 3702130735780000 BOURLIER NO SITE ADDRESS LINE TABLE CURVE RADIUS DELTA LENGTH L4 S88*14'13" W 45.33 C2 1070.82* 1*36'28" 315.48 L5 N1*32'07"E 67.83 C2 400.00* 19'17'33" 154.8 L6 S1*47'25"W 40.00		37021207203	00000	MARRINER & OWEN		355	VIEWCRES	T RD
R 3702120890320000 LAVALLEY TRUST/TR 351 VIEWCREST RD S 3702120920100000 BEER 354 VIEWCREST RD T 3702121000120000 LONNER REVOCABLE TRUST 350 VIEWCREST RD U 3702121140120000 SUNI 340 VIEWCREST RD V 3702121190270000 POEHLMAN 338 VIEWCREST RD X 3702121400030000 BROWNE 315 SEA PINES RD Y 3702131375250000 SCOTT 324 SEA PINES RD Z 3702120600060000 BRION REV TRUST/TR 358 VIEWCREST RD A1 3702130735780000 BOURLIER NO SITE ADDRESS B1 3702130735780000 BOURLIER NO SITE ADDRESS C1 3702130735780000 BOURLIER NO SITE ADDRESS C1 3702130735790000 BOURLIER NO SITE ADDRESS LINE TABLE CURVE RADIUS DELTA LENG L4 S88*14*13"W 45.33 C2 1070.82* 1/36*28* 30.00 L5 N1/32*07"E 67.83 C2 1070.82* 1/36*28* 30.00 L6 S1*4*725"W	Q	37021207307	30000	BARBONE		353	VIEWCRES	T RD
S 3702120920100000 BEER 354 VIEWCREST RD T 3702121000120000 LONNER REVOCABLE TRUST 350 VIEWCREST RD U 3702121140120000 SUNI 340 VIEWCREST RD V 3702121190270000 POEHLMAN 336 VIEWCREST RD X 370212190270000 BROWNE 315 SEA PINES RD X 3702131375250000 SCOTT 324 SEA PINES RD X 3702120600060000 BRION REV TRUST/TR 358 VIEWCREST RD A1 3702120740090000 BRION REV TRUST/TR NO SITE ADDRESS B1 3702130735780000 BOURLIER NO SITE ADDRESS B1 3702130735790000 BOURLIER NO SITE ADDRESS B2 3702130735790000 BOURLIER NO SITE ADDRESS B2 3702130735790000 BOURLIER NO SITE ADDRESS B3 3702130735790000 BOURLIER NO SITE ADDRESS B2 3702130735790000 BOURLIER NO SITE ADDRESS B3 3702130735790000 BOURLIER NO SITE ADDRESS B3 3702130735790000 BOURLIER NO SITE ADDRESS B4 S88*14*13*W 45.33 L5 N1*32*07*E 67.83 L6 S1*47*25*W 40.00 L7 S88*12*35*E 75.00 L8 S1*47*25*W 40.00 L9 S1*47*25*W 40.00 L10 N1*52*36*E 110.67 L11 N88*12*35*W 6.87 L12 N88*12*35*W 56.09 L14 S50*17*22*W 74.09 L15 N1*34*55*E 47.61 L16 N62*19*43*W 56.09 L17 N1*52*36*E 59.81 L18 N39*42*38*W 46.85 L19 339*42*38*W 46.85 L19 340*42*38*	R			LAVALLEY TRUST/TR		351	VIEWCRES	T RD
Table	S			· ·		354	VIEWCRES	T RD
				LONNER REVOCABLE TRU	JST	350	VIEWCRES	T RD
X 3702121190270000 BROWNE 315 SEA PINES RD X 3702121400030000 BROWNE 315 SEA PINES RD X 37021231375250000 SCOTT 324 SEA PINES RD X 3702120600060000 BRION REV TRUST/TR 358 VIEWCREST RD A1 3702120740090000 BRION REV TRUST/TR NO SITE ADDRESS B1 3702130665800000 BRION REV TRUST/TR NO SITE ADDRESS C1 3702130735780000 BOURLIER 356 VIEWCREST RD D1 3702130785790000 BOURLIER NO SITE ADDRESS D2 3702130785790000 BOURLIER NO SITE ADDRESS D3 3702130785790000 BOURLIER NO SITE ADDRESS D4 S88*14*13*W 45.33 L5 N1*32*07*E 67.83 L6 S1*47*25*W 40.00 L7 S88*12*35*E 75.00 L8 S1*47*25*W 40.00 L9 S1*47*25*W 40.00 L10 N1*52*36*E 110.67 L11 N88*12*35*W 6.87 L12 N88*12*35*W 26.82 L13 S50*17*22*W 74.09 L15 N1*34*55*E 47.61 L16 N62*19*43*W 56.09 L17 N1*52*36*E 59.81 L18 N39*42*38*W 46.85 L19 S39*42*38*E 40.09 405.00**19*13*W 56.09 L17 N1*52*36*E 59.81 L18 N39*42*38*W 46.85 L19 S39*42*38*E 40.09 C1 1040.82* 20*12*01** 366.8 L18 N39*42*38*W 46.85 L19 S39*42*38*E 40.09 C2 1070.82* 136*28* 30.00 C2 1070.82* 179*33* 179*32* C3 460.00* 19*17*33* 154.8 C2 1070.82* 179*03*47* 143.0 C2 1070.82* 179*03*47* 143.0 C3 460.00* 19*17*33* 154.8 C4 405.00* 24*17*28* 171.7 C5 430.00* 19*03*47* 143.0 C4 405.00* 24*17*28* 171.7 C5 430.00* 19*03*47* 143.0 C4 405.00* 24*17*28* 171.7 C5 430.00* 19*03*47* 143.0 C5 430.00* 19*03*47* 143.0 C5 430.00* 19*03*47* 143.0 C5 430.00* 19*03*47* 143.0 C6 VIEWCREST RD LINE TABLE LINE BEARING LENGTH L1NE BEARING LENGTH						340	VIEWCRES	T RD
X 3702121190270000 BROWNE 315 SEA PINES RD X 3702121400030000 BROWNE 315 SEA PINES RD X 37021231375250000 SCOTT 324 SEA PINES RD X 3702120600060000 BRION REV TRUST/TR 358 VIEWCREST RD A1 3702120740090000 BRION REV TRUST/TR NO SITE ADDRESS B1 3702130665800000 BRION REV TRUST/TR NO SITE ADDRESS C1 3702130735780000 BOURLIER 356 VIEWCREST RD D1 3702130785790000 BOURLIER NO SITE ADDRESS D2 3702130785790000 BOURLIER NO SITE ADDRESS D3 3702130785790000 BOURLIER NO SITE ADDRESS D4 S88*14*13*W 45.33 L5 N1*32*07*E 67.83 L6 S1*47*25*W 40.00 L7 S88*12*35*E 75.00 L8 S1*47*25*W 40.00 L9 S1*47*25*W 40.00 L10 N1*52*36*E 110.67 L11 N88*12*35*W 6.87 L12 N88*12*35*W 26.82 L13 S50*17*22*W 74.09 L15 N1*34*55*E 47.61 L16 N62*19*43*W 56.09 L17 N1*52*36*E 59.81 L18 N39*42*38*W 46.85 L19 S39*42*38*E 40.09 405.00**19*13*W 56.09 L17 N1*52*36*E 59.81 L18 N39*42*38*W 46.85 L19 S39*42*38*E 40.09 C1 1040.82* 20*12*01** 366.8 L18 N39*42*38*W 46.85 L19 S39*42*38*E 40.09 C2 1070.82* 136*28* 30.00 C2 1070.82* 179*33* 179*32* C3 460.00* 19*17*33* 154.8 C2 1070.82* 179*03*47* 143.0 C2 1070.82* 179*03*47* 143.0 C3 460.00* 19*17*33* 154.8 C4 405.00* 24*17*28* 171.7 C5 430.00* 19*03*47* 143.0 C4 405.00* 24*17*28* 171.7 C5 430.00* 19*03*47* 143.0 C4 405.00* 24*17*28* 171.7 C5 430.00* 19*03*47* 143.0 C5 430.00* 19*03*47* 143.0 C5 430.00* 19*03*47* 143.0 C5 430.00* 19*03*47* 143.0 C6 VIEWCREST RD LINE TABLE LINE BEARING LENGTH L1NE BEARING LENGTH	V	37021211801	90000	DAVIS		338	VIEWCRES	T RD
X 3702131375250000 BRION REV TRUST/TR 358 VIEWCREST RD	W	37021211902	70000			336	VIEWCREST	T RD
STATE STAT	X	37021214000	30000	BROWNE		315	SEA PINES	 S <i>RD</i>
### A10 3702120740090000 BOURLIER NO SITE ADDRESS ### B1 3702130665800000 BRION REV TRUST/TR NO SITE ADDRESS ### CURVE TABLE CURVE TABLE ### CURVE RADIUS DELTA LENG ### CURVE RADIUS DELTA ### CURVE RADIUS DELTA ### CURVE RADIUS DELTA ### CURVE RADIUS DELTA LENG ### CURVE	Y			SCOTT				
BOURLIER NO SITE ADDRESS		37021206000	60000	BRION REV TRUST/TR	?	358	VIEWCREST	T RD
C1 3702130735780000 BOURLIER 356 VIEWCREST RD	A1			BOURLIER		NO	SITE ADDR	
D1 3702130785790000 BOURLIER NO SITE ADDRESS	R1	77004706050		,				
LINE TABLE LINE BEARING LENGTH L4 \$88*14'13"W 45.33 L5 \$N1*32'07"E 67.83 L6 \$S1*47'25"W 40.00 L7 \$88*12'35"E 75.00 L8 \$S1*47'25"W 40.00 L9 \$S1*47'25"W 40.00 L10 \$N1*52'36"E 110.67 L11 \$N88*12'35"W 6.87 L12 \$N88*12'35"W 50.00 L14 \$S50*17'22"W 50.00 L15 \$N1*34'55"E 47.61 L16 \$N62*19'43"W 56.09 L17 \$N1*52'36"E 59.81 L18 \$N39*42'38"W 46.85 L19 \$S39*42'38"W 46.85		3/021306658	00000	BRION REV TRUST/TR	?	NO	SITE ADDR	PESS
LINE TABLE LINE BEARING LENGTH L4 \$88*14'13"W 45.33 L5 \$N1*32'07"E 67.83 L6 \$S1*47'25"W 40.00 L7 \$88*12'35"E 75.00 L8 \$S1*47'25"W 40.00 L9 \$S1*47'25"W 40.00 L10 \$N1*52'36"E 110.67 L11 \$N88*12'35"W 6.87 L12 \$N88*12'35"W 50.00 L14 \$S50*17'22"W 50.00 L15 \$N1*34'55"E 47.61 L16 \$N62*19'43"W 56.09 L17 \$N1*52'36"E 59.81 L18 \$N39*42'38"W 46.85 L19 \$S39*42'38"W 46.85				,	?			
L5 N1'32'07"E 67.83 L6 S1'47'25"W 40.00 L7 S88'12'35"E 75.00 L8 S1'47'25"W 20.00 L9 S1'47'25"W 40.00 L10 N1'52'36"E 110.67 L11 N88'12'35"W 6.87 L12 N88'12'35"W 26.82 L13 S50'17'22"W 50.00 L14 S50'17'22"W 74.09 L15 N1'34'55"E 47.61 L16 N62'19'43"W 56.09 L17 N1'52'36"E 59.81 L18 N39'42'38"W 46.85 L19 S39'42'38"E 40.09	C1	37021307357	80000	BOURLIER	?	356	VIEWCRES	T RD
L6 \$1'47'25"W \$40.00 L7 \$88*12'35"E 75.00 L8 \$1'47'25"W \$20.00 L9 \$1'47'25"W \$40.00 L10 \$N1*52'36"E \$110.67 L11 \$N88*12'35"W \$6.87 L12 \$N88*12'35"W \$26.82 L13 \$50*17'22"W \$50.00 L14 \$50*17'22"W \$74.09 L15 \$N1*34'55"E \$47.61 L16 \$N62'19'43"W \$56.09 L17 \$N1*52'36"E \$59.81 L18 \$N39*42'38"W \$46.85 L19 \$39*42'38"E \$40.09	C1 D1	37021307357 37021307857	80000 90000	BOURLIER BOURLIER		356 NO	VIEWCREST SITE ADDR	T RD
L7 \$88*12'35"E 75.00 L8 \$1*47'25"W 20.00 L9 \$1*47'25"W 40.00 L10 \$N1*52'36"E 110.67 L11 \$N88*12'35"W 6.87 L12 \$N88*12'35"W 26.82 L13 \$50*17'22"W 50.00 L14 \$50*17'22"W 74.09 L15 \$N1*34'55"E 47.61 L16 \$N62*19'43"W 56.09 L17 \$N1*52'36"E 59.81 L18 \$N39*42'38"W 46.85 L19 \$39*42'38"E 40.09	C1 D1 LINE	37021307357 37021307857 LINE TABLE BEARING	80000 90000 LENGT	BOURLIER BOURLIER CURVE	C RADI	356 NO CURVE	VIEWCREST SITE ADDR	T RD
L8 S1'47'25"W 20.00 L9 S1'47'25"W 40.00 L10 N1'52'36"E 110.67 L11 N88'12'35"W 6.87 L12 N88'12'35"W 26.82 L13 S50'17'22"W 50.00 L14 S50'17'22"W 74.09 L15 N1'34'55"E 47.61 L16 N62'19'43"W 56.09 L17 N1'52'36"E 59.81 L18 N39'42'38"W 46.85 L19 S39'42'38"E 40.09	C1 D1 LINE L4	37021307357 37021307857 LINE TABLE BEARING S88'14'13"W	80000 90000 LENGT 45.33	BOURLIER BOURLIER CURVE C2	C RADI 1070.	356 NO CURVE US 82'	VIEWCREST SITE ADDR TABLE DELTA 1'36'28"	LENG
L9 \$1.47.25.W 40.00 L10 \$1.52.36.E \$110.67 L11 \$1.2.35.W 6.87 L12 \$1.2.35.W \$26.82 L13 \$50.17.22.W \$50.00 L14 \$50.17.22.W \$74.09 L15 \$1.34.55.E \$47.61 L16 \$1.34.3.W \$1.34.3.W L16 \$1.34.3.W \$1.34.3.W L17 \$1.34.3.W \$1.34.3.W L16 \$1.34.3.W \$1.34.3.W L16 \$1.34.3.W \$1.34.3.W L17 \$1.34.3.W \$1.34.3.W L18 \$1.34.3.W \$1.34.3.W L19 \$1.34.3.W \$1.34.3.W L10	C1 D1 LINE L4 L5	37021307357 37021307857 LINE TABLE BEARING S88*14'13"W N1*32'07"E	LENGT 45.33	BOURLIER BOURLIER CURVE C2 C3	1070. 460.	356 NO NO CURVE US 82' 00'	TABLE DELTA 1'36'28" 19'17'33" 24'17'28"	LENG 30.03
L10 N1*52'36"E 110.67 L11 N88*12'35"W 6.87 L12 N88*12'35"W 26.82 L13 S50*17'22"W 50.00 L14 S50*17'22"W 74.09 L15 N1*34'55"E 47.61 L16 N62*19'43"W 56.09 L17 N1*52'36"E 59.81 L18 N39*42'38"W 46.85 L19 S39*42'38"E 40.09	C1 D1 LINE L4 L5 L6	37021307357 37021307857 37021307857 LINE TABLE BEARING S88*14'13"W N1*32'07"E S1*47'25"W S88*12'35"E	LENGT 45.33 67.83 40.00	BOURLIER BOURLIER CURVE C2 C3 C4 C5	1070. 460. 405.	356 NO NO CURVE US 82' 00'	TABLE DELTA 1'36'28" 19'17'33" 24'17'28"	LENG 30.03 154.8
L11 N88*12'35"W 6.87 L12 N88*12'35"W 26.82 L13 S50*17'22"W 50.00 L14 S50*17'22"W 74.09 L15 N1*34'55"E 47.61 L16 N62*19'43"W 56.09 L17 N1*52'36"E 59.81 L18 N39*42'38"W 46.85 L19 S39*42'38"E 40.09	C1 D1 LINE L4 L5 L6 L7 L8	37021307357 37021307857 37021307857 LINE TABLE BEARING S88*14'13"W N1*32'07"E S1*47'25"W S88*12'35"E S1*47'25"W	LENGT 45.33 67.83 40.00 75.00	BOURLIER BOURLIER CURVE C2 C3 C4 C5	1070. 460. 405.	356 NO NO CURVE US 82' 00'	TABLE DELTA 1'36'28" 19'17'33" 24'17'28"	T RD PESS
LINE BEARING LENGTH L12 N88*12'35"W 26.82 L13 S50*17'22"W 50.00 L14 S50*17'22"W 74.09 L15 N1*34'55"E 47.61 L16 N62*19'43"W 56.09 L17 N1*52'36"E 59.81 L18 N39*42'38"W 46.85 L19 S39*42'38"E 40.09	LINE	37021307357 37021307857 37021307857 LINE TABLE BEARING \$88*14'13"W N1*32'07"E \$1*47'25"W \$88*12'35"E \$1*47'25"W \$1*47'25"W	LENGT 45.33 67.83 40.00 75.00 20.00	BOURLIER BOURLIER CURVE C2 C3 C4 C5 C5	1070. 460. 405.	356 NO NO CURVE US 82' 00'	TABLE DELTA 1'36'28" 19'17'33" 24'17'28"	LENG 30.03 154.8
L13 S50°17′22″W 50.00 L14 S50°17′22″W 74.09 L15 N1°34′55″E 47.61 L16 N62°19′43″W 56.09 L17 N1°52′36″E 59.81 L18 N39°42′38″W 46.85 L19 S39°42′38″E 40.09	C1 D1 LINE L4 L5 L6 L7 L8 L9 L10	37021307357 37021307857 37021307857 LINE TABLE BEARING \$88*14'13"W N1*32'07"E \$1*47'25"W \$88*12'35"E \$1*47'25"W \$1*47'25"W N1*52'36"E	LENGT 45.33 67.83 40.00 20.00 40.00	BOURLIER BOURLIER CURVE C2 C3 C4 C5 C1 CL VIE	1070. 460. 405. 430.	356 NO NO CURVE US 82' 00' 00'	VIEWCRES' SITE ADDR TABLE DELTA 1'36'28" 19'17'33" 24'17'28" 19'03'47"	LENG 30.0. 154.8
L14 S50°17′22″W 74.09 L15 N1°34′55″E 47.61 L16 N62°19′43″W 56.09 L17 N1°52′36″E 59.81 L18 N39°42′38″W 46.85 L19 S39°42′38″E 40.09	C1 D1 LINE L4 L5 L6 L7 L8 L9 L10 L11	JINE TABLE BEARING \$88*14'13"W N1*32'07"E \$1*47'25"W \$88*12'35"E \$1*47'25"W N1*52'36"E N88*12'35"W	LENGT 45.33 67.83 40.00 75.00 40.00 110.6 6.87	BOURLIER BOURLIER CURVE C2 C3 C4 C5 C1 CL VIE LINE	7 RADI 1070. 460. 405. 430.	356 NO NO CURVE US 82' 00' 00'	VIEWCRES: SITE ADDR TABLE DELTA 1°36'28" 19°17'33" 24°17'28" 19°03'47"	LENG 30.0. 154.8
L15 N1*34'55"E 47.61 L16 N62*19'43"W 56.09 L17 N1*52'36"E 59.81 L18 N39*42'38"W 46.85 L19 S39*42'38"E 40.09	C1 D1 LINE L4 L5 L6 L7 L8 L9 L10 L11 L12	37021307357 37021307857 37021307857 S1021307857 SEARING S88*14'13"W N1*32'07"E S1*47'25"W S88*12'35"E S1*47'25"W S1*47'25"W N1*52'36"E N88*12'35"W N88*12'35"W	LENGT 45.33 67.83 40.00 20.00 40.00 110.6 6.87 26.82	BOURLIER BOURLIER CURVE C2 C3 C4 C5 C5 CL VIE LINE L11	### RADI 1070. 460. 405. 430. WCREST BEAR	356 NO SURVE US 82' 00' 00' RD L	TABLE DELTA 1°36'28" 19°17'33" 24°17'28" 19°03'47" INE TABLE LENGTH	LENG 30.03 154.8
L16 N62'19'43"W 56.09 L17 N1'52'36"E 59.81 L18 N39'42'38"W 46.85 L19 S39'42'38"E 40.09	C1 D1 LINE L4 L5 L6 L7 L8 L9 L10 L11 L12 L13	37021307357 37021307857 37021307857 37021307857 BEARING S88*14'13"W N1*32'07"E S1*47'25"W S88*12'35"E S1*47'25"W N1*52'36"E N88*12'35"W N88*12'35"W N88*12'35"W S50*17'22"W	LENGT 45.33 67.83 40.00 20.00 40.00 110.6 6.87 26.82 50.00	BOURLIER BOURLIER CURVE C2 C3 C4 C5 C5 CL VIE LINE L1 L2	### CONTRIBET CO	356 NO CURVE US 82' 00' 00' 100' RD L ING '07"W	TABLE DELTA 1°36'28" 19°17'33" 24°17'28" 19°03'47" INE TABLE LENGTH 120.46	LENG 30.0. 154.8
L17 N1*52'36"E 59.81 L18 N39*42'38"W 46.85 L19 S39*42'38"E 40.09	C1 D1 LINE L4 L5 L6 L7 L8 L9 L10 L11 L12 L13 L14	37021307357 37021307857 37021307857 S1021307857 S1021307857 S88*14'13"W N1*32'07"E S1*47'25"W S88*12'35"E S1*47'25"W N1*52'36"E N88*12'35"W N88*12'35"W N88*12'35"W S50*17'22"W S50*17'22"W	LENGT 45.33 67.83 40.00 20.00 40.00 110.6 6.87 26.82 50.00 74.09	BOURLIER BOURLIER CURVE C2 C3 C4 C5 C1 CL VIE LINE LINE L1 L2 L3	### RADI 1070. 460. 405. 430. 430. #### WCREST BEAR \$88*15 \$88*14	356 NO CURVE US 82' 00' 00' 00' UNG '07"W '13"W	TABLE DELTA 1°36'28" 19°17'33" 24°17'28" 19°03'47" INE TABLE LENGTH 120.46 46.23	LENG 30.03 154.8
L18 N39*42'38"W 46.85 L19 S39*42'38"E 40.09	C1 D1 LINE L4 L5 L6 L7 L8 L9 L10 L11 L12 L13 L14 L15	JINE TABLE BEARING \$88*14'13"W N1*32'07"E \$1*47'25"W \$88*12'35"E \$1*47'25"W N1*52'36"E N88*12'35"W N88*12'35"E	LENGT 45.33 67.83 40.00 20.00 40.00 110.6 6.87 26.82 50.00 74.09	BOURLIER BOURLIER CURVE C2 C3 C4 C5 C1 CL VIE LINE L1 L2 L3 CL	### RADI 1070. 460. 405. 430.	356 NO CURVE US 82' 00' 00' 00' 707"W 713"W 713"W PEST R	TABLE DELTA 1°36'28" 19°17'33" 24°17'28" 19°03'47" INE TABLE LENGTH 120.46 46.23 263.34 RD CURVE	LENG 30.00 154.8 171.7 143.0
L19 S39*42'38"E 40.09	C1 D1 LINE L4 L5 L6 L7 L8 L9 L10 L11 L12 L13 L14 L15 L16	37021307357 37021307857 37021307857 37021307857 LINE TABLE BEARING S88*14'13"W N1*32'07"E S1*47'25"W S88*12'35"E S1*47'25"W N1*52'36"E N88*12'35"W N88*12'35"W N88*12'35"W S50*17'22"W S50*17'22"W N1*34'55"E N62*19'43"W	LENGT 45.33 67.83 40.00 75.00 20.00 40.00 110.6 6.87 26.82 50.00 74.09 47.6	BOURLIER BOURLIER CURVE C2 C3 C4 C5 C1 CL VIE LINE L1 L2 L3 CL CURVE	### ##################################	356 NO CURVE US 82' 00' 00' 00' 1NG '07"W '13"W '13"W PEST R	TABLE DELTA 1°36'28" 19°17'33" 24°17'28" 19°03'47" INE TABLE LENGTH 120.46 46.23 263.34 RD CURVE : DELTA	LENG 30.00 154.8 171.7 143.0
	C1 D1 LINE L4 L5 L6 L7 L8 L9 L10 L11 L12 L13 L14 L15 L16 L17	37021307357 37021307357 37021307857 LINE TABLE BEARING S88*14'13"W N1*32'07"E S1*47'25"W S88*12'35"E S1*47'25"W N1*52'36"E N88*12'35"W N88*12'35"W N88*12'35"W N88*12'35"W N88*12'35"W N88*12'35"W N88*12'35"W N88*12'35"W N88*12'35"W N1*52'36"E N62*19'43"W N1*52'36"E	LENGT 45.33 67.83 40.00 75.00 20.00 40.00 710.6 6.87 26.82 50.00 74.09 47.6 56.09	BOURLIER BOURLIER CURVE C2 C3 C4 C5 C5 C1 CL VIE LINE L1 L2 L3 CL CURVE C1 CURVE	### ##################################	356 NO CURVE US 82' 00' 00' 00' 1NG '07"W '13"W '13"W PEST R	TABLE DELTA 1°36'28" 19°17'33" 24°17'28" 19°03'47" INE TABLE LENGTH 120.46 46.23 263.34 RD CURVE : DELTA	LENG 30.03 154.8 171.7 143.0
[120 N88*12 35 W 27.01	C1 D1 LINE L4 L5 L6 L7 L8 L9 L10 L11 L12 L13 L14 L15 L16 L17 L18	37021307357 37021307357 37021307857 S1021307857 S88*14'13"W N1*32'07"E S1*47'25"W S88*12'35"E S1*47'25"W N1*52'36"E N88*12'35"W N88*12'35"W N88*12'35"W N88*12'35"W N88*12'35"W N88*12'35"W N1*52'36"E N62*19'43"W N1*52'36"E N39*42'38"W	LENGT 45.33 67.83 40.00 75.00 20.00 40.00 110.6 6.87 26.82 50.00 74.09 47.6 56.09 46.83	BOURLIER BOURLIER CURVE C2 C3 C4 C5 C5 C1 LINE LINE L1 L2 L3 CL CURVE CI CURVE CI CI CURVE CI CI CI CURVE CI CI CURVE CI CI CURVE CURVE	### ##################################	356 NO CURVE US 82' 00' 00' 00' 1NG '07"W '13"W '13"W PEST R	TABLE DELTA 1°36'28" 19°17'33" 24°17'28" 19°03'47" INE TABLE LENGTH 120.46 46.23 263.34 RD CURVE : DELTA	LENG 30.00 154.8 171.7 143.0
	C1 D1 LINE L4 L5 L6 L7 L8 L9 L10 L11 L12 L13 L14 L15 L16 L17 L18 L19	JINE TABLE BEARING \$88*14'13"W N1*32'07"E \$1*47'25"W \$88*12'35"E \$1*47'25"W N1*52'36"E N88*12'35"W N88*12'35"W N88*12'35"W N88*12'35"W N88*12'35"W N1*52'36"E N62*19'43"W N1*52'36"E N62*19'43"W S39*42'38"E	LENGT 45.33 67.83 40.00 20.00 40.00 110.6 6.87 26.82 50.00 74.09 47.6 56.09 59.8 40.00	BOURLIER BOURLIER CURVE C2 C3 C4 C5 C1 CL VIE LINE L1 L2 L3 1 CL CURVE CI CURVE CI CI CURVE CI CI CI CURVE CI CI CI CI CI CI	### ##################################	356 NO CURVE US 82' 00' 00' 00' 1NG '07"W '13"W '13"W PEST R	TABLE DELTA 1°36'28" 19°17'33" 24°17'28" 19°03'47" INE TABLE LENGTH 120.46 46.23 263.34 RD CURVE : DELTA	LENG 30.00 154.8 171.7 143.0
	C1 D1 LINE L4 L5 L6 L7 L8 L9 L10 L11 L12 L13 L14 L15 L16 L17 L18 L19	JINE TABLE BEARING \$88*14'13"W N1*32'07"E \$1*47'25"W \$88*12'35"E \$1*47'25"W N1*52'36"E N88*12'35"W N88*12'35"W N88*12'35"W N88*12'35"W N88*12'35"W N1*52'36"E N62*19'43"W N1*52'36"E N62*19'43"W S39*42'38"E	LENGT 45.33 67.83 40.00 20.00 40.00 110.6 6.87 26.82 50.00 74.09 47.6 56.09 59.8 40.00	BOURLIER BOURLIER CURVE C2 C3 C4 C5 C1 CL VIE LINE L1 L2 L3 1 CL CURVE CI CURVE CI CI CURVE CI CI CI CURVE CI CI CI CI CI CI	### ##################################	356 NO CURVE US 82' 00' 00' 00' 1NG '07"W '13"W '13"W PEST R	TABLE DELTA 1°36'28" 19°17'33" 24°17'28" 19°03'47" INE TABLE LENGTH 120.46 46.23 263.34 RD CURVE : DELTA	LENG 30.00 154.8 171.7 143.0
	C1 D1 LINE L4 L5 L6 L7 L8 L9 L10 L11 L12 L13 L14 L15 L16 L17 L18 L19	JINE TABLE BEARING \$88*14'13"W N1*32'07"E \$1*47'25"W \$88*12'35"E \$1*47'25"W N1*52'36"E N88*12'35"W N88*12'35"W N88*12'35"W N88*12'35"W N88*12'35"W N1*52'36"E N62*19'43"W N1*52'36"E N62*19'43"W S39*42'38"E	LENGT 45.33 67.83 40.00 20.00 40.00 110.6 6.87 26.82 50.00 74.09 47.6 56.09 59.8 40.00	BOURLIER BOURLIER CURVE C2 C3 C4 C5 C1 CL VIE LINE L1 L2 L3 1 CL CURVE CI CURVE CI CI CURVE CI CI CI CURVE CI CI CI CI CI CI	### ##################################	356 NO CURVE US 82' 00' 00' 00' 1NG '07"W '13"W '13"W PEST R	TABLE DELTA 1°36'28" 19°17'33" 24°17'28" 19°03'47" INE TABLE LENGTH 120.46 46.23 263.34 RD CURVE : DELTA	LENG 30.0 154.8 171.7 143.0

EXISTING LINE	LEGEND
· ·	= EXISTING EDGE OF ASPHALT
	= EXISTING EDGE OF CONCRETE
	= EXISTING EDGE OF GRAVEL ROAD
	= EXISTING CURB
	= EXISTING SIDEWALK
	= EXISTING EDGE OF MASONRY PAVERS
======	= EXISTING STORM CULVERT
SD	= EXISTING STORM DRAIN LINE
ss	= EXISTING SANITARY SEWER GRAVITY LINE
w	= EXISTING WATER LINE
OHE	= EXISTING OVERHEAD ELECTRIC LINES
OHE/OCM	= EXISTING OVERHEAD ELECTRIC & COMMUNICATION LINES
UGE	= EXISTING UNDERGROUND POWER
OCM	= EXISTING OVERHEAD COMMUNICATIONS LINE
G	= EXISTING UNDERGROUND GAS LINE
· · TOP · ·	= EXISTING TOP OF SLOPE LINE
· · TOE · ·	= EXISTING TOE OF SLOPE LINE
	= EXISTING GRADE INDEX CONTOUR
118	= EXISTING GRADE INTERVAL CONTOUR
·>> ·	= EXISTING FLOW LINE
	= EXISTING WETLAND LINE
	= EXISTING WETLAND BUFFER LINE
	= EXISTING EDGE OF LANDSCAPED AREA

ANNE C. JONES FAMILY LP

807 CHUCKANUT SHORE ROAD

BELLINGHAM, WA 98229

THE WOODS AT VIEWCREST - EXISTING CONDITIONS FOR ANNE C. JONES FAMILY LP

807 CHUCKANUT SHORE ROAD BELLINGHAM, WA 98229

SITUATE IN A PORTION OF THE SW 1/4 OF THE SW 1/4 OF SECTION 12, AND THE NW 1/4 OF THE NW 1/4 OF SECTION 13, TOWNSHIP 37 NORTH, RANGE 2 EAST, CITY OF BELLINGHAM, WHATCOM COUNTY, WASHINGTON



EXISTING FEATURE SYMBOL LEGEND

= EXISTING MONUMENT

 \bigcirc = EXISTING IRON PIPE

 \blacksquare = SET HUB AND MAG

 \bullet = SET NAIL

○ = EXISTING LEAD AND TACK

⊙ = EXISTING RAILROAD SPIKE • = SET RAILROAD SPIKE

 \Box = EXISTING AREA DRAIN □ = EXISTING CATCH BASIN

 \boxplus = EXISTING WATER METER \bigcirc = EXISTING FIRE HYDRANT = EXISTING BOLLARD (STOP) = EXISTING STOP SIGN M = EXISTING MAILBOX \Box = EXISTING TEST PIT -O- = EXISTING POWER POLE

□ = EXISTING STORM DRAIN MANHOLE

= EXISTING SANITARY SEWER MANHOLE

-O-drp = EXISTING POWER POLE W/DROP

□ = EXISTING FIBER-OPTIC/COMM. PEDESTAL/RISER

□ = EXISTING TELEPHONE PEDESTAL/RISER

= EXISTING CARSONITE POST


 \leftarrow = EXISTING GROUND GUY


Δ = SET REBAR & ORANGE PLASTIC CAP

PACIFIC SURVEYING
& ENGINEERING, INC.
909 Squalicum Way, Suite 111 BELLINGHAM, WA 98225

EASEMENT (SHOWN PER

DATA	DRAWN BY	CHECKED BY		FIELD BOOKS	
BASE	TJM	ASM	DESIGN:	XXX	
DESIGN			STAKING:	XXX	
XREF:	XXX		ASBUILT:	XXX	
DWG:	XXX			DATUM	
HORIZ. SCALE	: 1" =	100']	DATON	
VERT. SCALE:	N/	⁄A	HORIZ.:	XXX	
JOB#:	2019190	5	VERT.:	XXX	
	SHEET	7	OF	 7	



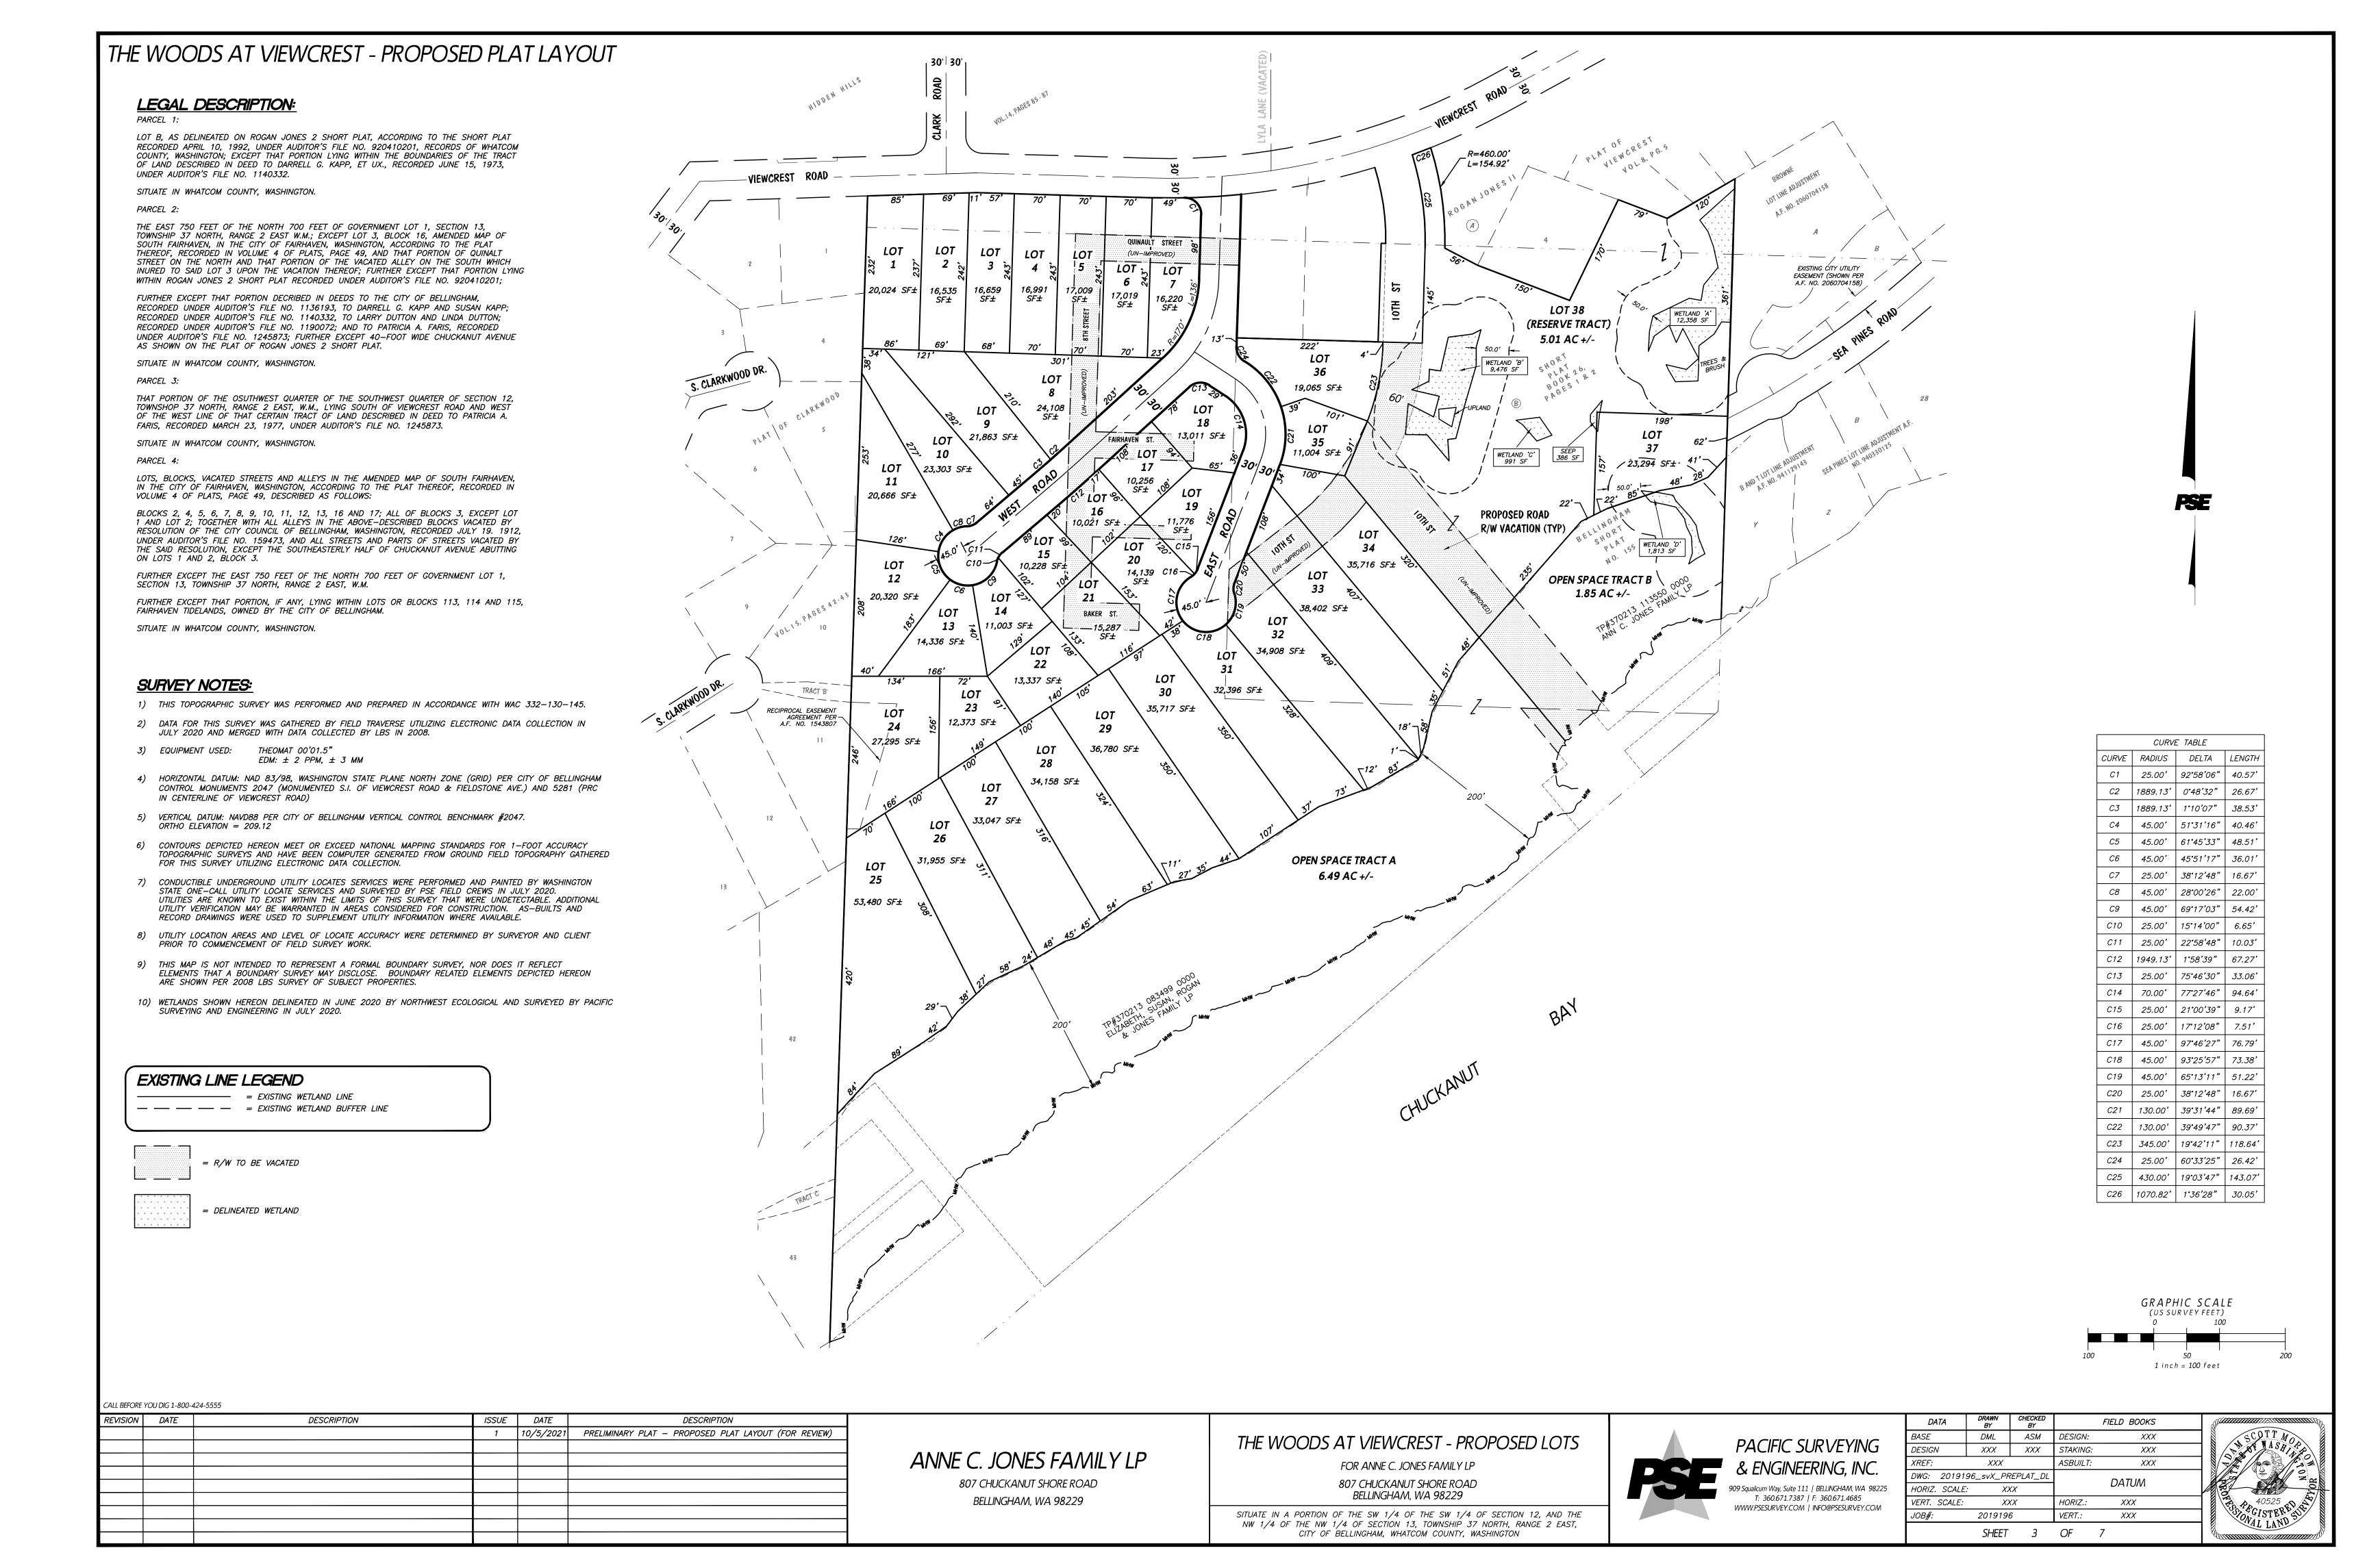

THE WOODS AT VIEWCREST - PROPOSED LOTS & EXISTING CONDITIONS EXHIBIT LEGAL DESCRIPTION: LOT B, AS DELINEATED ON ROGAN JONES 2 SHORT PLAT, ACCORDING TO THE SHORT PLAT RECORDED APRIL 10, 1992, UNDER AUDITOR'S FILE NO. 920410201, RECORDS OF WHATCOM COUNTY, WASHINGTON; EXCEPT THAT PORTION LYING WITHIN THE BOUNDARIES OF THE TRACT OF LAND DESCRIBED IN DEED TO DARRELL G. KAPP, ET UX., RECORDED JUNE 15, 1973, UNDER AUDITOR'S FILE NO. 1140332. SITUATE IN WHATCOM COUNTY, WASHINGTON. PARCEL 2: THE EAST 750 FEET OF THE NORTH 700 FEET OF GOVERNMENT LOT 1, SECTION 13, TOWNSHIP 37 NORTH, RANGE 2 EAST W.M.; EXCEPT LOT 3, BLOCK 16, AMENDED MAP OF SOUTH FAIRHAVEN. IN THE CITY OF FAIRHAVEN. WASHINGTON. ACCORDING TO THE PLAT THEREOF, RECORDED IN VOLUME 4 OF PLATS, PAGE 49, AND THAT PORTION OF QUINALT STREET ON THE NORTH AND THAT PORTION OF THE VACATED ALLEY ON THE SOUTH WHICH INURED TO SAID LOT 3 UPON THE VACATION THEREOF; FURTHER EXCEPT THAT PORTION LYING WITHIN ROGAN JONES 2 SHORT PLAT RECORDED UNDER AUDITOR'S FILE NO. 920410201; FURTHER EXCEPT THAT PORTION DECRIBED IN DEEDS TO THE CITY OF BELLINGHAM, RECORDED UNDER AUDITOR'S FILE NO. 1136193, TO DARRELL G. KAPP AND SUSAN KAPP; RECORDED UNDER AUDITOR'S FILE NO. 1140332, TO LARRY DUTTON AND LINDA DUTTON; RECORDED UNDER AUDITOR'S FILE NO. 1190072; AND TO PATRICIA A. FARIS, RECORDED UNDER AUDITOR'S FILE NO. 1245873; FURTHER EXCEPT 40-FOOT WIDE CHUCKANUT AVENUE AS SHOWN ON THE PLAT OF ROGAN JONES 2 SHORT PLAT. SITUATE IN WHATCOM COUNTY, WASHINGTON. S. CLARKWOOD DR. PARCEL 3: THAT PORTION OF THE OSUTHWEST QUARTER OF THE SOUTHWEST QUARTER OF SECTION 12. TOWNSHOP 37 NORTH, RANGE 2 EAST, W.M., LYING SOUTH OF VIEWCREST ROAD AND WEST OF THE WEST LINE OF THAT CERTAIN TRACT OF LAND DESCRIBED IN DEED TO PATRICIA A. FARIS, RECORDED MARCH 23, 1977, UNDER AUDITOR'S FILE NO. 1245873. SITUATE IN WHATCOM COUNTY, WASHINGTON. PARCEL 4: LOTS, BLOCKS, VACATED STREETS AND ALLEYS IN THE AMENDED MAP OF SOUTH FAIRHAVEN, IN THE CITY OF FAIRHAVEN, WASHINGTON, ACCORDING TO THE PLAT THEREOF, RECORDED IN VOLUME 4 OF PLATS, PAGE 49, DESCRIBED AS FOLLOWS: BLOCKS 2, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 16 AND 17; ALL OF BLOCKS 3, EXCEPT LOT 1 AND LOT 2; TOGETHER WITH ALL ALLEYS IN THE ABOVE—DESCRIBED BLOCKS VACATED BY RESOLUTION OF THE CITY COUNCIL OF BELLINGHAM, WASHINGTON, RECORDED JULY 19. 1912, UNDER AUDITOR'S FILE NO. 159473, AND ALL STREETS AND PARTS OF STREETS VACATED BY THE SAID RESOLUTION, EXCEPT THE SOUTHEASTERLY HALF OF CHUCKANUT AVENUE ABUTTING ON LOTS 1 AND 2, BLOCK 3. FURTHER EXCEPT THE EAST 750 FEET OF THE NORTH 700 FEET OF GOVERNMENT LOT 1, SECTION 13, TOWNSHIP 37 NORTH, RANGE 2 EAST, W.M. FURTHER EXCEPT THAT PORTION, IF ANY, LYING WITHIN LOTS OR BLOCKS 113, 114 AND 115, FAIRHAVEN TIDELANDS, OWNED BY THE CITY OF BELLINGHAM. SITUATE IN WHATCOM COUNTY, WASHINGTON. **SURVEY NOTES:** 1) THIS TOPOGRAPHIC SURVEY WAS PERFORMED AND PREPARED IN ACCORDANCE WITH WAC 332-130-145. 2) DATA FOR THIS SURVEY WAS GATHERED BY FIELD TRAVERSE UTILIZING ELECTRONIC DATA COLLECTION IN JULY 2020 AND MERGED WITH DATA COLLECTED BY LBS IN 2008. 3) EQUIPMENT USED: THEOMAT 00'01.5" EDM: \pm 2 PPM, \pm 3 MM 4) HORIZONTAL DATUM: NAD 83/98, WASHINGTON STATE PLANE NORTH ZONE (GRID) PER CITY OF BELLINGHAM DRIVEWAY CONTROL MONUMENTS 2047 (MONUMENTED S.I. OF VIEWCREST ROAD & FIELDSTONE AVE.) AND 5281 (PRC IN CENTERLINE OF VIEWCREST ROAD) VERTICAL DATUM: NAVD88 PER CITY OF BELLINGHAM VERTICAL CONTROL BENCHMARK #2047. $ORTHO\ ELEVATION = 209.12$ CONTOURS DEPICTED HEREON MEET OR EXCEED NATIONAL MAPPING STANDARDS FOR 1-FOOT ACCURACY TOPOGRAPHIC SURVEYS AND HAVE BEEN COMPUTER GENERATED FROM GROUND FIELD TOPOGRAPHY GATHERED FOR THIS SURVEY UTILIZING ELECTRONIC DATA COLLECTION. 7) CONDUCTIBLE UNDERGROUND UTILITY LOCATES SERVICES WERE PERFORMED AND PAINTED BY WASHINGTON STATE ONE-CALL UTILITY LOCATE SERVICES AND SURVEYED BY PSE FIELD CREWS IN JULY 2020. UTILITIES ARE KNOWN TO EXIST WITHIN THE LIMITS OF THIS SURVEY THAT WERE UNDETECTABLE. ADDITIONAL UTILITY VERIFICATION MAY BE WARRANTED IN AREAS CONSIDERED FOR CONSTRUCTION. AS-BUILTS AND RECORD DRAWINGS WERE USED TO SUPPLEMENT UTILITY INFORMATION WHERE AVAILABLE. 8) UTILITY LOCATION AREAS AND LEVEL OF LOCATE ACCURACY WERE DETERMINED BY SURVEYOR AND CLIENT PRIOR TO COMMENCEMENT OF FIELD SURVEY WORK. 9) THIS MAP IS NOT INTENDED TO REPRESENT A FORMAL BOUNDARY SURVEY, NOR DOES IT REFLECT ELEMENTS THAT A BOUNDARY SURVEY MAY DISCLOSE. BOUNDARY RELATED ELEMENTS DEPICTED HEREON ARE SHOWN PER 2008 LBS SURVEY OF SUBJECT PROPERTIES. 10) WETLANDS SHOWN HEREON DELINEATED IN JUNE 2020 BY NORTHWEST ECOLOGICAL AND SURVEYED BY PACIFIC SURVEYING AND ENGINEERING IN JULY 2020. CALL BEFORE YOU DIG 1-800-424-5555 ISSUE DATE REVISION DATE DESCRIPTION

BRICK PILLAR WITH ADDRESS SEVIEWCREST ROAD ASPHALT DRIVEWAY LOT LOT (RESERVE TRACT) LOT ∥ LOT WETLAND 'C' 991 SF WETLAND 'D' 1,813 SF OPEN SPACE TRACT B *32* EXISTING SHARED **OPEN SPACE TRACT A** EXISTING FEATURE SYMBOL LEGEND = EXISTING MONUMENT \bigcirc = EXISTING IRON PIPE △ = SET REBAR & ORANGE PLASTIC CAP \blacksquare = SET HUB AND MAG \odot = EXISTING LEAD AND TACK \oplus = SET MAG NAIL \bullet = SET NAIL ⊙ = EXISTING RAILROAD SPIKE HIGH WATER DIGITIZED FROM PUBLICLY AVAILABLE LIDAR ☐ = EXISTING STORM DRAIN MANHOLE DATA (NOT SURVEYED) \Box = EXISTING AREA DRAIN □ = EXISTING CATCH BASIN = EXISTING SANITARY SEWER MANHOLE \bowtie = EXISTING GATE VALVE \boxplus = EXISTING WATER METER □ = EXISTING FIRE HYDRANT (STOP) = EXISTING STOP SIGN \square = EXISTING MAILBOX -O- = EXISTING POWER POLE -O-drp = EXISTING POWER POLE W/DROP GRAPHIC SCALE \Rightarrow = EXISTING STREET LIGHT POLE (US SURVEY FEET) otin = EXISTING YARD LIGHT \leftarrow = EXISTING GROUND GUY \[
\text{\text{\$\sigma}} = EXISTING FIBER-OPTIC/COMM. PEDESTAL/RISER
\] = EXISTING TELEPHONE PEDESTAL/RISER 1 inch = 100 feet DESCRIPTION THE WOODS AT VIEWCREST - PROPOSED LOTS

BELLINGHAM "LOT DESIGN" CRITERIA. EXISTING LINE LEGEND —— · — = EXISTING EDGE OF ASPHALT —— — — = EXISTING EDGE OF CONCRETE --- = EXISTING EDGE OF GRAVEL ROAD ---- = EXISTING CURB ----- = EXISTING EDGE OF MASONRY PAVERS —— SD ———— = EXISTING STORM DRAIN LINE ———— SS ———— = EXISTING SANITARY SEWER GRAVITY LINE ———— w ———— = EXISTING WATER LINE ———— OHE ————— = EXISTING OVERHEAD ELECTRIC LINES ——— UGE ——— = EXISTING UNDERGROUND POWER = EXISTING OVERHEAD COMMUNICATIONS LINE = EXISTING UNDERGROUND GAS LINE = EXISTING TOP OF SLOPE LINE TOE . . . — = EXISTING TOE OF SLOPE LINE — = EXISTING GRADE INDEX CONTOUR = EXISTING GRADE INTERVAL CONTOUR ---- >>> ---- = EXISTING FLOW LINE = EXISTING WETLAND LINE — — — — — = EXISTING WETLAND BUFFER LINE ----- = EXISTING EDGE OF LANDSCAPED AREA = EXISTING BARBED WIRE FENCE

60'X60' BUILDING ENVELOPE PURSUANT TO BMC 23.08.060.D.1.

BUILDING ENVELOPE, BUT RATHER IS INTENDED TO REPRESENT

THAT THE NEW LOT HAS BEEN CONFIGURED TO MEET CITY OF

THIS AREA DOES NOT NECESSARILY REPRESENT THE ACTUAL

ANNE C. JONES FAMILY LP

807 CHUCKANUT SHORE ROAD BELLINGHAM, WA 98229

& ROADS & EXISTING CONDITIONS

FOR ANNE C. JONES FAMILY LP 807 CHUCKANUT SHORE ROAD BELLINGHAM, WA 98229

SITUATE IN A PORTION OF THE SW 1/4 OF THE SW 1/4 OF SECTION 12, AND THE NW 1/4 OF THE NW 1/4 OF SECTION 13, TOWNSHIP 37 NORTH, RANGE 2 EAST, CITY OF BELLINGHAM, WHATCOM COUNTY, WASHINGTON



PACIFIC SURVEYING & ENGINEERING, INC.

EASEMENT (SHOWN PER


FIELD BOOKS TJM/DML ASM DESIGN: XXX DESIGN STAKING: XXXASBUILT: XXXXXX909 Squalicum Way, Suite 111 | BELLINGHAM, WA 98225 HORIZ. SCALE: 1" = 100T: 360.671.7387 | F: 360.671.4685 VERT. SCALE: HORIZ.: N/A XXXwww.psesurvey.com | info@psesurvey.com

2019196


SHEET 4 OF


VERT.:


XXX





	1	10/14/2021	PRELIMINARY PLAT — EXISTING CONDITIONS EXHIBIT (FOR REVIEW)

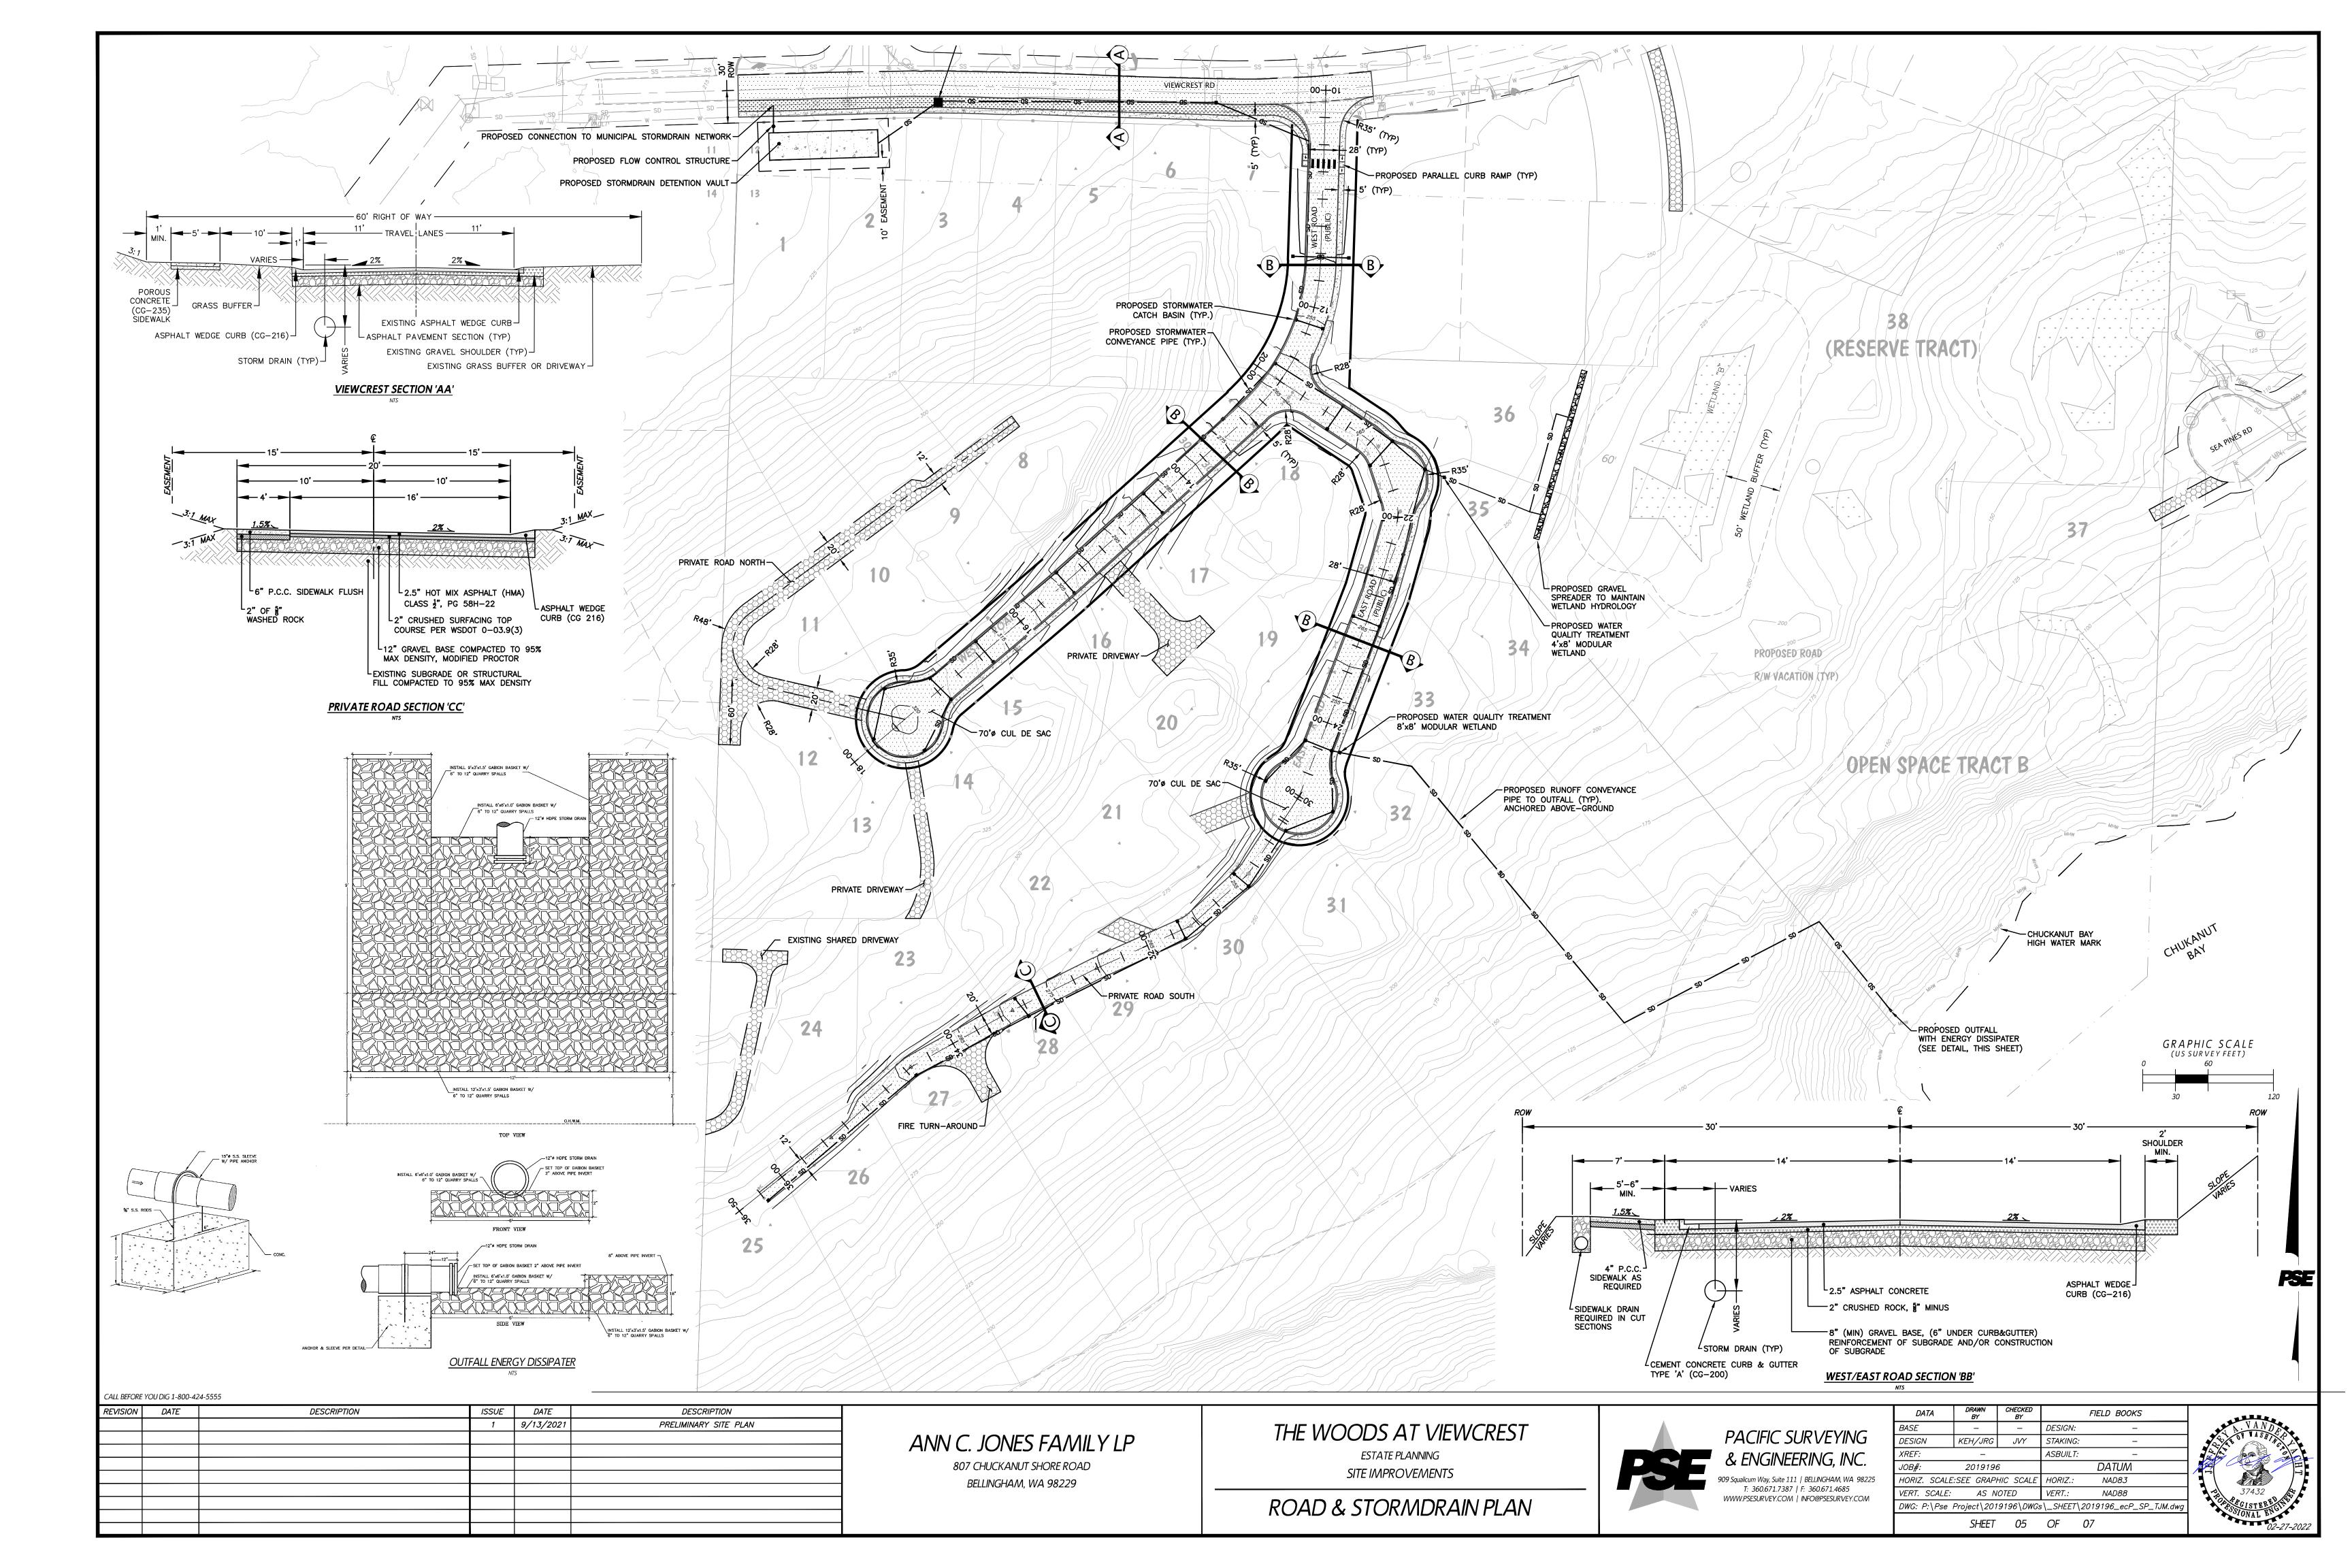

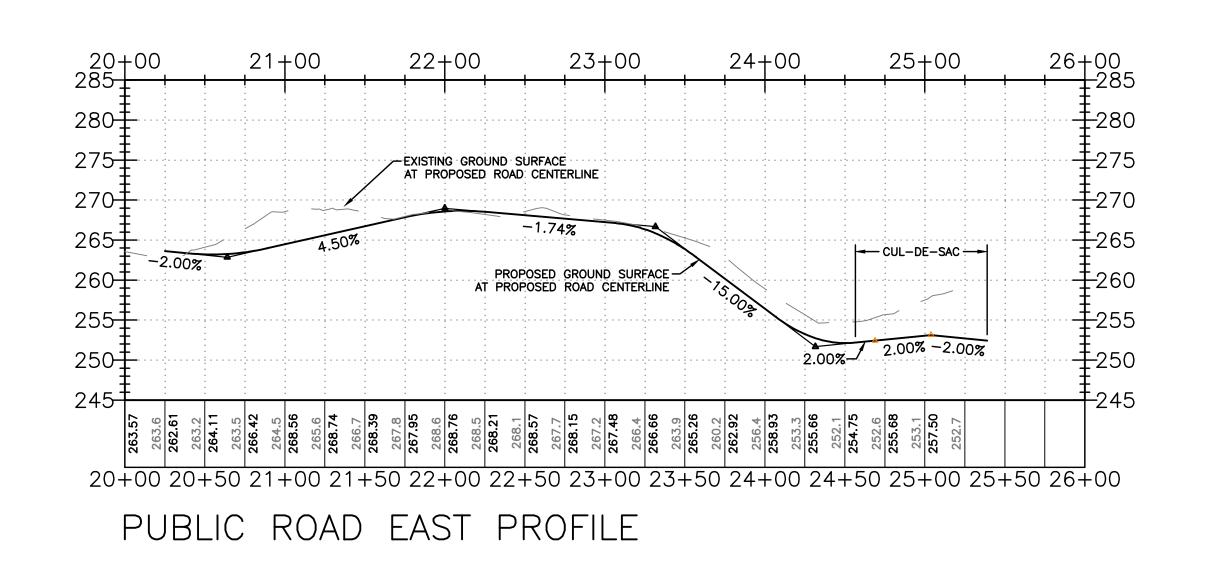

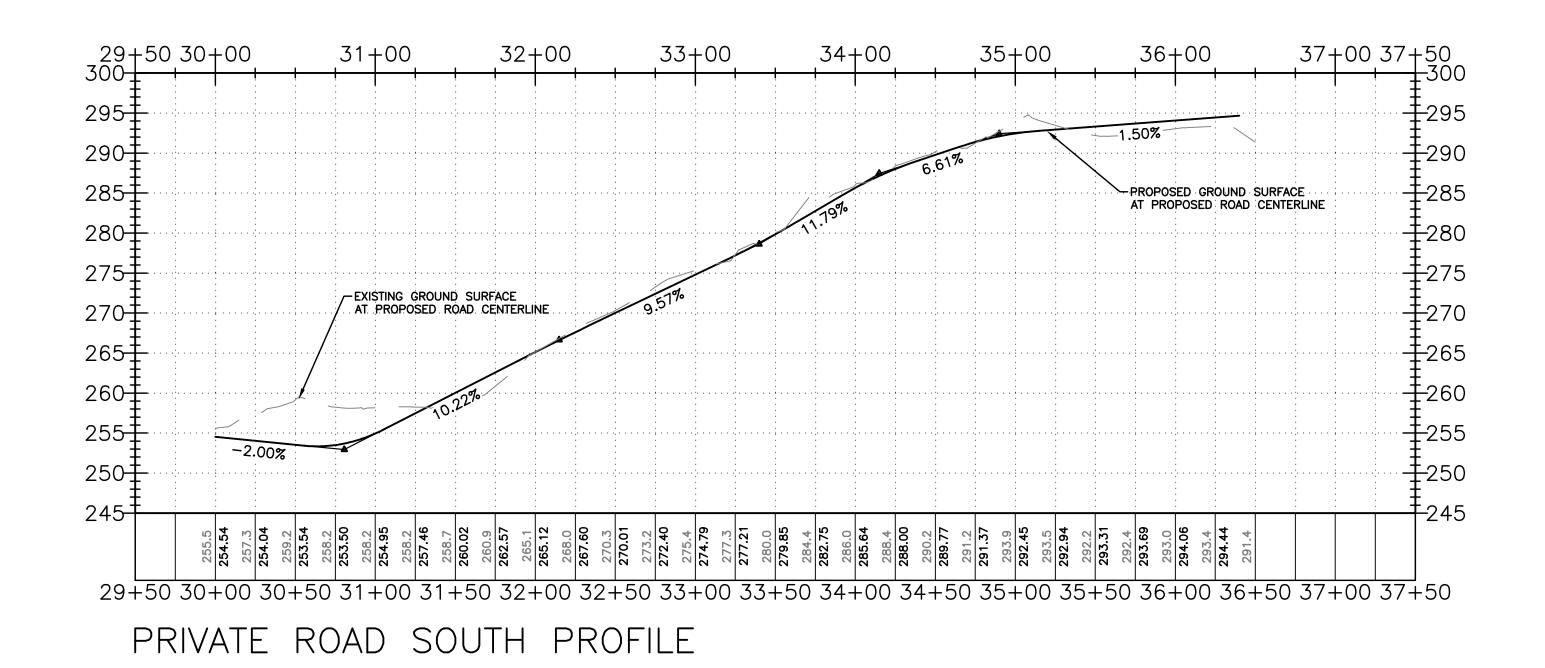

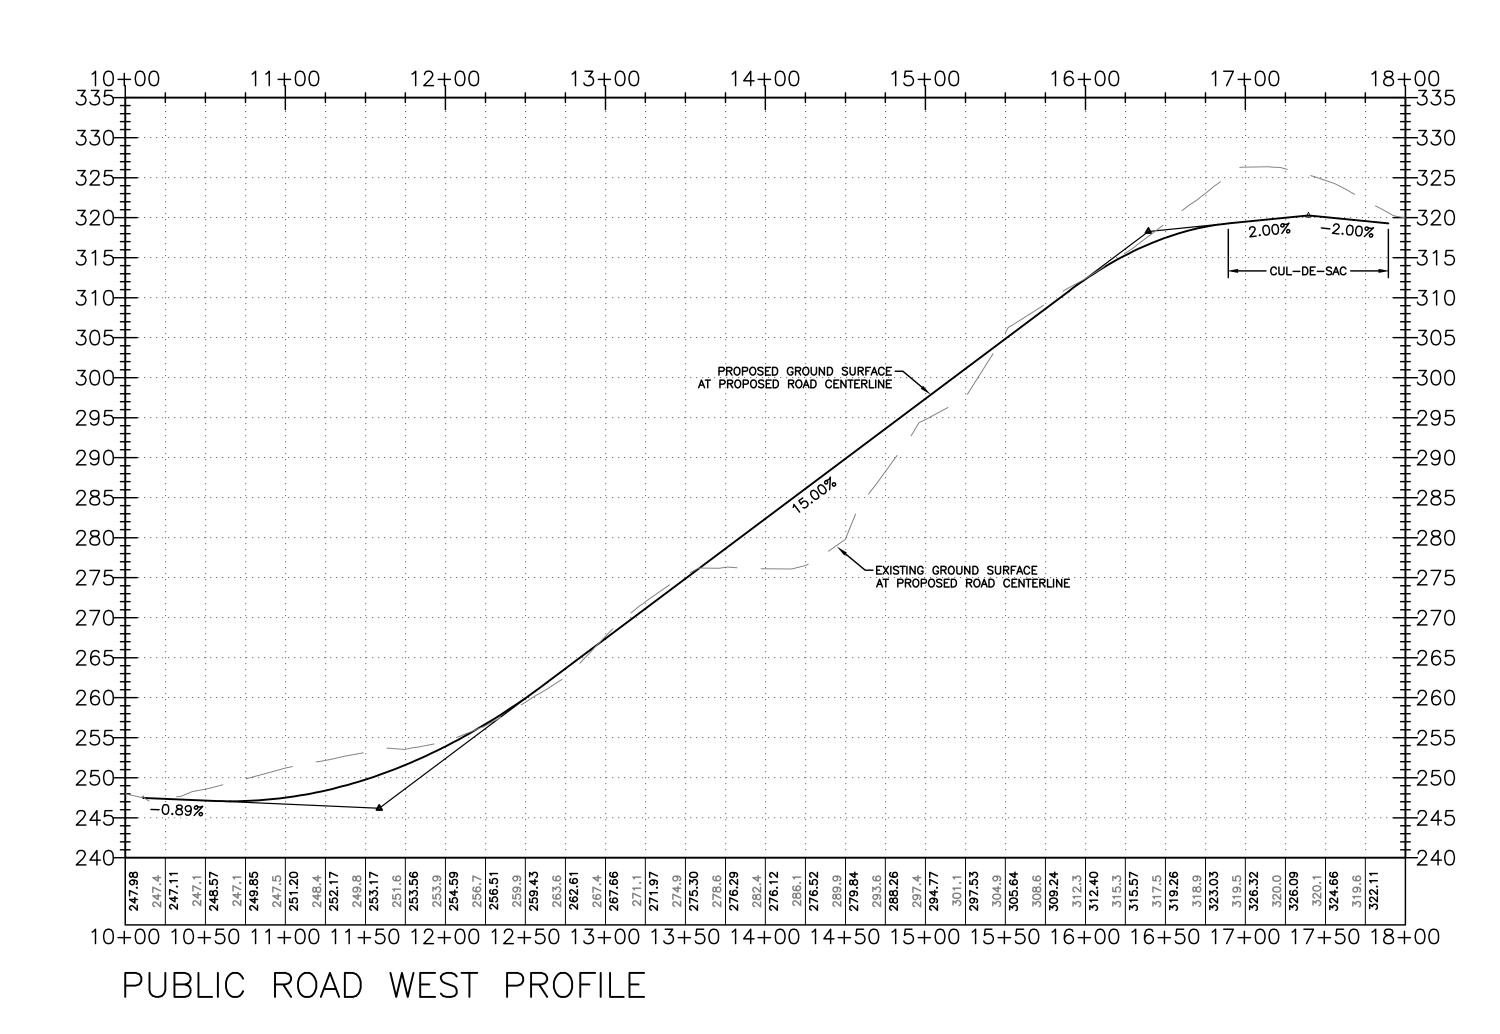



CALL BEFORE \	CALL BEFORE YOU DIG 1-800-424-5555								
REVISION	DATE	DESCRIPTION	ISSUE	DATE	DESCRIPTION				
			1	9/13/2021	PRELIMINARY SITE PLAN				

ANN C. JONES FAMILY LP 807 CHUCKANUT SHORE ROAD BELLINGHAM, WA 98229 THE WOODS AT VIEWCREST

ESTATE PLANNING


SITE IMPROVEMENTS

ROAD PROFILES



	DATA	DRAWN BY	CHECKED BY		FIELD BOOK	s
	BASE	-	1	DESIGN:	_	
	DESIGN	KEH/JRG	JVY	STAKING:	-	
	XREF:	_		ASBUILT:	_	
	JOB#:	2019196	6		DATUM	
25	HORIZ. SCALE	:SEE GRAPI	HIC SCALE	HORIZ.:	NAD83	
ı	VERT. SCALE:	AS N	OTED	VERT.:	NAD88	
	DWG: P:\Pse	Project\20	019196\DW	/Gs_SHE	ET\2019196_e	ecP_SP.dwg
		SHEET	06	OF	07	



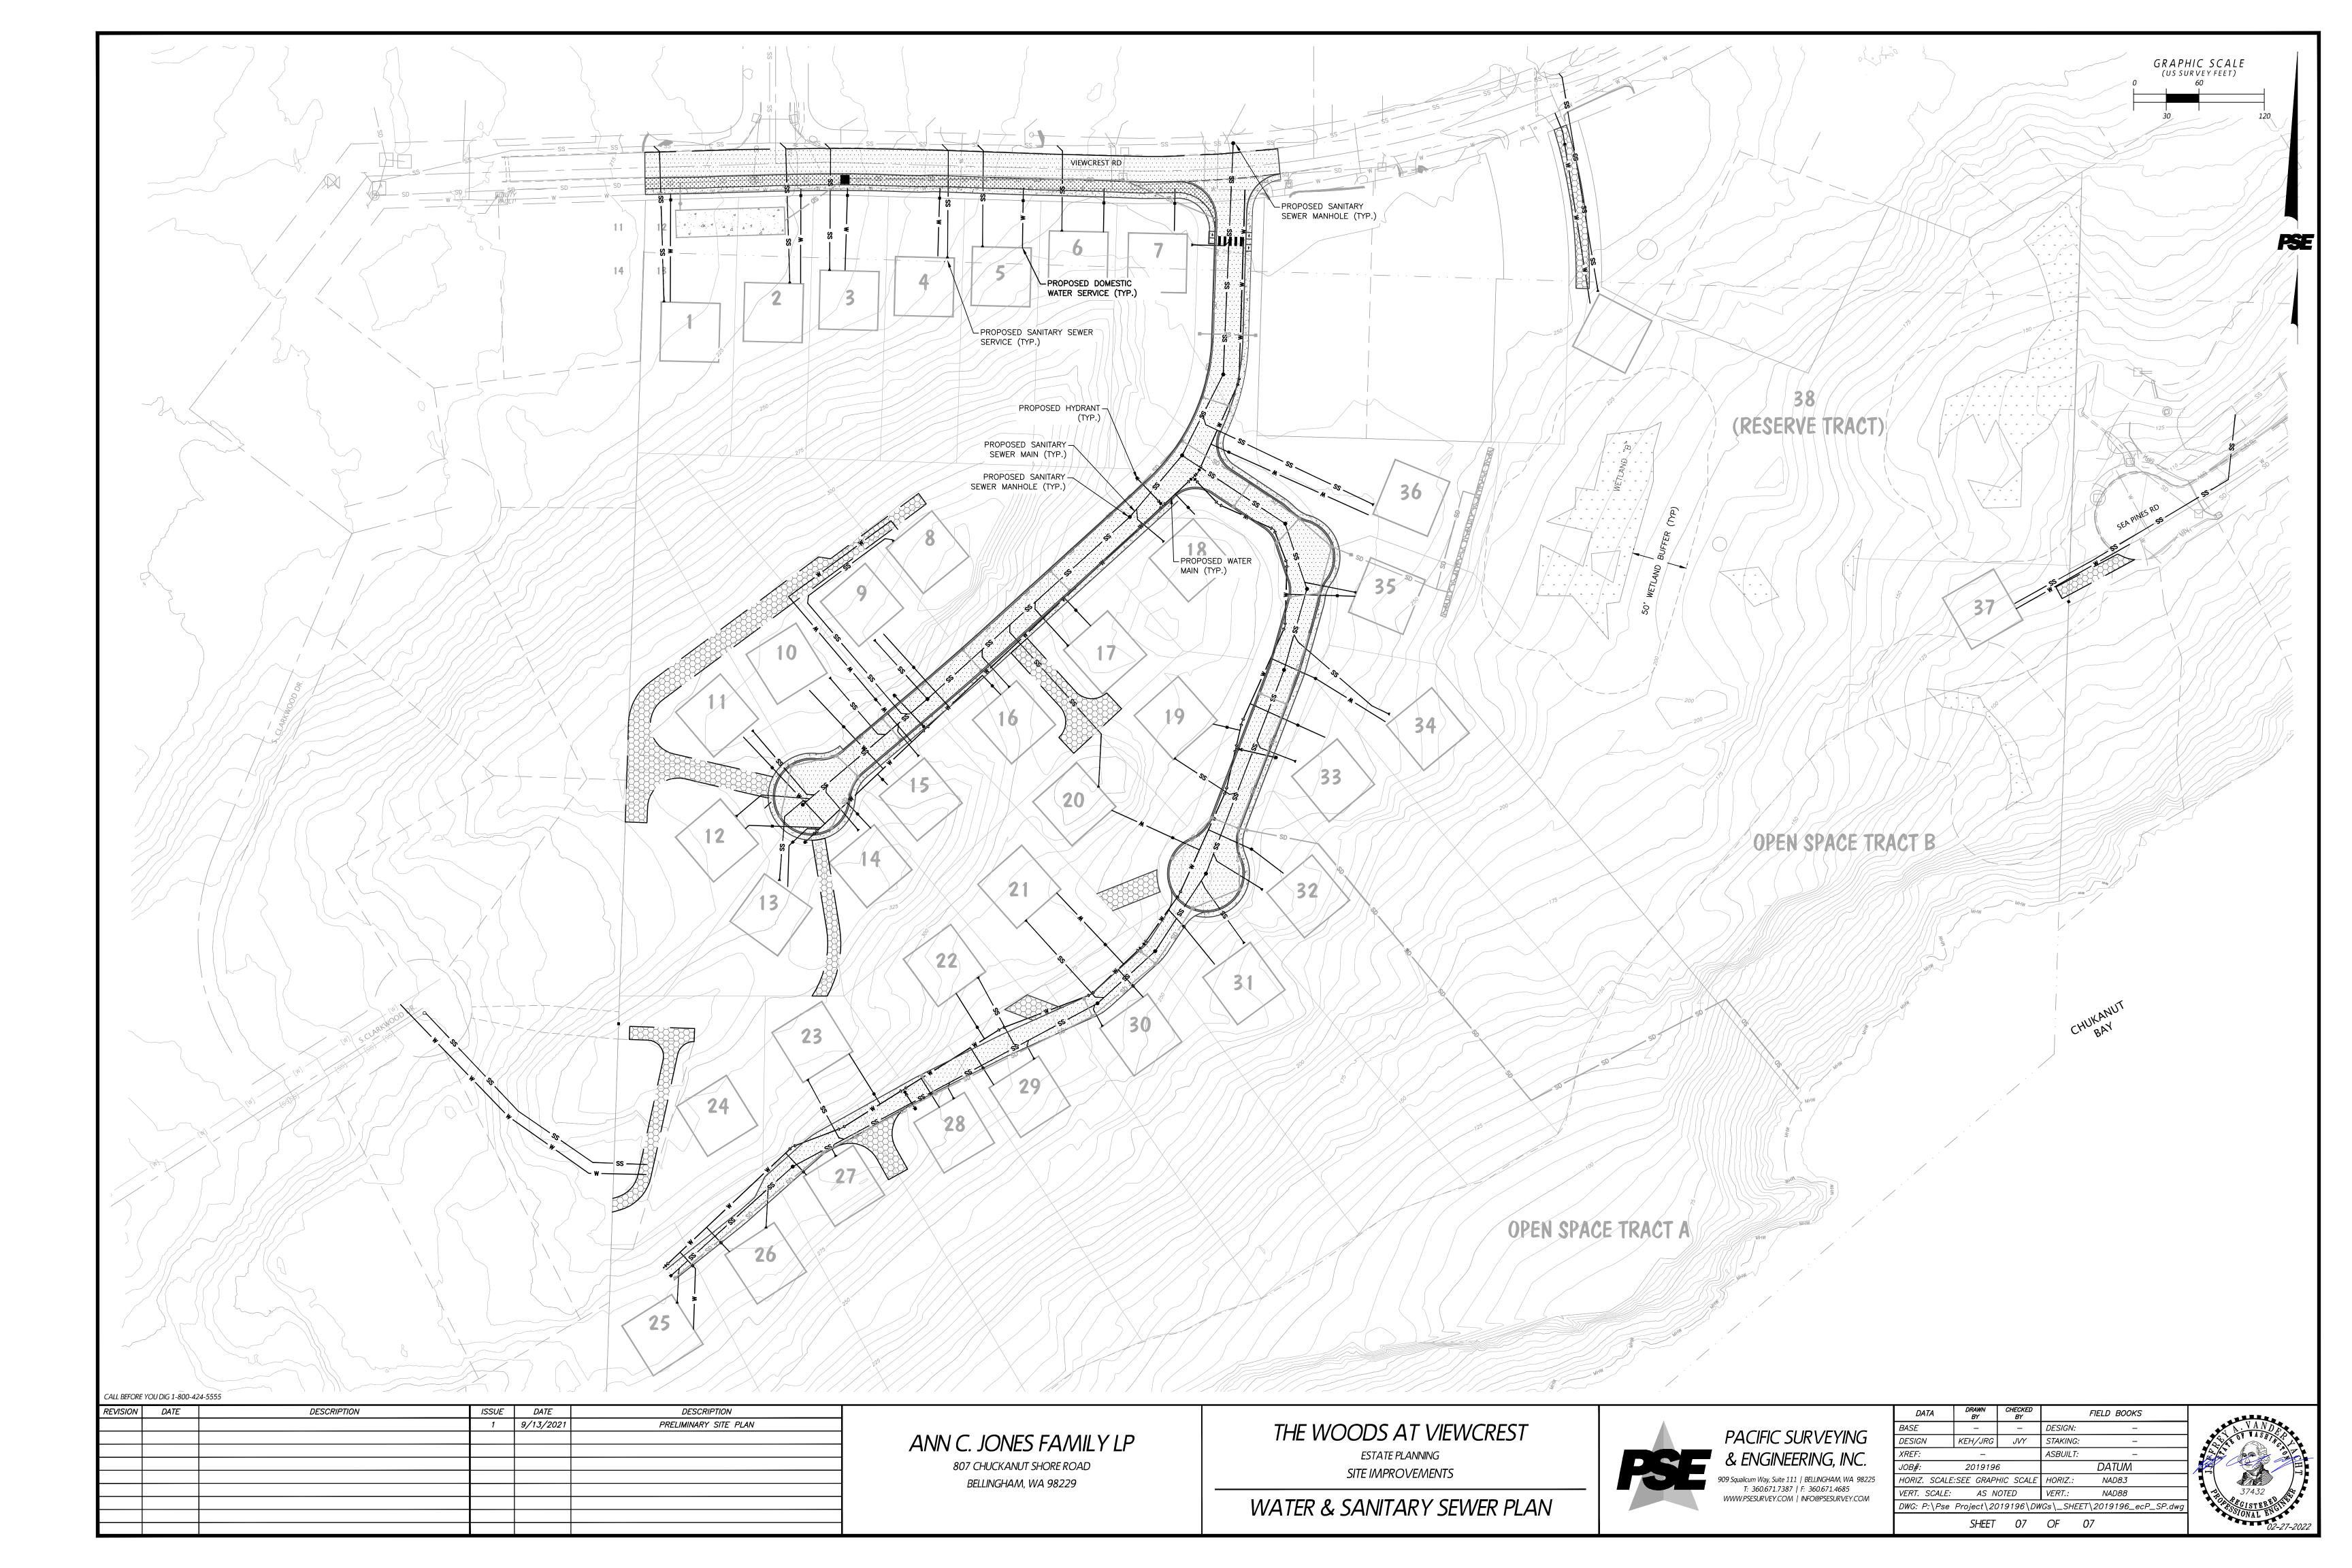

8.6 CRITICAL AREAS SUMMARY

MEMORANDUM

To: Susan Jones, Landowner

From: Collin Van Slyke, Northwest Ecological Services (NES)

Date: February 24, 2022

RE: Wetland Delineation Update & Critical Areas Summary

for The Woods at Viewcrest Project

BACKGROUND

Northwest Ecological Services, LLC (NES) was retained to provide an update to the 2010 Critical Areas Report for four parcels (#370212 030004; 370213 075542; -083499; - 113550) totaling approximately 34 acres, located in the Edgemoor neighborhood of Bellingham, Washington (Figure 1).

The parcels were reviewed for wetlands, streams, and other critical areas by Pacific Ecological Consultants in 2010. One wetland (Wetland A) was identified on site during the 2010 review. Since the critical areas report was prepared more than five years ago, an update is needed for projects involving critical area review.

Collin Van Slyke [Professional Wetland Scientist (PWS) #3129] and Michael Whitehurst, of NES, performed site visits June 22nd and 26th of 2020 and August 31st of 2021 to document the current site conditions. The NES site investigation was conducted in accordance with the *Regional Supplement to the Corps of Engineers Wetland Delineation Manual: Western Mountains, Valleys, and Coast Region* (Corps, 2010) and the *Corps of Engineers Wetland Delineation Manual* (Environmental Laboratory, 1987). This methodology is consistent with the WDOE's requirements established in 2011 (WAC 173-22-035) and the City of Bellingham (COB) Critical Areas Ordinance (CAO).

CURRENT CONDITIONS

The subject parcels are situated on a slope along the northwestern shore of the Chuckanut Bay Tidelands. The site generally exists in the same undeveloped and forested condition that was documented in the 2010 critical areas report. The exception to this is in a localized area in the central portion of the site where the forest understory was burned during a wildfire that occurred in 2019. In general, the site is vegetated with a mixed upland forest dominated by Douglas fir (*Pseudotsuga menziesii*), big leaf maple (*Acer macrophyllum*), salal (*Gaultheria shallon*), and sword fern (*Polystichum munitum*).

The 2010 report identified one slope wetland (Wetland A) in the northeastern corner of the site. NES observed Wetland A and also identified three additional slope wetlands (Wetlands B, C, and D) located in the nearby vicinity (Figure 2). NES collected data documenting wetland vegetation, soils, and hydrology indicators in each wetland (see attached data sheets). NES





nwecological.com | t 360.734.9484

delineated and marked the wetland boundaries in the field with pink flagging. The flags were surveyed by Pacific Survey and Engineering, Inc. (PSE) to produce Figure 3.

The site wetlands are summarized in Table 1 and described below.

Table 1. Wetland Classification Summary

Wetland	Hydrogeomorphic Class	Cowardin Classification	Size (square feet)		
А	Slope	PFO	12,358		
В	Slope	PFO	9,476		
С	Slope	PFO	991		
D	Slope	PEM/PSS	1,813		

PFO: Palustrine Forested, PEM: Palustrine Emergent, PSS: Palustrine Scrub Shrub

Wetland A

Wetland A is a palustrine forested (PFO) slope wetland located in the northeastern corner of review area. Vegetation within Wetland A includes: red alder (*Alnus rubra*), Cascara (*Frangula purshiana*), salmonberry (*Rubus spectabilis*), black twinberry (*Lonicera involucrata*), Scouler's willow (*Salix scouleriana*), snowberry (*Symphoricarpos albus*), American skunk cabbage (*Lysichiton americanus*), American brooklime (*Veronica americana*), lady fern (*Athyrium filix-femina*), giant horsetail (*Equisetum telmateia*), Cooley's hedge nettle (*Stachys cooleyae*), Watson's willowherb (*Epilobium ciliatum*), creeping buttercup (*Ranunculus repens*), small bedstraw (*gallium trifidum*), and bluegrass (*Poa sp.*). Invasive species, Himalayan blackberry (*Rubus armeniacus*) and Canada thistle (*Cirsium arvense*), were also present within Wetland A.

Hydrology to Wetland A appears to be driven by surface runoff and a groundwater seep. The wetland is seasonally saturated but also contains seasonal or occasional shallow water flowing-through above or just below the soil surface. Soil in the northern portion of the wetland was saturated to the surface at the time of the June site visit, but the remainder was dry due to the time of year. Water moves through the wetland from northwest to southeast. The wetland outlets to a ditch located between a residential driveway and the eastern wetland boundary. Water from the ditch flows east into a culvert under the driveway and is conveyed south towards Chuckanut Bay.

Wetland B

Wetland B is a PFO slope wetland located west of Wetland A. Wetland B is situated on an approximate seven degree slope, grading down to the southeast. The area flagged as Wetland B is contains two small upland hummocks located within the central area. Only one larger upland island was flagged within the wetland (Figure 3).

Vegetation observed in the wetland included: black cottonwood (*Populus balsamifera*), western red cedar (*Thuja plicata*), red alder, and Scouler's willow, Himalayan blackberry, American brooklime, and American skunk cabbage. Much of the ground within the wetland was bare.

The upland hummocks were vegetated with Douglas fir, salal, oceanspray (*Holodiscus discolor*), beaked hazelnut (*Corylus cornuta*), sword fern, and small bedstraw.

The wetland appears to be seasonally saturated only. Again, hydrology appears to be driven by surface runoff and a potentially a groundwater seep. Wetland B slopes down to the southeast to an old road grade, where water from the wetland appears to infiltrate.

Wetland C

Wetland C is a very small PFO slope wetland located between Wetlands A and B. The wetland contains almost no vegetation with the exception of a few red alder, red-osier dogwood, Scouler's willow, and snowberry.

The wetland was dry at the time of the site visits but appears to be seasonally saturated only. The wetland is located on an approximate five percent grade. Water from the wetland appears to outlet to the south and infiltrate into the forested upland.

Wetland D

Wetland D is a palustrine emergent/scrub-shrub (PEM/PSS) slope wetland located in the southeastern portion of the review area. Dominant vegetation within Wetland D included Nootka rose (*Rosa nutkana*), hardhack (*Spirea douglasii*), Himalayan blackberry, and black twinberry, giant horsetail, water parsley (*Oenanthe sarmentosa*), and American skunk cabbage.

Hydrology within Wetland D is similar to the other site wetlands with inputs including surface runoff and groundwater surfacing along the hillside. Water within Wetland D flows downslope to a rock headwall/boulder formation towards the grade break near the southern boundary of the review area. No surface connection to Chuckanut Bay was observed.

WDOE Ratings

NES rated the site wetlands using the updated 2014 Washington Department of Ecology (WDOE) Wetland Rating System for Western Washington. Wetland rating sheets are attached and summarized below in Table 2.

Table 2. Wetland Rating and Functional Assessment

Wetland	Improving Water Quality	Hydrologic	Habitat	Total Score	WDOE Category
А	L/M/L (4)	M/M/L (5)	L/L/M (4)	13	IV
В	L/M/L (4)	L/M/L (4)	L/L/M (4)	12	IV
С	L/L/L (3)	L/L/L (3)	L/L/M (4)	10	IV
D	L/L/L (3)	L/L/L (3)	L/L/M (4)	10	IV

Site potential score /landscape potential score/ value score (total points for function) L=Low; M=Moderate, H=High

Streams, Shorelines, and Habitat Conservation Areas (HCAs)

Wetlands A and B contain large woody debris and snags meeting the Washington Department of Fish and Wildlife (WDFW) definition of Priority habitat features. Pileated woodpecker

(*Dryocopus pileatus*), a state Priority and Candidate listed species, excavations were observed within a snag in Wetland A. Due to the slope and lack ponding, no amphibian breeding habitat is assumed present within the any of the site wetlands.

A groundwater seep was observed in the central portion of the review area (Figure 3, Appendix B). Groundwater surfacing from a slight cut in topography flows downslope along an unvegetated trail. As documented in SP 102 (data sheets attached) this area did not contain hydric soil indicators and therefore does not meet wetland criteria.

No streams were mapped on-site in 2010 and none were observed during the 2020 site visit.

Chuckanut Bay is located along the entire southern boundary of the site. The ordinary high water mark (OHWM) along this shoreline is defined by exposed sandstone bedrock located at the toe of a moderately steep slope. The unvegetated bedrock wall is sux to ten feet tall. The OHWM was not marked in the field (it would require spray painting the rock), but was mapped in Figure 2 using aerial imagery, LiDAR, and field notes. The beach and intertidal zone were unvegetated and the substrate consisted of a mix of cobble, gravel, and silt. Chuckanut Bay is mapped by WDFW to contain hardshell clam and shorebird concentrations (Priority Species/Habitats). No other Priority habitats or species are mapped or were identified on site.

DETERMINATION & REGULATORY SUMMARY

Table 3 summarizes agencies with regulatory authority over site critical areas and the anticipated buffers.

Factions	WDOE Catagory/		Regulatory	Come	Regulated Buffer (ft)*		
Feature	Category/ Shoreline Designation	COB Corps		WDOE WDFW			Corps Hydrology Classification
Wetland A	IV	Х	Х	Х		Isolated	50
Wetland B	IV	Х		Х		Isolated	50
Wetland C	IV			Х		Isolated	n/a
Wetland D	IV	Х		Х		Isolated	50
Chuckanut Bay	Natural	Х	Х	Х	Х	TNW	200

TNW= Traditional Navigable Water

City of Bellingham

The COB regulates all wetlands, regardless of size, with the exception of isolated Category III or IV wetlands smaller than 1,000 sq. ft. that do not provide suitably significant or unique characteristics as defined by the CAO (BMC 16.55.270). Wetlands A, B, and D are greater than 1,000 sq. ft. and are therefore expected to be regulated by the COB.

^{*} Buffer based on high intensity land use

Wetland C is a Category IV wetland and is smaller than 1,000 sq. ft. Therefore, Wetland C is not expected to be regulated by the COB and no buffer is required.

The COB requires a buffer around regulated critical areas to protect functions. The buffer must remain naturally vegetated except where it can be enhanced to improve functions. It appears that a high intensity land use would apply to the proposed project based on housing density. Wetlands A and B are Category IV wetlands with low (four) habitat points. According to BMC 16.55.340(B), Wetlands A, B, and D are expected to require 50-foot standard buffers (Figure 2).

The COB CAO regulates Chuckanut Bay as an HCA. The COB Shoreline Management Program (SMP) designates this reach of shoreline (Marine 19) with a Natural designation. <u>The SMP requires a regulated buffer of 200 feet extending from the Chuckanut Bay OHWM.</u>

WDOE

WDOE has authority over discharge into all wetlands (including isolated wetlands) and streams and can impose buffers and compensatory mitigation for impacts (RCW 90.48).

Under Section 401 of the Clean Water Act (CWA), any activity involving a discharge into waters of the U.S. authorized under a Federal permit must receive a CWA Section 401 Water Quality Certification (WQC). WDOE is authorized to make WQC decisions on federal, public and privates lands in Washington, with a few exceptions (where EPA or Tribes have authority). WDOE reviews all CWA Section 404 permit applications received by the Corps for WQC. WDOE requires an "individual" review of all wetland disturbances greater than one-half acre, or for projects in tidal waters or where impacts to wetlands and streams are determined to require additional review.

WDFW

The WDFW requires issuance of a Hydraulic Project Approval (HPA) prior to any activities that may directly or indirectly affect streams or associated wetlands. WDFW is not expected to regulate the site wetlands due to lack of direct connectivity to a stream. WDFW is expected to regulate any activities proposed below the OHWM of Chuckanut Bay. Only the WDFW has the authority to make this determination. Mitigation may be required for impacts.

U.S. Army Corps of Engineers

The Corps regulates the discharge of dredged or fill material into wetlands, streams, and other drainages that connect to Waters of the United States (WOTUS) under Section 404 of the CWA. The Corps regulates structures and/or work in or affecting the course, condition, or capacity of WOTUS under Section 10 of the Rivers and Harbors Act of 1899. The Corps requires notification for <u>all</u> disturbances to wetlands, streams, and potentially to other drainages (ditches). It is incumbent upon the landowner to disclose disturbances.

The Corps will automatically assert jurisdiction over some surface waters and will need to complete a "significant nexus" determination for others, depending on the degree of connection to other waters, the hydrologic classification of these associated waters, and their significance in the larger drainage basin. Wetland hydrologic classification and connectivity is described in this

report as the "Corps hydrologic classification" (Table 3) using definitions provided in current Corps guidance documents.

The Corps hydrologic classification is based on whether a surface water meets the definition of or is connected to a waterbody that meets the definition of a Traditional Navigable Water (TNW) or a Relatively Permanent Water (RPW). A TNW is a navigable water protected under Section 10 of the Rivers and Harbors Act of 1899 or other waters currently or historically used or susceptible to use in interstate or foreign commerce. An RPW is a surface stream or river that exhibits continuous flow of more than three months out of the year.

Only the Corps has the authority to make jurisdictional determinations; however, the following is a description of the anticipated determinations. Water outflowing from Wetlands B, C, and D appears to infiltrate into downslope upland areas. No direct surface connections to Chuckanut Bay (a TNW) were observed. Therefore, Wetlands B, C, and D are not anticipated to be regulated by the Corps. Wetland A outlets water to a ditch which conveys water to a culvert, eventually outfalling to Chuckanut Bay. This ditch does not appear to meet the definition of a tributary or RPW and therefore, the Corps may potentially not regulate Wetland A. However, a Jurisdictional Determination (JD) would need to be made by the Corps to confirm this if impacts to Wetland A were proposed.

Activities in Waters of the United States that require Corps authorization may qualify for authorization under one of the general Nationwide Permits (NWPs) if the activities meet the criteria. In the more commonly used NWPs, discharge (fill) is limited to under 1/2 acre of wetland, 300 linear feet of stream, and 1/3 acre of tidal waters. Discharge exceeding the NWP thresholds requires an Individual Permit from the Corps. Mitigation is required for most activities. The Corps also has discretion to disallow disturbance to high quality wetlands. As part of their permit review, the Corps must verify the project complies with Section 7 of the Endangered Species Act, the Magnuson-Stevens Fishery Conservation and Management Act, and Section 106 of the National Historic Preservation Act, (including archeological sites).

Site Plan


The preliminary plat (Attachment 4) depicts the proposed lot layout, roads, and future building sites. As depicted, the plat avoids impacts to all critical areas and buffers identified in this report.

ATTACHMENTS

Figures:

- 1. Vicinity Map
- 2. Critical Areas Overview Map
- 3. Wetlands Survey Map
- 4. Preliminary Plat

Photo Page
Data Sheets
Current WDOE Rating Forms

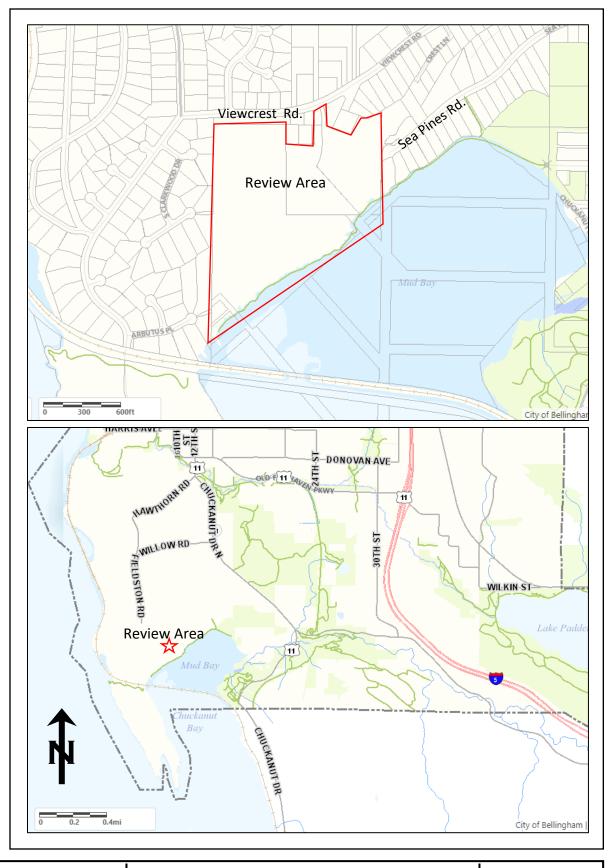






Vicinity Map (Google Maps)


The Woods at Viewcrest Critical Areas Report Figure 1


FEB 2022

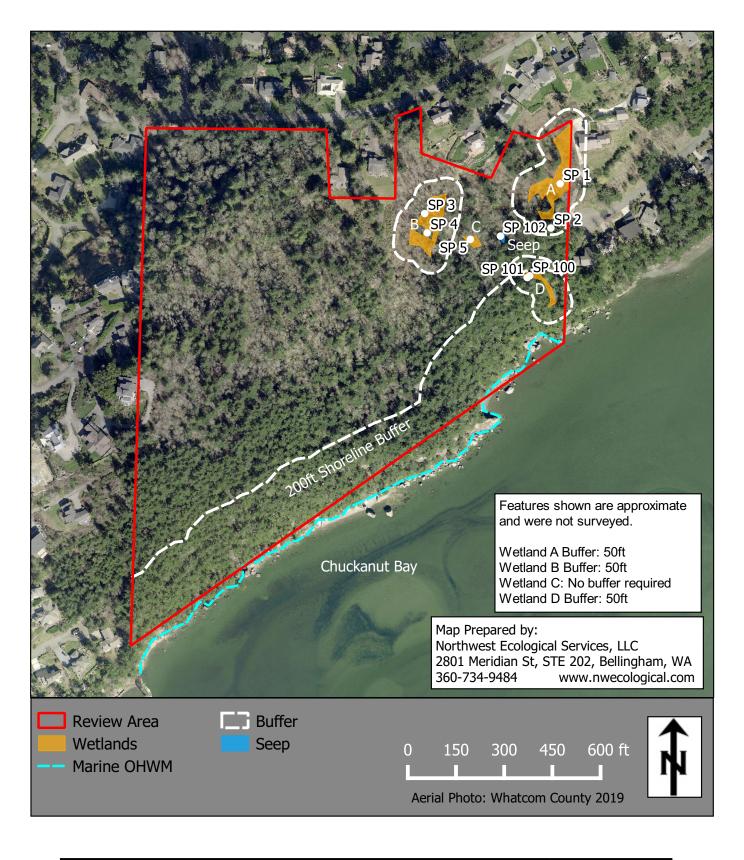


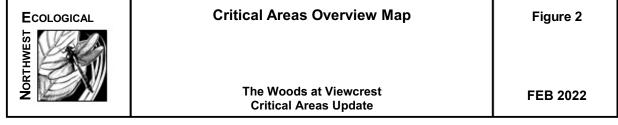

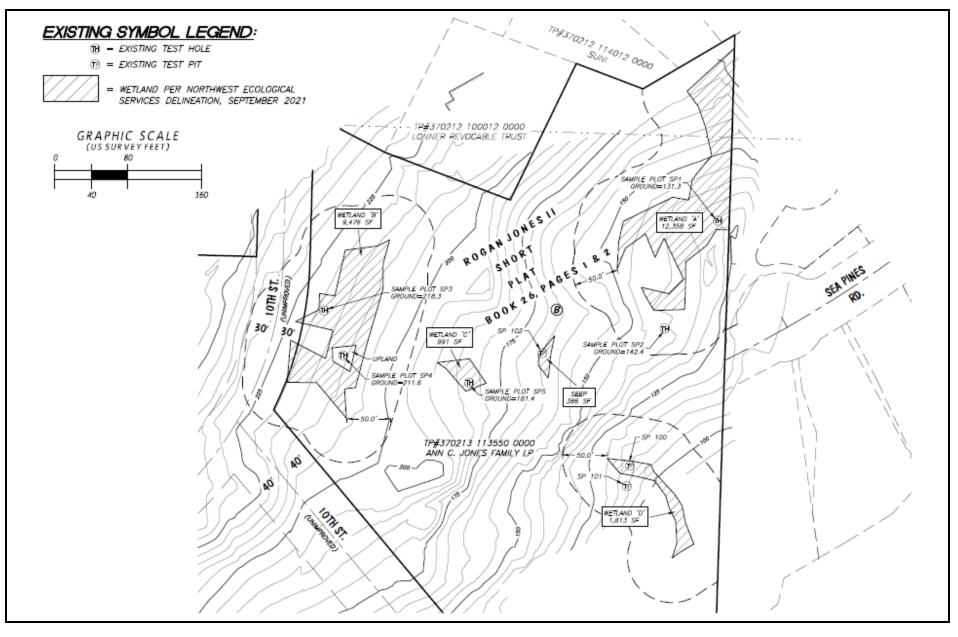

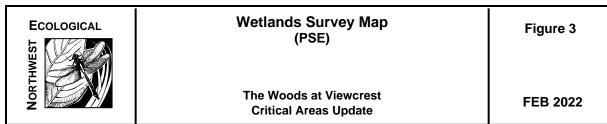

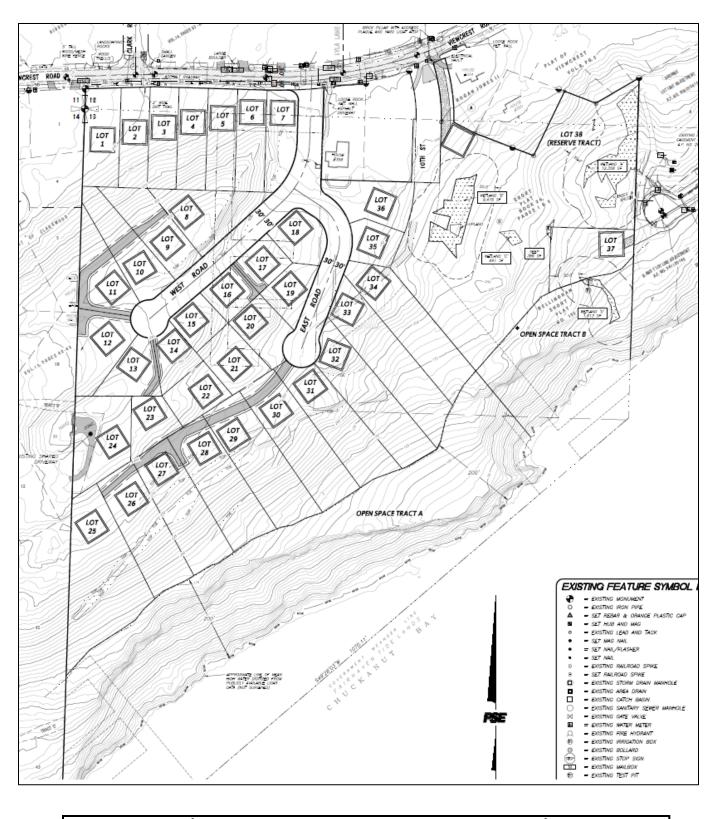

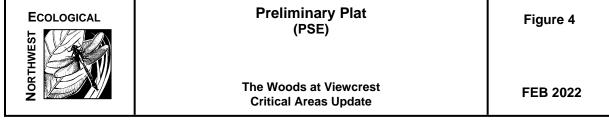



Detail of typical upland forest dominating most of site



Overview of Wetland A, looking west



Detail of area affected by past forest fire



Overview of Wetland A, looking northwest



Detail of Wetland B



Overview of Wetland C



Detail of Wetland B



Overview of Mud Bay shoreline and OHWM



Overview of Wetland D



Overview of seep



Detail of Wetland D outlet



Project Site: Viewcrest			City/Co	ounty: Belling	ham Sample Date:	06/22/20
Applicant/Owner: Jones				State: WA	Sample Point	: 01
Investigator: Van Slyke; Whitehurst			Section	n/Township/F	Range: 13/37N/02E	
Landform (hillslope, terrace, etc): sl	оре	Loca	al Relief (cor	icave, convex	, none): Subre	gion: LRR A
Soil Map Unit Name: Everett-Urban	land complex				NWI Classification: non	е
Are climatic/hydrologic conditions o			-			
Are Vegetation , Soil , or Hyd		-			Circumstances" present? Yes	
Are Vegetation, Soil, or Hydi	ology 🔲 natura	lly problema	tic? (If needed, ex	plain any answers in Remarks	5.)
SUMMARY OF FINDINGS - A	Attach site map	showing s	ampling p	oint location	ns, transects, important fe	atures, etc.
Hydrophytic Vegetation Present?	Yes No [_		le the	Sampled Area within a Wetlar	nd2
Hydric Soil Present?	Yes No [_		is tile	Yes ⊠ No □	iu:
Wetland Hydrology Present?	Yes 🛛 No [100 🖂 110 🖂	
Remarks: Wetland A. Positive indica	ators for all three	parameters	were obser	ved at this lo	cation.	
VEGETATION						
Tree Stratum (Plot size: 30 feet)		Absolute % Cover	Indicator Status	Dominant Species?	Dominance Test worksheet Number of Dominant Specie	
Alnus rubra		90	FAC	\boxtimes	that are OBL, FACW, or FAC	
Rhamnus purshiana		5	FAC			5+
			-			(A)
			-		Total number of dominant	8
	Total Cover:	95			species across all strata:	(AB)
Sapling/Shrub Stratum (Plot size: 1	5 feet)				Percent of dominant specie	s 62+
Symphoricarpos albus		20	FACU		that or OBL, FACW, FAC:	02.
Rubus spectabilis		15	FAC			(A/AB)
Lonicera involucrata		10	FAC		Prevalence Index workshee	1
			-		OBL species:	x 1=
			-		FACW species:	x 2=
	Total Cover:	45			FAC species:	x 3=
Herb Stratum (Plot size: 5 feet)		00			FACU species:	x 4=
Poa sp.		60	-		UPL species:	x 5=
Lysitchiton americanus Equisetum telmateia		20 20	OBL FACW		Total: (A)	(B
		_	_		Prevalence Index = B/A =	
Athyrium filix-femina		10	FAC		Hydrophytic Vegetation Indi	
Cirsium arvense		10	FAC		Dominance Test is > 50	
Veronica americana	Total O	5	OBL	$\sqcup \sqcup$	Prevalence Index is ≤3.0	
Woody Vine Stratum (Plot size: 30 f	Total Cover: eet)	125			Morphological Adaptation	
Rubus armeniacus		5	FAC	×	separate sheet) Wetland Non-Vascular F	Plante1
			-		Problematic Hydrophytic	
			-		Indicators of hydric soil and we	_
	Total Cover:	5			must be present.	
% Bare Ground in Herb Stratum: 0						
Remarks: The majority of dominant	species observe	d at this loca	ation were h	ydrophytic.	Hydrophytic Vegetation	on Present?
Poa species is undetermined.					riyaropriyao regetati	on i resenti

SOIL Sample Point: 01

D (1) D 1 11	/B '' ' '' '	 	e	

Depth	Soil Cold	or		Re	edox Featur	es							
(inches)	Color (moist)	%	Color	(moist)	oist) % T		Loc2	Text	ure	Remarks			
0-8	10YR 2/2	95		R 4/6	5	C	М	silt lo					
8-16	2.5Y 4/2	60		YR 5/6 40		С	М	sandy silt					
							_	loa	m				
						-	-						
							-						
						-	-						
						-	-						
						-	-						
¹Type: C=	concentration D=	depletion=	RM=red	uced matri	x ² Locatio	on: PL=po	re lining F	RC=root	chan	nel M=matrix			
Hydric So	il Indicators: (app	licable to	all LRRs	unless oth	erwise note	d)			Indi	cators for Problematic Hydric Soils3			
☐ Histos	sol (A1)		[Sandy R	edox (S5)				_	2 cm Muck (A10)			
☐ Histic	Epidedon (A2)		[Stripped	Matrix (S6)					Red parent material (TF2)			
□ Black	Histic (A3)		[Loamy N	lucky Miner	al (F1) (e	xcept MLI	RA 1)	□ '	Very shallow dark surface (TF12)			
☐ Hydro	gen Sulfide (A4)		_Loamy G	leyed Matrix	(F2)				Other (Explain in Remarks)				
□ Deplet	ted Below Dark S	urface (A1	.1)	Depleted	d Matrix (F3)							
☐ Thick	Dark Surface (A1	2)	0	Redox D	ark Surface	(F6)							
☐ Sandy	Mucky Mineral ([Depleted	d Dark Surfa	ace (F7)				licators of hydrophytic vegetation ar				
☐ Sandy Gleyed Matrix (S4) ☐ Redox Depressions									wet	land hydrology must be present.			
	e Layer (if presen Type:	nt):					ı	Hvdric S	oil Pr	esent? Yes ⊠ No □			
	Depth (inches):							•					
HYDROL	.OGY												
	hydrology Indicate		is suffic	ient)						Secondary Indicators (2 or more required)			
•	ce Water (A1)	e indicator	is suille		selv Vegeta	ted Conca	d Concave Surface (B8)						
_	Vater Table (A2)				/ater-stained Leaves (B9) (except MLRA 1, 2,					1,2,4A, and 4B)			
Satura				4A and			Drainage Patterns						
_	marks (B1)			☐ Salt	Crust (B11)		☐ Dry-season Water						
_	ent Deposits (B2)		☐ Aqua	tic Inverteb	rates (B1	3)			Saturation Visible on Aerial			
_	Deposits (B3)	,		☐ Hydr	ogen Sulfid	e Odor (C	1)			Imagery (C9)			
_	Mat or Crust (B4)			☐ Oxidi	zed Rhizos	heres ald	ong living	roots (C	(3)	Geomorphic Position (D2)			
	eposits (B5)			☐ Prese	ence of Red	uced Iron	(C4)			Shallow Aquitard (D3)			
Surface Soil Cracks (B6)							Tilled Soil	s (C6)		Frost-heave Hummocks (D7)			
_	ation Visible on A		ery (B7)	Stun	ted or Stres	ses Plants (D1) (LRR A)				FAC-neutral (D5)			
				Othe	r (Explain in	Remarks	5)						
	ervations:												
	Vater Present?		_	epth (inche						Wetland Hydrology Present?			
	ble Present?	_	_	epth (inche						Yes ⊠ No □			
	n Present?				es): -10 (i				:c				
Describe	Recorded Data (s	stream gau	ige, mon	itoring well	, aeriai pho	tos, previ	ous inspe	ctions),	ır ava	ilable:			
Pomarke:	: Soil was saturate	od at 10 i	nohoc										

Project Site: Viewcrest			City/Co	unty: Belling	ham Sample Da	Sample Date: 06/22/20		
Applicant/Owner: Jones			- 5	State: WA	Sample Po	Sample Point: 02		
Investigator: Van Slyke; Whitehurst			Section	n/Township/f	Range: 13/37N/02E			
Landform (hillslope, terrace, etc): sl	оре	Loca	al Relief (cor	cave, conve	k, none): Sub	oregion: LRR A		
Soil Map Unit Name: Everett-Urban	land complex				NWI Classification: r	none		
Are climatic/hydrologic conditions of	n the site typical	of this time	of year? Ye	s 🛛 No 🗌	(if no, explain in Remarks)			
Are Vegetation , Soil , or Hyd	rology 🗌 signific	cantly distur	bed? A	re "Normal (Circumstances" present? Ye	es 🛛 No 🗌		
Are Vegetation, Soil, or Hydi	ology 🗌 natural	lly problema	tic? (If needed, ex	plain any answers in Rema	rks.)		
SUMMARY OF FINDINGS - A	Attach site map	showing s	ampling p	oint locatio	ns, transects, important	features, etc.		
Hydrophytic Vegetation Present?	Yes No [✓						
Hydric Soil Present?	Yes 🛛 No [Is the	Sampled Area within a Wet	tland?		
Wetland Hydrology Present?	Yes 🗌 No 🏿	\boxtimes			Yes ☐ No ⊠			
Remarks: Upland adjacent to Wetla	nd A. Positive ind	licators for a	all three para	ameters were	not observed at this locati	ion.		
VEGETATION								
Tree Stratum (Plot size: 30 feet)		Absolute % Cover	Indicator Status	Dominant Species?	Dominance Test workshe			
Pseudotsuga menziesii		50	FACU	×	Number of Dominant Spe that are OBL, FACW, or Fa	AC-		
Thuja plicata		20	FAC	×	,,,	1		
			-			(A)		
			-	П	Total number of dominar	nt 5		
	Total Cover:	70			species across all strata:	(AB)		
Sapling/Shrub Stratum (Plot size: 1	5 feet)				Percent of dominant spe	cies		
Gaultheria shallon	•	65	FACU	Ø	that or OBL, FACW, FAC:	20		
Oemleria cerasiformis		40	FACU	\boxtimes		(A/AB)		
Corylus cornuta		15	FACU	П	Prevalence Index worksh			
Rosa gymnocarpa		10	FACU	П	OBL species:	x 1=		
			-	П	FACW species:	x 2=		
	Total Cover:	130			FAC species:	x 3=		
Herb Stratum (Plot size: 5 feet)			l .		FACU species:	x 4=		
Pteridium aquilinum		5	FACU	M	UPL species:	x 5=		
7.			-	П		A) (B)		
			-	П	Prevalence Index = B/A =	_		
			_	П	Hydrophytic Vegetation In			
			-		Dominance Test is >			
			-		☐ Prevalence Index is ≤			
	Total Cover:	5	-		☐ Morphological Adapta			
Woody Vine Stratum (Plot size: 30 f					supporting data in R separate sheet)			
			-		☐ Wetland Non-Vascula	ar Plants1		
			-		Problematic Hydroph	ytic Vegetation1		
			-		Indicators of hydric soil and	I wetland hydrology		
% Bare Ground in Herb Stratum: 20	Total Cover:	0			must be present.			
Remarks: The majority of dominant hydrophytic.		d at this loca	ation were n	ot	Hydrophytic Veget	ation Present?		

SOIL Sample Point: 02

Depth (inches) (inche	Soil Colo Color (moist)											
+1	Color (moist)		Color (moist)		dox Featur			_				
0-2		%	Col	or (moist)	%	Type ¹	Loc ²	Textu	ire	Remarks		
						-	-			Duff		
2-16	10YR 3/2	100				-	-	loar	n			
	10YR 6/1	99	2	.5Y 6/4	1	С	М	silt lo	am			
						-	-					
						-	-					
						-	-					
						-	-					
						-	-					
¹Type: C=co	ncentration D=	depletion	RM=re	duced matri	x ² Locatio	n: PL=po	re lining F	RC=root	chanı	nel M=matrix		
Hydric Soil I	Indicators: (app	licable to a	all LRR	s unless othe	erwise note	d)			Indi	cators for Problematic Hydric Soils3:		
Histosol	(A1)			☐ Sandy R	edox (S5)					2 cm Muck (A10)		
Histic Ep	idedon (A2)			Stripped	Matrix (S6)	1			□ F	Red parent material (TF2)		
☐ Black His	stic (A3)			Loamy M	lucky Miner	al (F1) (e:	cept MLF	RA 1)		ery shallow dark surface (TF12)		
Hydroger	n Sulfide (A4)			☐Loamy GI	eyed Matrix	(F2)				Other (Explain in Remarks)		
□ Depleted	d Below Dark S	urface (A1:	1)	☐ Depleted	d Matrix (F3)						
☐ Thick Da	ark Surface (A1	2)		☐ Redox D	ark Surface	(F6)						
☐ Sandy M	lucky Mineral (☐ Depleted	Dark Surfa	ace (F7)				icators of hydrophytic vegetation and				
Sandy Gl	Redox D	epressions	(F8)			wetl	and hydrology must be present.					
Restrictive I	Layer (if presen	nt):						ı				
Тур	pe:						H	lydric So	oil Pre	esent? Yes 🗌 No 🖂		
De	pth (inches):											
HYDROLOG	GY											
	drology Indicate	ors:								Secondary Indicators (2 or more		
	icators (any on		is suff	icient)						required)		
Surface \	Water (A1)			☐ Spars	sely Vegeta	ted Conca	ve Surfac	e (B8)		☐ Water-stained (B9) (MLRA		
☐ High Wat	ter Table (A2)				r-stained Le	eaves (B9	, 2,	1,2,4A, and 4B)				
Saturation	on (A3)			4A and 4	•		☐ Drainage Patterns (B10)					
■ Water ma	arks (B1)			_	Crust (B11)	. (54	Dry-season Water Table (C2)					
_	nt Deposits (B2	()		1 —	tic Inverteb		Saturation Visible on Aerial Imagery (C9)					
□ Drift Dep	oosits (B3)			1	ogen Sulfide					Geomorphic Position (D2)		
☐ A1~~1 * *	t or Crust (B4)			-	zed Rhizosp			roots (C	3)	Shallow Aquitard (D3)		
	☐ Iron Deposits (B5) ☐ Presence of							(00)		Frost-heave Hummocks (D7)		
☐ Iron Dep	Soil Cracks (B6				nt Iron Red			. ,		FAC-neutral (D5)		
☐ Iron Dep		erial Image	ry (B7	, —	ted or Stres r (Explain in			ik A)				
☐ Iron Dep	on Visible on A	_			· \=Apiuii III							
☐ Iron Dep												
☐ Iron Dep☐ Surface S☐ Inundation	vations:		No 🖂		es):							
☐ Iron Dep☐ Surface S☐ Inundation Field Observing Surface Water	vations: ter Present?	Yes 🔲 1	_	Depth (inche						Wetland Hydrology Present?		
☐ Iron Dep☐ Surface S☐ Inundation Field Observing Surface Water Table	vations: ter Present? e Present?	Yes 🔲 I	No 🖂	Depth (inche	es):		e capillary	fringe)		Wetland Hydrology Present? Yes □ No ⊠		
☐ Iron Dep☐ Surface S☐ Inundation Field Obsen Surface Wat Water Table Saturation F	vations: ter Present? e Present?	Yes 🔲 I Yes 🔲 I	No ⊠ No ⊠	Depth (inche Depth (inche Depth (inche	es):	(include	e capillary		if ava	Yes ☐ No ⊠		

Project Site: Viewcrest			City/Co	ounty: Belling	lingham Sample Date: 06/26/20					
Applicant/Owner: Jones			(State: WA	Sample Point	Sample Point: 03				
Investigator: Van Slyke; Whitehurst			Section	n/Township/f	Range: 13/37N/02E					
Landform (hillslope, terrace, etc): slo	ре	Loca	al Relief (cor	cave, conve	k, none): Subre	gion: LRR A				
Soil Map Unit Name: Nati Loam					NWI Classification: non	е				
Are climatic/hydrologic conditions or	the site typical	of this time	of year? Ye	es 🛛 No 🗌	(if no, explain in Remarks)					
Are Vegetation, Soil, or Hydro	ology 🗌 signifi	cantly distur	bed?	Are "Normal (Circumstances" present? Yes	⊠ No □				
Are Vegetation, Soil, or Hydro	ology 🔲 natura	lly problema	tic? (If needed, ex	plain any answers in Remarks	5.)				
SUMMARY OF FINDINGS - A	ttach site map	showing s	ampling p	oint locatio	ns, transects, Important fe	atures, etc.				
Hydrophytic Vegetation Present?	Yes 🛛 No [
Hydric Soil Present?	Yes 🛛 No [Is the	Sampled Area within a Wetlar	nd?				
Wetland Hydrology Present?	Yes 🛛 No [Yes 🛛 No 🗌					
Remarks: Wetland B. Positive indicate	tors for all three	parameters	were obser	ved at this lo	cation.					
VEGETATION										
Tree Stratum (Plot size: 30 feet)		Absolute % Cover	Indicator Status	Dominant Species?						
Alnus rubra		30	FAC	Species:	Number of Dominant Specie					
Acer macrophyllum		25	FACU		that are OBL, FACW, or FAC:	3				
Acer macrophynam		25	1 700			(A)				
			_		Total number of dominant	6				
	Total Cover:	55			species across all strata:	(AB)				
Sapling/Shrub Stratum (Plot size: 15		- 55	ļ.		Percent of dominant species	· '				
Symphoricarpos albus	, 1000	10	FACU	\square	that or OBL, FACW, FAC:	50				
Symphonical pool alloud			-			(A/AB)				
			_		Prevalence Index worksheet					
			-		OBL species: 20	x 1= 20				
			_		FACW species: 0	x 2= 0				
	Total Cover:	10			FAC species: 45	x 3= 135				
Herb Stratum (Plot size: 5 feet)	Total Cover.				FACU species: 40	x 4= 160				
Veronica americana		20	OBL	×	UPL species: 0	x 5= 0				
Rubus ursinus		5	FACU	×	Total: 105 (A)	315 (B)				
		-	-		Prevalence Index = B/A = 3					
			_	П	Hydrophytic Vegetation India					
			-		Dominance Test is > 50					
			-		Prevalence Index is ≤3.0					
	Total Cover:	25	-		☐ Morphological Adaptation					
Woody Vine Stratum (Plot size: 30 fe		25	I .		supporting data in Rem					
Rubus armeniacus		15	FAC	×	separate sheet)					
nadas armeniacus		10	-		─ Wetland Non-Vascular F					
			-		Problematic Hydrophytic	-				
	Total Cover:	15	-		 Indicators of hydric soil and we must be present. 	etland hydrology				
% Bare Ground in Herb Stratum: 80	iotal cover.	10			made so present					
Remarks: The majority of dominant s based on the prevalence index.	pecies observe	d at this loca	ation were h	ydrophytic	Hydrophytic Vegetation	on Present?				
					1					

Depth	Soil Cold	or		Re	edox Featu	res						
(inches)	Color (moist)	%	Col	or (moist)	%	Type ¹	Loc2	Texture		Remarks		
0-11	10YR 3/2	80	1	OYR 4/4	20	С	RC	fine sandy silt loam				
11-16	10YR 4/4	60	1	OYR 4/6	10	С	М	clayey	silt			
	2.5Y 5/3	30				-	-					
						-	-					
						-	-					
						-	-					
						-	-					
						-	-					
¹Type: C=	concentration D=	depletion	RM=re	educed matri	x ² Locat	ion: PL=po	re lining F	RC=root	chanr	nel M=matrix		
Hydric So	lydric Soil Indicators: (applicable to all LRR				erwise not	ed)			India	ators for Problematic Hydric Soil		
☐ Histos	ol (A1)	☐ Sandy R	edox (S5)					cm Muck (A10)				
Histic Epidedon (A2)				☐ Stripped	Matrix (Se	5)				Red parent material (TF2)		
Black	Histic (A3)			Loamy N	lucky Mine	eral (F1) (e:	cept MLI	RA 1)	□ V	Very shallow dark surface (TF12)		
☐ Hydrog	gen Sulfide (A4)			Loamy G	leyed Matr	ther (Explain in Remarks)						
Deplet	ed Below Dark S	urface (A1	.1)	☐ Depleted	d Matrix (F	3)						
Thick	Dark Surface (A1	2)		Redox D	ark Surfac	e (F6)						
☐ Sandy	Mucky Mineral (S	51)		□ Depleted	d Dark Sur	face (F7)				icators of hydrophytic vegetation		
Sandy	Gleyed Matrix (S	4)		☐ Redox D	epressions	s (F8)			weti	and hydrology must be present.		
Restrictiv	e Layer (if presen	t):	•									
•	Гуре:						ı	lydric So	il Pre	sent? Yes 🛛 No 🗌		
	Depth (inches):											
Remarks:	Soil at this locati	on met NI	RCS hy	dric soil indic	ator F6.							
HYDROL	OGY											
	nydrology Indicato dicators (any one		r is suff	icient)						Secondary Indicators (2 or more required)		
Surfac	e Water (A1)			☐ Span	sely Veget	ated Conca	ve Surfac	ce (B8)		☐ Water-stained (B9) (MLRA		
☐ High V	Vater Table (A2)			☐ Wate	r-stained I	Leaves (B9) (except	MLRA 1,	2,	1,2,4A, and 4B)		
☐ Satura	tion (A3)			4A and						☑ Drainage Patterns (B10)		
■ Water	marks (B1)			_	Crust (B11		☐ Dry-season Water Table (C2)					
Sedim Sedim	ent Deposits (B2))				brates (B1	Saturation Visible on Aerial Imagery (C9)					
Drift D	eposits (B3)	1 – 1	•	de Odor (C:								
🗌 Algal N	Mat or Crust (B4)	_		spheres ald	Geomorphic Position (D2) Shallow Aquitard (D3)							
_	eposits (B5)			_		duced Iron						
_	e Soil Cracks (B6					duction in	Frost-heave Hummocks (D7) FAC-neutral (D5)					
	ation Visible on A	erial Imag	ery (B7	, —		sses Plant		(K A)				
∐ Inunda				□ O+b o		n Remarks	٠١					

(include capillary fringe)

Water Table Present?

Saturation Present?

Yes ☐ No ☒ Depth (inches):

Yes No Depth (inches):

Remarks: Soil was damp but not saturated. Primary indictor C3 observed.

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Wetland Hydrology Present?

Yes 🛛 No 🗌

Project Site: Viewcrest				ounty: Belling			26/20
Applicant/Owner: Jones				State: WA	Sample Po	int: 04	
Investigator: Van Slyke; Whitehurst			Section	n/Township/F	Range: 13/37N/02E		
Landform (hillslope, terrace, etc): s	lope	Loca	al Relief (cor	icave, convex	r, none): Sub	region:	LRR A
Soil Map Unit Name: Nati Loam					NWI Classification: r	one	
Are climatic/hydrologic conditions of							
Are Vegetation 🔲, Soil 🔲, or Hyd	Irology 🗌 signifi	cantly distur	bed?	re "Normal C	Circumstances" present? Ye	s 🛛 N	
Are Vegetation 🔲, Soil 🔲, or Hyd	rology 🗌 natura	lly problema	tic? (If needed, ex	plain any answers in Rema	rks.)	
SUMMARY OF FINDINGS -	Attach site map	showing s	ampling p	oint locatio	ns, transects, important	feature	es, etc.
Hydrophytic Vegetation Present?	Yes 🗌 No [\boxtimes					
Hydric Soil Present?	Yes 🗌 No	\boxtimes		Is the	Sampled Area within a Wet	land?	
Wetland Hydrology Present?	Yes 🗌 No	\boxtimes			Yes 🗌 No 🖂		
Remarks: Upland island within Wet	land B. Positive in	ndicators for	all three pa	rameters we	re not observed at this loca	tion.	
VEGETATION							
Tree Stratum (Plot size: 30 feet)		Absolute	Indicator	Dominant	Dominance Test workshe	et	
		% Cover	Status	Species?	Number of Dominant Spe		
Alnus rubra		40	FAC		that are OBL, FACW, or F	AC:	1
Pseudotsuga menziesii		20	FACU				(4)
			-		T		(A)
	.		-	ш	Total number of dominar species across all strata:	τ	6
0	Total Cover:	60			-,		(AB)
Sapling/Shrub Stratum (Plot size: 1	L5 Teet)	00	FACU	~	Percent of dominant spe- that or OBL, FACW, FAC:	cies	17
Gaultheria shallon		60	FACU		alacol obe, more, I Ao.		(A (AB)
Oemleria cerasiformis		10	FACU				(A/AB)
Vaccinium parvifolium		5	FACU		Prevalence Index worksh		
			-		OBL species:	x 1:	
			-		FACW species:	x 2	
	Total Cover:	75			FAC species:	x 3:	
Herb Stratum (Plot size: 5 feet)					FACU species:	x 4:	
Polystichum munitum		20	FACU		UPL species:	x 5:	
Rubus ursinus		20	FACU		Total: (A)	(B)
Geranium robertainum		15	FACU		Prevalence Index = B/A =	:	
			-		Hydrophytic Vegetation Ir	dicators	s:
			-		☐ Dominance Test is >	50%	
			-		☐ Prevalence Index is ≤	3.0 ¹	
Woody Vine Stratum (Plot size: 30 t	Total Cover:	55			☐ Morphological Adapta supporting data in R	ations¹ (emarks	provide or on a
			-	П	separate sheet)		
			-	Н	Wetland Non-Vascula		
			-	H	Problematic Hydroph		
	Total Cover:	0	-	— Ш	 Indicators of hydric soil and must be present. 	wetland	nydrology
% Bare Ground in Herb Stratum: 45							
Remarks: The majority of dominant		d at this loca	ation were n	ot	Hydrophytic Veget	ation Pre	esent?
hydrophytic.					,		

SOIL Sample Point: 04

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

(inches) Color (m 0-8 10YR: 8-16 10YR: 10YR: 10YR: 10YR: 110YR: 1	8/2 100 8/2 80 5/2 20 tion D=depletic s: (applicable to (A2)	o all LRRs		% %	Type ¹		silt loa gravel silt loa gravel silt loa	m ly m ly	Remarks mixed mixed
**Type: C=concentra* **Hydric Soil Indicato* Histosol (A1) Histic Epidedon Black Histic (A3) Hydrogen Sulfid Depleted Below Thick Dark Surfa	5/2 80 5/2 20 tion D=depletic rs: (applicable to (A2)	o all LRRs		y 21 goati	-	-	gravel silt loa gravel	ly m ly	
¹Type: C=concentra Hydric Soil Indicato	tion D=depletic s: (applicable t (A2)	o all LRRs		y 21 goati	-	-	silt loa grave	m ly	
¹Type: C=concentra Hydric Soil Indicato Histosol (A1) Histic Epidedon Black Histic (A3) Hydrogen Sulfid Depleted Below Thick Dark Surfa	tion D=depletic s: (applicable t	o all LRRs		y 21 goati	-		grave	ly	mixed
Hydric Soil Indicato Histosol (A1) Histic Epidedon Black Histic (A3) Hydrogen Sulfid Depleted Below Thick Dark Surfa	(A2)	o all LRRs		y 21 posti	-		SIIC IOC		
Hydric Soil Indicato Histosol (A1) Histic Epidedon Black Histic (A3) Hydrogen Sulfid Depleted Below Thick Dark Surfa	(A2)	o all LRRs		y 21 posti	-	-			
Hydric Soil Indicato Histosol (A1) Histic Epidedon Black Histic (A3) Hydrogen Sulfid Depleted Below Thick Dark Surfa	(A2)	o all LRRs		y 21 goati	-	-			
Hydric Soil Indicato Histosol (A1) Histic Epidedon Black Histic (A3) Hydrogen Sulfid Depleted Below Thick Dark Surfa	(A2)	o all LRRs		y 21 oosti	-				
Hydric Soil Indicato Histosol (A1) Histic Epidedon Black Histic (A3) Hydrogen Sulfid Depleted Below Thick Dark Surfa	(A2)	o all LRRs		y 21 goatie		-			
Hydric Soil Indicato Histosol (A1) Histic Epidedon Black Histic (A3) Hydrogen Sulfid Depleted Below Thick Dark Surfa	(A2)	o all LRRs		v 2Looptie	-	-			
Histosol (A1) Histic Epidedon Black Histic (A3) Hydrogen Sulfid Depleted Below Thick Dark Surfa	(A2) e (A4)	[unless oth	x -Lucatii	on: PL=po	re lining F	RC=root o	hanr	nel M=matrix
Histic Epidedon Black Histic (A3) Hydrogen Sulfid Depleted Below Thick Dark Surfa	e (A4)			erwise note	d)			Indic	cators for Problematic Hydric Soils3:
Black Histic (A3) Hydrogen Sulfide Depleted Below Thick Dark Surfa	e (A4)		Sandy R	edox (S5)				□ 2	cm Muck (A10)
Black Histic (A3) Hydrogen Sulfid Depleted Below Thick Dark Surfa	e (A4)			Matrix (S6)			_ R	Red parent material (TF2)
Hydrogen Sulfide	e (A4)	l i		Aucky Mine		reent MI	2Δ 1)	_	'ery shallow dark surface (TF12)
☐ Depleted Below ☐ Thick Dark Surfa		١.	_ ′	•	. , .	Cept WILI	(,, 1)	_	Other (Explain in Remarks)
☐ Thick Dark Surfa	Dark Surface (<i>F</i>			leyed Matri				шч	ther (Explain in Remarks)
_				d Matrix (F3					
☐ Sandy Mucky M				ark Surface					
_ ound) maon, m	neral (S1)	[_ Deplete	d Dark Surfa	ace (F7)				icators of hydrophytic vegetation an
Sandy Gleyed M	atrix (S4)	1	Redox D	epressions	(F8)			wetia	and hydrology must be present.
Restrictive Layer (if	present):								
Type:						H	lydric So	il Pre	sent? Yes 🗌 No 🖂
Depth (inc	nes):								
HYDROLOGY									
Wetland hydrology Primary Indicators (or is suffic	ient)						Secondary Indicators (2 or more required)
Surface Water ((1)		☐ Spar	sely Vegeta	ted Conca	ve Surfac	e (B8)		
☐ High Water Tabl	e (A2)		☐ Wate	er-stained L	eaves (B9) (except	MLRA 1,	2,	1,2,4A, and 4B)
Saturation (A3)			4A and	4B)					☐ Drainage Patterns (B10)
☐ Water marks (B:	_)		☐ Salt	Crust (B11)					☐ Dry-season Water Table (C2)
Sediment Depos			☐ Aqua	atic Inverteb	rates (B1	3)			Saturation Visible on Aerial
☐ Drift Deposits (B			☐ Hydr	ogen Sulfid	e Odor (C	L)			Imagery (C9)
Algal Mat or Cru			☐ Oxid	ized Rhizos	pheres ald	ng living	roots (C3)	Geomorphic Position (D2)
☐ Iron Deposits (B			☐ Pres	ence of Rec	luced Iron	(C4)			Shallow Aquitard (D3)
Surface Soil Cra	*		_	ent Iron Red			s (C6)		☐ Frost-heave Hummocks (D7)
Inundation Visib		don/(D7)	_	ted or Stres					☐ FAC-neutral (D5)
I munuation visio	e on Aenai ima	igery (D7)	_	r (Explain ir					
Field Observations:	nnt2 Voc.] No ⊠ □	epth (inch	es):					l
Field Observations: Surface Water Pres	ciili iesi		epth (inch						Wetland Hydrology Present?
Surface Water Pres	_								
	t? Yes		epth (inch	es).	(includ	e capillary	fringe)		Yes □ No ⊠
Surface Water Pres Water Table Presen	t? Yes		enth (inch	ec).	(includ	capillan	frings)		Yes □ No ⊠

Project Site: Viewcrest			City/Co	ounty: Belling	ham Sample Date:	06/26/20
Applicant/Owner: Jones			;	State: WA	Sample Point:	05
Investigator: Van Slyke; Whitehurst			Section	n/Township/F	Range: 13/37N/02E	
Landform (hillslope, terrace, etc): slope		Loca	Relief (cor	ncave, convex	k, none): Subreg	ion: LRR A
Soil Map Unit Name: Nati Loam					NWI Classification: none	е
Are climatic/hydrologic conditions on the site ty	pical	of this time	of year? Ye	es 🛛 No 🗌	(if no, explain in Remarks)	
Are Vegetation ☐, Soil ☐, or Hydrology ☐ s	ignific	antly distur	ped?	Are "Normal C	Circumstances" present? Yes	No □
Are Vegetation, Soil, or Hydrology na	atural	ly problemat	tic?	(If needed, ex	plain any answers in Remarks	.)
SUMMARY OF FINDINGS - Attach site	map	showing s	ampling p	oint locatio	ns, transects, important fea	atures, etc.
Hydrophytic Vegetation Present? Yes ⊠	No [
Hydric Soil Present? Yes ⊠	No [Is the	Sampled Area within a Wetlan	d?
Wetland Hydrology Present? Yes ⊠	No [Yes ⊠ No 🗌	
Remarks: Wetland C. Positive indicators for all	three	parameters	were obse	rved at this lo	cation.	
VEGETATION						
Tree Stratum (Plot size: 30 feet)		Absolute % Cover	Indicator Status	Dominant Species?	Dominance Test worksheet	
Alnus rubra		75	FAC	⊠ ⊠	Number of Dominant Specie	s
Airius rubra		13	-	П	that are OBL, FACW, or FAC:	3
			-	H		(A)
					Total number of dominant	3
Total Co	ver.	75			species across all strata:	(AB)
Sapling/Shrub Stratum (Plot size: 15 feet)	¥C1.	10			Percent of dominant species	, ,
Cornus alba		35	FACW	×	that or OBL, FACW, FAC:	100
Salix scouleriana		25	FAC	×		(A/AB)
			-	П	Prevalence Index worksheet	
			-	П	OBL species:	x 1=
			-	П	FACW species:	x 2=
Total Co	ver:	60			FAC species:	x 3=
Herb Stratum (Plot size: 5 feet)					FACU species:	x 4=
			-	П	UPL species:	x 5=
			-		Total: (A)	(B)
			-		Prevalence Index = B/A =	. ,
			-	П	Hydrophytic Vegetation India	ators:
				Н	Dominance Test is > 50°	
			-		☐ Prevalence Index is ≤3.0	
Total Co	ver	0			Morphological Adaptatio	
Woody Vine Stratum (Plot size: 30 feet)	.01.				supporting data in Rema separate sheet)	
			-		☐ Wetland Non-Vascular P	lants1
			-		Problematic Hydrophytic	Vegetation1
			-		Indicators of hydric soil and we	tland hydrology
Total Co	ver:	0			must be present.	
% Bare Ground in Herb Stratum: 100						
Remarks: The majority of dominant species obs	serve	at this loca	tion were h	ydrophytic.	Hydrophytic Vegetation	n Present?
					Yes 🖂 No	
					1	

SOIL Sample Point: 05

Depth	Soil Cole	or		Re	edox Feature	es				
(inches)	Color (moist)	%	Color (moist)	%	Type ¹	Loc2	Text	ure	Remarks
0-16	10YR 4/1	60	7.5YF	•	40	C	М	silt lo wit cob	:h	
						-	-			
						-	-			
						-	-			
						-	-			
						-	-			
						-	-			
						-				
¹Tvpe: C=	concentration D=	depletion F	RM=redu	ced matri	x ² Locatio	n: PL=po	re lining F	RC=root	chan	nel M=matrix
	il Indicators: (app									cators for Problematic Hydric Soils3
Black Hydro Deple Thick Sandy Sandy	Epidedon (A2) Histic (A3) gen Sulfide (A4) ted Below Dark S Dark Surface (A1 Mucky Mineral (i Gleyed Matrix (S e Layer (if presen Type: Depth (inches): Soil at this locat	2) S1) 4)] Loamy M]Loamy Gi] Depleted] Redox D] Depleted] Redox D	Matrix (S6) flucky Miner leyed Matrix I Matrix (F3 ark Surface I Dark Surfa epressions ator F3.	ral (F1) (e (F2)) (F6) ace (F7)			3Ind wetl	Very shallow dark surface (TF12) Other (Explain in Remarks) idicators of hydrophytic vegetation all and hydrology must be present.
HYDROL	hydrology Indicate									Secondary Indicators (2 or more
	ndicators (any on-	e indicator	is sufficie							required)
Primary I							ave Surtar	e (B8)		Water-stained (B9) (MLRA
Primary II	ce Water (A1)				sely Vegeta					
Primary II Surfac	ce Water (A1) Vater Table (A2)			☐ Wate	r-stained Le				., 2 ,	1,2,4A, and 4B)
Primary II Surface High V	ce Water (A1) Water Table (A2) ation (A3)			☐ Wate	er-stained Le	eaves (B9			l, 2,	1,2,4A, and 4B) Drainage Patterns (B10)
Primary II Surface High V Satura Water	ce Water (A1) Vater Table (A2) ation (A3) marks (B1)			☐ Wate	er-stained Le 4B) Crust (B11)	eaves (B9) (except		L , 2 ,	T,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2)
Primary II Surface High V Satura Water Sedim	ce Water (A1) Vater Table (A2) ation (A3) marks (B1) nent Deposits (B2)		Wate	er-stained Le 4 B) Crust (B11) itic Inverteb	eaves (B9) (except		L , 2 ,	1,2,4A, and 4B) Drainage Patterns (B10)
Primary II Surfac Surfac High V Satura Water Sedim Drift D	ce Water (A1) Water Table (A2) ation (A3) marks (B1) nent Deposits (B2) Deposits (B3)			Wate 4A and Salt Aqua	er-stained Le 4 B) Crust (B11) itic Inverteb ogen Sulfide	eaves (B9 rates (B1 e Odor (C	(except 3)	MLRA 1		T.2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial
Primary II Surface High V Satura Water Sedim Drift C Algal I	ce Water (A1) Water Table (A2) ation (A3) marks (B1) nent Deposits (B2) Deposits (B3) Wat or Crust (B4)			Wate	er-stained Le 4 B) Crust (B11) itic Inverteb	rates (B1 e Odor (C	3) 1) ong living	MLRA 1		T.2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9)
Primary II Surface High V Satura Water Sedim Drift C Algal I	ce Water (A1) Vater Table (A2) ation (A3) marks (B1) nent Deposits (B2) Deposits (B3) Wat or Crust (B4) Deposits (B5)			Wate 4A and Salt (Aqua Hydre Oxidi	er-stained Le 4 B) Crust (B11) Itic Inverteb ogen Sulfide zed Rhizosp	rates (B1 e Odor (C) oheres ald	3) 1) ong living (C4)	MLRA 1		1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9) Geomorphic Position (D2)
Primary II Surface High V Satura Water Sedim Drift D Algal I Surface	ce Water (A1) Water Table (A2) ation (A3) marks (B1) nent Deposits (B2) Deposits (B3) Wat or Crust (B4)	5)	rv (B7)	Wate 4A and Salt Aqua Hydr Oxidi Press	er-stained Le 4B) Crust (B11) itic Inverteb ogen Sulfide zed Rhizosp ence of Red	rates (B9 rates (B1 e Odor (Co oheres ald fuced Iron ruction in	3) 1) ong living (C4) Tilled Soil	MLRA 1 roots (C		1,2,4A, and 4B)

(include capillary fringe)

Wetland Hydrology Present?

Yes 🛛 No 🗌

Field Observations:

Water Table Present?

Saturation Present?

Surface Water Present? Yes $\hfill \square$ No $\hfill \boxtimes$ Depth (inches):

Yes
No
Depth (inches):

Yes No Depth (inches):

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks: Soils were dry during the site visit, but oxidized rhizospheres and water-stained leaves were observed.

Project Site: Viewcrest		City/Co	ounty: Belling	nam Sampl	e Date: 08	3/31/21
Applicant/Owner: Jones			State: WA		e Point: 10	
Investigator: Van Slyke		Section	n/Township/F	Range: 13/37N/02E		
Landform (hillslope, terrace, etc): slope	Loca	al Relief (cor	ncave, convex	, none) :	Subregion	n: LRR A
Soil Map Unit Name: Nati Loam				NWI Classification	on: none	
Are climatic/hydrologic conditions on the site typical	of this time	of year? Ye	es 🛛 No 🗌	(if no, explain in Rema	rks)	
Are Vegetation ☐, Soil ☐, or Hydrology ☐ signifi	cantly distur	rbed?	Are "Normal C	ircumstances" presen	t? Yes 🖂	No 🗌
Are Vegetation, Soil, or Hydrology natura	lly problema	ntic? (If needed, ex	plain any answers in R	emarks.)	
SUMMARY OF FINDINGS - Attach site map	showing s	sampling p	oint location	ns, transects, import	tant featu	ıres, etc.
Hydrophytic Vegetation Present? Yes ⊠ No [
Hydric Soil Present? Yes ⊠ No [_		Is the	Sampled Area within a	Wetland?	
Wetland Hydrology Present? Yes ⊠ No [Yes 🛛 No 🗌		
Remarks: Wetland D. Positive indicators for all three	parameters	s were obse	rved at this io	cation.		
VEGETATION						
Tree Stratum (Plot size: 30 feet)	Absolute	Indicator	Dominant	Dominance Test wor	ksheet	
	% Cover	Status	Species?	Number of Dominant		
		-		that are OBL, FACW,	or FAC:	2
	1	-				/A)
	1	-		Total number of	inant	(A)
T-1-1 0	0	-	$\sqcup \sqcup$	Total number of dom species across all str		2 (AB)
Total Cover:	0	1				(AB)
Sapling/Shrub Stratum (Plot size: 15 feet)				Percent of dominant that or OBL, FACW, F		100
	 	-			-	(A /A D)
	 	-		Prevalence Index wo	rkehoot	(A/AB)
	 	-		OBL species:		1=
	 	-		'		2=
Total Cover:	0	-	— Ш	FACW species:		3=
Herb Stratum (Plot size: 5 feet)	U			FAC species: FACU species:		3= 4=
Equisetum telmateia	30	FACW	×	UPL species:		5=
Equisetum termatera Lysichiton americanus	25	OBL	M	Total:	(A)	5= (B)
Denanthe sarmentosa	10	OBL				(B)
Johannio Samionosa	10			Prevalence Index = E		
	-	-		Hydrophytic Vegetati		ors:
	-	-		Dominance Test		
	05	-	\Box	Prevalence Index		1 /
Total Cover:	65			Morphological Ac supporting data		
Woody Vine Stratum (Plot size: 30 feet)	T	T		separate sheet)	5	
	-	-		☐ Wetland Non-Vas	scular Plan	ts1
		-		Problematic Hydi	rophytic Ve	getation1
	_	-		Indicators of hydric soi	il and wetla	nd hydrology
Total Cover:	0			must be present.		
% Bare Ground in Herb Stratum: 35						
Remarks: The majority of dominant species observe	d at this loca	ation were h	ydrophytic.	Hydrophytic Vo	egetation l	Present?
				Yes D	⊲ No □	

SOIL Profile De	escription: (Descr	ibe to the dept	needed to de	ocument the	e indicato	or or confi	rm the	absen	Sample Point: 100 ce of indicators.)
Depth	Soil Cold			edox Feature					
(inches)	Color (moist)		olor (moist)	%	Type ¹	Loc2	Text	ure	Remarks
0-7	10YR 2/1	100	, , , , ,		-	-	Grav San Loa	elly	
7-16	Gley 1 4/10GY	85	10YR 3/4	15	С	М	Loa Cla	my	
	,				-	-			
					-	-			
					-	-			
					-	-			
					-	-			
					-	-			
¹Type: C=	concentration D=	depletion RM=	reduced matri	ix ² Locatio	n: PL=pc	re lining F	RC=root	chan	nel M=matrix
Hydric So	il Indicators: (app	licable to all LR	Rs unless oth	erwise note	d)			Indi	cators for Problematic Hydric Soils
Histos	ol (A1)		☐ Sandy R	tedox (S5)					2 cm Muck (A10)
_	Epidedon (A2)		_ ,	Matrix (S6)				<u> </u>	Red parent material (TF2)
	Histic (A3)			Mucky Miner		xcept MLF	RA 1)		/ery shallow dark surface (TF12)
_	gen Sulfide (A4)			leyed Matrix			,		Other (Explain in Remarks)
	ted Below Dark S	urface (A11)	_	d Matrix (F3				_	,
	Dark Surface (A1	, ,		ark Surface					
_	Mucky Mineral (,	_	d Dark Surfa	. ,			3Ind	licators of hydrophytic vegetation a
_ :	Gleyed Matrix (S			epressions					and hydrology must be present.
Restrictiv	e Layer (if presen	nt)·							
	Type: loamy clay	.9.					lvdric S	oil Pre	esent? Yes 🖂 No 🗌
	Depth (inches): 7					•	.,	· · · · · ·	
Remarks:	Soil at this locat	ion met NRCS h	ydric soil indic	cators A11 a	nd F3.				
	nydrology Indicate		fficient)						Secondary Indicators (2 or more required)
Surfac	e Water (A1)		Spar	sely Vegetat	ed Conc	ave Surfac	e (B8)		☐ Water-stained (B9) (MLRA
☐ High V	Vater Table (A2)			er-stained Le	eaves (B9	except	MLRA 1	L , 2 ,	1,2,4A, and 4B)
Satura	ation (A3)		4A and	•					☐ Drainage Patterns (B10)
☐ Water	marks (B1)		-	Crust (B11)					☐ Dry-season Water Table (C2)
Sedim	ent Deposits (B2	2)	I — ·	atic Inverteb					Saturation Visible on Aerial
☐ Drift D	eposits (B3)		- 1	ogen Sulfide		,			Imagery (C9)
Algal M	Mat or Crust (B4)		_	ized Rhizosp			roots (C	(3)	Geomorphic Position (D2)
☐ Iron D	eposits (B5)		-	ence of Red		, ,			Shallow Aquitard (D3)
☐ Surfac	ce Soil Cracks (B6	3)		ent Iron Red					Frost-heave Hummocks (D7)
☐ Inunda	ation Visible on A	erial Imagery (B	1)	ted or Stres			RA)		FAC-neutral (D5)
			☐ Othe	er (Explain in	Remarks	3)			

(include capillary fringe)

Wetland Hydrology Present?

Yes ⊠ No □

Field Observations:

Water Table Present?

Saturation Present?

Surface Water Present? Yes ⊠ No ☐ Depth (inches): 0-7

Remarks: Indicators of wetland hydrology were observed at this location.

Yes ☐ No ☒ Depth (inches):

Yes
No
Depth (inches):

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

City/County: Bellingham

State: WA

Sample Date: 06/26/20

Sample Point: 101

Project Site: Viewcrest

Applicant/Owner: Jones

Investigator: Van Slyke; Whitehurst		Section	n/Township/F	Range: 13/37N/02E	
Landform (hillslope, terrace, etc): slope	Loca	al Relief (con	cave, convex	k, none): Subre	egion: LRR A
Soil Map Unit Name: Nati Loam				NWI Classification: no	ne
Are climatic/hydrologic conditions on the site typical	of this time	of year? Ye	s 🛛 No 🗌	(if no, explain in Remarks)	
Are Vegetation ☐, Soil ☐, or Hydrology ☐ significant	cantly distur	bed? A	re "Normal C	Circumstances" present? Yes	No □
Are Vegetation , Soil , or Hydrology natura	lly problema	tic? (If needed, ex	plain any answers in Remark	s.)
SUMMARY OF FINDINGS - Attach site map	showing s	ampling p	oint locatio	ns, transects, important f	eatures, etc.
Hydrophytic Vegetation Present? Yes No I Hydric Soil Present? Yes No I Wetland Hydrology Present? Yes No I	×		Is the	Sampled Area within a Wetla Yes ☐ No ⊠	nd?
Remarks: Upland adjacent to Wetland D. Positive inc	dicators for a	all three para	ameters were	e not observed at this locatio	n.
VEGETATION					
Tree Stratum (Plot size: 30 feet)	Absolute % Cover	Indicator Status	Dominant Species?	Dominance Test workshee Number of Dominant Spec	
Pseudotsuga menziesii	95	FACU	×	that are OBL, FACW, or FAC	
		-			0
		-			(A)
		-		Total number of dominant	4
Total Cover:	95			species across all strata:	(AB)
Sapling/Shrub Stratum (Plot size: 15 feet)	1			Percent of dominant specie	es 0
Rosa gymnocarpa	15	FACU		that or OBL, FACW, FAC:	
Symphoricarpos albus	5	FACU			(A/AB)
		-		Prevalence Index workshee	
		-		OBL species:	x 1=
		-		FACW species:	x 2=
Total Cover:	20			FAC species:	x 3=
Herb Stratum (Plot size: 5 feet)			_	FACU species:	x 4=
Gaultheria shallon	95	FACU		UPL species:	x 5=
Rubus ursinus	5	FACU		Total: (A)	(B)
Pteridium aquilinum	5	FACU		Prevalence Index = B/A =	
		-		Hydrophytic Vegetation Ind	
		-		Dominance Test is > 5	
		-		☐ Prevalence Index is ≤3	-
Total Cover:	105			 Morphological Adaptati supporting data in Rer 	
Woody Vine Stratum (Plot size: 30 feet)	ı			separate sheet)	nano di dii a
		-		☐ Wetland Non-Vascular	Plants ¹
		-		Problematic Hydrophyt	ic Vegetation1
		-		Indicators of hydric soil and w	etland hydrology
Total Cover: % Bare Ground in Herb Stratum: 0	0			must be present.	
Remarks: The dominant species observed at this loc	ation were r	not hydrophy	tic.	Hydrophytic Vegetat	
				Yes ☐ No	$oxed{egin{array}{c} oxed{eta}}$

SOIL Sample Point: 101

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Soil Col	or		Re	dox Featur	es				
(inches)	Color (moist)	%	Colo	r (moist)	%	Type ¹	Loc2	Text	ure	Remarks
0-3	7.5YR 2.5/2	100	00.0	· (moloc)	70	-	-	San	dy	Tomano
3-16	10YR 4/3	100				_	_	Silt L		
3-10	101K 4/3	100						SIIL	Jaiii	
						-	_			
						-	-			
							_			
							-			
¹Type: C=	concentration D	depletion	RM=red	duced matri	x ² Locati	on: PL=po	re lining F	RC=root	chan	nel M=matrix
	il Indicators: (ap									cators for Problematic Hydric Soils3:
Histos				☐ Sandy R					1	cm Muck (A10)
_	Epidedon (A2)			Stripped	. ,)			_	Red parent material (TF2)
_	Histic (A3)			Loamy N			vcent MI	2Δ 1)	_	'ery shallow dark surface (TF12)
_	gen Sulfide (A4)			☐ Loamy G			ACCPC IVIL	U(<u>1</u>)	_	Other (Explain in Remarks)
	ted Below Dark S	turface (A1		Depleted	-				Δ,	(Explain in Homano)
	Dark Surface (A1			Redox D						
_	Mucky Mineral (,		Depleted					3Ind	icators of hydrophytic vegetation ar
_	Gleyed Matrix (S			Redox D						and hydrology must be present.
Gariay	dicycu ividanx (c	,-,			Сргсоотопо	(10)				
Restrictiv	e Layer (if presei	nt):								
	e Layer (if preser Type:	nt):					ı	lydric S	oil Pre	sent? Yes □ No ⊠
			t meet N	RCS hydric	soil indicat	ors.	ŀ	Hydric S	oil Pre	sent? Yes □ No ⊠
Remarks:	Type: Depth (inches): Soil at this locat OGY hydrology Indicat	ion did not			soil indicat	ors.		Hydric S	oil Pre	Secondary Indicators (2 or more
Remarks: HYDROL Wetland I Primary Ir	Type: Depth (inches): Soil at this locat OGY hydrology Indicat ndicators (any on	ion did not		cient)					oil Pre	Secondary Indicators (2 or more required)
Remarks: HYDROL Wetland I Primary Ir	Type: Depth (inches): Soil at this local OGY hydrology Indicate dicators (any on the Water (A1)	ion did not		cient) ☐ Spar	sely Vegeta	ited Conca	ave Surfac	ce (B8)		Secondary Indicators (2 or more required) Water-stained (B9) (MLRA
HYDROL Wetland I Primary Ir Surfac	Type: Depth (inches): Soil at this locat OGY hydrology Indicat ndicators (any on the Water (A1) Water Table (A2)	ion did not		cient)	sely Vegeta er-stained L	ited Conca	ave Surfac	ce (B8)		Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B)
Remarks: HYDROL Wetland I Primary Ir Surfac High V	Type: Depth (inches): Soil at this locat OGY hydrology Indicat ndicators (any on be Water (A1) Vater Table (A2) stion (A3)	ion did not		cient) Spar Wate	sely Vegeta er-stained L 4B)	ited Conca eaves (B9	ave Surfac	ce (B8)		Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10)
Remarks: HYDROL Wetland I Primary Ir Surfac High V Satura Water	Type: Depth (inches): Soil at this locat OGY hydrology Indicate dicators (any on be Water (A1) Vater Table (A2) ation (A3) marks (B1)	ion did not		cient) Spar Wate 4A and	sely Vegeta er-stained L 4B) Crust (B11)	ited Conca eaves (B9	ave Surfac	ce (B8)		Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2)
Remarks: HYDROL Wetland I Primary Ir Surfac High V Satura Water Sedim	Type: Depth (inches): Soil at this locat OGY hydrology Indicat dicators (any on ew Water (A1) Vater Table (A2) ation (A3) marks (B1) lent Deposits (B2)	ion did not		Sient) Spar Wate 4A and Salt Aqua	sely Vegeta er-stained L 4B) Crust (B11) tic Invertet	ated Conca eaves (B9 orates (B1	ave Surfac o) (except	ce (B8)		Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial
Remarks: HYDROL Wetland I Primary Ir Surfac High V Satura Water Sedim Drift D	Type: Depth (inches): Soil at this locat DOGY hydrology Indicat dicators (any on De Water (A1) Water Table (A2) ation (A3) marks (B1) ment Deposits (B2) Peposits (B3)	ors: e indicator		Sient) Spar Wate 4A and Salt Aqua	sely Vegeta er-stained L 4B) Crust (B11) tic Invertet ogen Sulfid	eaves (B9) prates (B1) e Odor (C:	ave Surfac) (except 3)	ce (B8)	., 2,	Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9)
Remarks: HYDROL Wetland I Primary Ir Surfac High V Satura Water Sedim Drift D Algal N	Type: Depth (inches): Soil at this locat DOGY hydrology Indicat dicators (any on the Water (A1) Vater Table (A2) ation (A3) marks (B1) tent Deposits (B2) Deposits (B3) Mat or Crust (B4)	ors: e indicator		cient) Spar Wate 4A and Salt Aqua Hydr	sely Vegeta vr-stained L 4B) Crust (B11) tic Invertet ogen Sulfid zed Rhizos	eaves (B9) orates (B1 e Odor (C:	ave Surfac () (except 3) 1) ong living	ce (B8)	., 2,	Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9) Geomorphic Position (D2)
HYDROL Wetland I Primary Ir Surfac High V Satura Water Sedim Drift D Algal N	Type: Depth (inches): Soil at this locat OGY hydrology Indicat dicators (any on 22 Water (A1) Vater Table (A2) ation (A3) marks (B1) heent Deposits (B2) heposits (B3) Mat or Crust (B4) eposits (B5)	ors: e indicator		cient) Spar Wate 4A and Salt Aqua Hydr Oxidi Pres	sely Vegeta vr-stained L 4B) Crust (B11; titic Invertet ogen Sulfid zed Rhizos ence of Rec	orates (B1 e Odor (C: pheres alc duced Iron	ave Surface 3) (except 3) 1) ong living a (C4)	ce (B8) MLRA 1	., 2,	Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9) Geomorphic Position (D2) Shallow Aquitard (D3)
Remarks: HYDROL Wetland I Primary Ir Surfac High V Satura Water Sedim Drift D Algal N Iron D	Type: Depth (inches): Soil at this locat OGY Nydrology Indicat ndicators (any on be Water (A1) Vater Table (A2) ation (A3) marks (B1) nent Deposits (B3) Wat or Crust (B4) eposits (B5) be Soil Cracks (B6)	ors: e indicator	r is suffic	cient) Spar Wate 4A and Salt Aqua Hydr Oxidi Pres Rece	sely Vegeta vr-stained L 48) Crust (B11; tic Invertet ogen Sulfid zed Rhizos ence of Rec int Iron Rec	eaves (B9) prates (B1) le Odor (C: pheres alc duced Iron fuction in '	ave Surfaction (except 3) (1) ong living a (C4) Tilled Soil	ce (B8) MLRA 1 roots (C	., 2,	Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9) Geomorphic Position (D2) Shallow Aquitard (D3) Frost-heave Hummocks (D7)
Remarks: HYDROL Wetland I Primary Ir Surfac High V Satura Water Sedim Drift D Algal N Iron D	Type: Depth (inches): Soil at this locat OGY hydrology Indicat dicators (any on 22 Water (A1) Vater Table (A2) ation (A3) marks (B1) heent Deposits (B2) heposits (B3) Mat or Crust (B4) eposits (B5)	ors: e indicator	r is suffic	cient) Spar Wate 4A and Salt Aqua Hydr Oxidi Pres Rece Stun	sely Vegeta er-stained L 48) Crust (B11) titc Invertet ogen Sulfid zed Rhizos ence of Rec ent Iron Rec ted or Strest	eaves (B9) prates (B1) e Odor (C: pheres alc duced Iron fuction in 'ssess Plant	ave Surface (except) (except) 3) 1) nng living (C4) Tilled Soil s (D1) (LF	ce (B8) MLRA 1 roots (C	., 2,	Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9) Geomorphic Position (D2) Shallow Aquitard (D3)
Remarks: HYDROL Wetland I Primary Ir Surfac High V Sature Vater Algal N Iron D Surfac Inunda	Type: Depth (inches): Soil at this locat LOGY hydrology Indicat dicators (any on the Water Table (A2) ation (A3) marks (B1) tent Deposits (B3) what or Crust (B4) eposits (B5) the Soil Cracks (B6) ation Visible on A	ors: e indicator	r is suffic	cient) Spar Wate 4A and Salt Aqua Hydr Oxidi Pres Rece Stun	sely Vegeta vr-stained L 48) Crust (B11; tic Invertet ogen Sulfid zed Rhizos ence of Rec int Iron Rec	eaves (B9) prates (B1) e Odor (C: pheres alc duced Iron fuction in 'ssess Plant	ave Surface (except) (except) 3) 1) nng living (C4) Tilled Soil s (D1) (LF	ce (B8) MLRA 1 roots (C	., 2,	Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9) Geomorphic Position (D2) Shallow Aquitard (D3) Frost-heave Hummocks (D7)
Remarks: HYDROL Wetland I Surface High V Sature Vater Sedim Drift D Surface Inunda	Type: Depth (inches): Soil at this locat OGY hydrology Indicat dicators (any on the Water (A1) Water Table (A2) ation (A3) marks (B1) went Deposits (B3) Wat or Crust (B4) eposits (B5) the Soil Cracks (B4 ation Visible on A4 ervations:	ors: e indicator 2)	r is suffice	Sient) Spar Wate 4A and Aqua Hydr Oxidi Pres Rece Stun Othe	sely Vegeta tr-stained L 48) Crust (B11); titic Invertet ogen Sulfid zed Rhizos ence of Rec ent Iron Rec ted or Street r (Explain in	eaves (B9) prates (B1) e Odor (C: pheres alc duced Iron fuction in 'ssess Plant	ave Surface (except) (except) 3) 1) nng living (C4) Tilled Soil s (D1) (LF	ce (B8) MLRA 1 roots (C	., 2,	Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9) Geomorphic Position (D2) Shallow Aquitard (D3) Frost-heave Hummocks (D7) FAC-neutral (D5)
Remarks: HYDROL Wetland I Primary Ir Surface High V Satura Sedim Drift C Algal N Iron D Surface Inunda	Type: Depth (inches): Soil at this locat OGY hydrology Indicat ndicators (any on we Water (A1) Vater Table (A2) ation (A3) marks (B1) hent Deposits (B3) Water Crust (B4) eposits (B5) we Soil Cracks (B6 ation Visible on A ervations: Vater Present?	ors: e indicator 2) Yes Yes	r is suffice ery (B7)	sient) Spar Wate 4A and Salt: Aqua Hydr Oxidi Pres Stun Othe	sely Vegeta r-stained L 48) Crust (B11); tic Invertet ogen Sulfid zed Rhizos ence of Rec int Iron Rec ted or Stres r (Explain in	eaves (B9) prates (B1) e Odor (C: pheres alc duced Iron fuction in 'ssess Plant	ave Surface (except) (except) 3) 1) nng living (C4) Tilled Soil s (D1) (LF	ce (B8) MLRA 1 roots (C	., 2,	Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9) Geomorphic Position (D2) Shallow Aquitard (D3) Frost-heave Hummocks (D7)
Remarks: HYDROL Wetland I Primary Ir Surface Water Sedim Drift D Iron D Surface Inund:	Type: Depth (inches): Soil at this locat OGY hydrology Indicat dicators (any on the Water (A1) Water Table (A2) ation (A3) marks (B1) went Deposits (B3) Wat or Crust (B4) eposits (B5) the Soil Cracks (B4 ation Visible on A4 ervations:	ors: e indicator Yes Yes Yes Yes Yes Yes Yes Yes	r is suffice ery (B7) No ⊠ I No ⊠ I	Sient) Spar Wate 4A and Aqua Hydr Oxidi Pres Rece Stun Othe	sely Vegeta er-stained L 4B) Crust (B11) tic Inverted ogen Sulfid zed Rhizos ence of Recent Iron Recent ted or Street r (Explain in es):	orates (B1) orates (B1) de Odor (C: pheres alc duced Iron fluction in ssees Plant n Remarks	ave Surface (except) (except) 3) 1) nng living (C4) Tilled Soil s (D1) (LF	mula 1 model (B8) model (B8)	, 2,	Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9) Geomorphic Position (D2) Shallow Aquitard (D3) Frost-heave Hummocks (D7) FAC-neutral (D5)

Remarks: Indicators of hydrology were not observed at this location.

Project Site: Viewcrest		•	ounty: Belling		
Applicant/Owner: Jones			State: WA	Sample Poin	t: 102
Investigator: Van Slyke; Whitehurst			, ,,	Range: 13/37N/02E	
Landform (hillslope, terrace, etc): slope	Loca	al Relief (cor	ncave, conve	·	egion: LRR A
Soil Map Unit Name: Nati Loam				NWI Classification: no	ne
Are climatic/hydrologic conditions on the site typ			es 🛛 No 🗌	(if no, explain in Remarks)	
Are Vegetation, Soil, or Hydrology sig	nificantly distu	rbed? A	Are "Normal (Circumstances" present? Yes	No □
Are Vegetation, Soil, or Hydrology nat	urally problema	atic? (If needed, ex	plain any answers in Remark	s.)
SUMMARY OF FINDINGS - Attach site n	nap showing s	sampling p	oint locatio	ns, transects, Important fo	eatures, etc.
Hydrophytic Vegetation Present? Yes ⊠ N	lo 🗆				
Hydric Soil Present? Yes ☐ N	lo 🖂		Is the	Sampled Area within a Wetla	ind?
Wetland Hydrology Present? Yes ⊠ N	lo 🗆			Yes 🗌 No 🖂	
Remarks: Seep. Positive indicators for hydric soil	were not obse	rved at this I	ocation and t	herefore do not meet wetlan	d criteria.
VEGETATION					
Tree Stratum (Plot size: 30 feet)	Absolute % Cover	Indicator Status	Dominant Species?	Dominance Test worksheet	t
	76 COVE	Status	Species:	Number of Dominant Spec	
				that are OBL, FACW, or FAC): 4
		-			(4)
				Tatal accept on of dancin and	(A) 6
Total One	er: 0	-	ш	Total number of dominant species across all strata:	(AB)
Total Coving Sapling/Shrub Stratum (Plot size: 15 feet)	er. U			Percent of dominant specie	` '
Lonicera involucrata	25	FAC	M	that or OBL, FACW, FAC:	66
Corylus cornuta	20	FACU			(A/AB)
Salix scouleriana	20	FAC	M	Prevalence Index workshee	
Symphoricarpos albus	15	FACU		OBL species:	x 1=
Symphonical pos albus	15	FACU		FACW species:	x 2=
Total Cov.	er: 80	-	ш		x 3=
	er: 80			FAC species:	
Herb Stratum (Plot size: 5 feet)		F4.0		FACU species:	x 4=
Athyrium filix-femina	30	FAC		UPL species:	x 5=
Gaultheria shallon	15	FACU		Total: (A)	(B)
Geum macrophyllum	5	FAC		Prevalence Index = B/A =	
Geranium robertianum	5	FACU		Hydrophytic Vegetation Ind	
		-		☐ Dominance Test is > 50	0%
		-		Prevalence Index is ≤3.	.01
Total Cov	er: 55			☐ Morphological Adaptati	
Woody Vine Stratum (Plot size: 30 feet)		T		supporting data in Rer separate sheet)	narks or on a
Rubus armeniacus	15	FAC	\boxtimes	→ Wetland Non-Vascular	Plants1
		-		Problematic Hydrophyti	
		-		Indicators of hydric soil and w	
Total Cov	er: 15			must be present.	
% Bare Ground in Herb Stratum: 45					
Remarks: The majority of dominant species obse	rved at this loc	ation were h	ydrophytic.	Hydrophytic Vegetat	ion Present?
·					
				Yes ⊠ No	• ⊔

SOIL Sample Point: 102

Depth	Soil Cole	or		Redox Featu	res				
(inches)	Color (moist)	%	Color (moist)		Type ¹	Loc2	Text	ure	Remarks
0-16	10YR 3/2	100	1		-	-	Silt L	oam	Cobble
16-20	10YR 4/2	40	10YR 4/4	10	С	М	Sandy		
	10YR 3/2	50			-	-	Silt L	oam	
-					-	-			
					-	-			
					-	-			
					-	-			
					-	-			
¹Type: C=	concentration D=	depletion F	M=reduced m	atrix ² Locat	ion: PL=po	re lining l	RC=root	chan	nel M=matrix
Hydric So	il Indicators: (app	licable to a	I LRRs unless	otherwise not	ed)			Indi	cators for Problematic Hydric Soils3:
☐ Histos				y Redox (S5)				П	2 cm Muck (A10)
_	Epidedon (A2)		_	ped Matrix (S6	3)			П	Red parent material (TF2)
_	Histic (A3)			ny Mucky Mine	,	xcept MLI	RA 1)	<u>ا</u> ا	/ery shallow dark surface (TF12)
_	gen Sulfide (A4)			y Gleyed Matr			,		Other (Explain in Remarks)
	ted Below Dark S	urface (A11	I —	eted Matrix (F				_	
☐ Thick	Dark Surface (A1	2)	∏ Redo	x Dark Surfac	e (F6)				
_	Mucky Mineral (•	_	eted Dark Sur				³Ind	icators of hydrophytic vegetation ar
Sandy	Gleyed Matrix (S	4)	Redo	x Depressions	(F8)			wetl	and hydrology must be present.
					_				
	e Layer (if preser	it):							
	Type:					ı	Hydric S	oil Pre	esent? Yes 🗌 No 🖂
I	Depth (inches):					ı	Hydric S	ioil Pre	esent? Yes 🗌 No 🖂
I		ion did not i	neet NRCS hyd	Iric soil indica	tors.		Hydric S	ioil Pre	esent? Yes 🗌 No 🛛
I	Depth (inches):	ion did not i	neet NRCS hyd	Iric soil indica	tors.	I	Hydric S	ioil Pre	esent? Yes 🗌 No 🗵
I	Depth (inches):	ion did not ı	neet NRCS hyd	fric soil indica	tors.	ı	Hydric S	ioil Pre	esent? Yes □ No ⊠
I	Depth (inches): : Soil at this locat	ion did not ı	neet NRCS hyd	Iric soil indica	tors.		Hydric S	ioil Pre	esent? Yes 🗌 No 🗵
Remarks: HYDROL Wetland I	Depth (inches): : Soil at this locat	ors:		Iric soil indica	tors.		Hydric S	ioil Pre	Secondary Indicators (2 or more required)
Remarks: HYDROL Wetland I Primary Ir	Depth (inches): Soil at this locat OGY hydrology Indicate	ors:	s sufficient)	Iric soil indica				ioil Pre	Secondary Indicators (2 or more
Remarks: HYDROL Wetland I Primary Ir Surface	Depth (inches): Soil at this locat OGY hydrology Indicated indicators (any one	ors:	s sufficient)		ated Conca	ave Surfac	ce (B8)		Secondary Indicators (2 or more required)
Remarks: HYDROL Wetland I Primary Ir Surface	Depth (inches): Soil at this locat OGY hydrology Indicate dicators (any on the Water (A1) Vater Table (A2)	ors:	s sufficient)	parsely Vegeta	ated Conca	ave Surfac	ce (B8)		Secondary Indicators (2 or more required) Water-stained (B9) (MLRA
HYDROL Wetland Primary Ir Surfac High V	Depth (inches): Soil at this locat OGY hydrology Indicate dicators (any on the Water (A1) Vater Table (A2)	ors:	s sufficient)	parsely Vegeta Jater-stained L	ated Conca Leaves (B9	ave Surfac	ce (B8)		Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B)
Remarks: HYDROL Wetland I Primary Ir Surfac High V Satura Water	Depth (inches): Soil at this locat OGY hydrology Indicat dicators (any on the Water (A1) Water Table (A2) attion (A3)	ors: e indicator i	s sufficient) S W 4A a S A	parsely Vegeta /ater-stained I nd 4B) alt Crust (B11 quatic Inverte	ated Conca Leaves (B9) brates (B1	ave Surfar o) (except	ce (B8)		Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial
Remarks: HYDROL Wetland I Primary Ir Surface High V Satura Water Sedim	Depth (inches): Soil at this locat OGY hydrology Indicate adicators (any on one water (A1) Vater Table (A2) ation (A3) marks (B1)	ors: e indicator i	s sufficient) S W 4A a S A	parsely Vegeta /ater-stained I nd 4B) alt Crust (B11	ated Conca Leaves (B9) brates (B1	ave Surfar o) (except	ce (B8)		Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9)
HYDROL Wetland I Primary Ir Surfac High V Satura Water Sedim Drift D	Depth (inches): Soil at this locat Depth (inches): Soil at this locat Depth (inches): Depth	ors: e indicator i	s sufficient) S W 4A a S S S S S S S S S S S S S S S S S S S	parsely Vegeta /ater-stained I nd 4B) alt Crust (B11 quatic Inverte ydrogen Sulfia xidized Rhizos	ated Conca Leaves (B9) brates (B1 de Odor (C:	ave Surfact) (except 3) 1) 2) 3) 1) 2) 3)	ce (B8)	L, 2,	Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9) Geomorphic Position (D2)
HYDROL Wetland I Primary Ir Surface High V Satura Water Sedim Drift D Algal N	Depth (inches): Soil at this locat DOGY hydrology Indicate dicators (any on the Water (A1) Water Table (A2) ation (A3) marks (B1) thent Deposits (B2) Peposits (B3)	ors: e indicator i	s sufficient) S W 4A a S S S S S S S S S S S S S S S S S S S	parsely Vegeta /ater-stained I nd 4B) alt Crust (B11 quatic Inverte ydrogen Sulfic	ated Conca Leaves (B9) brates (B1 de Odor (C:	ave Surfact) (except 3) 1) 2) 3) 1) 2) 3)	ce (B8)	L, 2,	Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9) Geomorphic Position (D2) Shallow Aquitard (D3)
HYDROL Wetland I Primary Ir Surface High V Sature Water Sedim Drift D Algal N	Depth (inches): Soil at this locat DOGY hydrology Indicate ndicators (any on be Water (A1) Vater Table (A2) ation (A3) marks (B1) leent Deposits (B2) Deposits (B3) Wat or Crust (B4)	ors: e indicator i	s sufficient) S W 4Aa S S S S S S S S S S S S S S S S S S S	parsely Vegeta /ater-stained I nd 4B) alt Crust (B11 quatic Inverte ydrogen Sulfia xidized Rhizos	ated Conca eaves (B9) brates (B1 de Odor (C: spheres ald duced Iron	ave Surface (except) (except) (a) (except) (b) (except) (c) (except) (d) (except) (d) (except) (except	ce (B8) MLRA 1	L, 2,	Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9) Geomorphic Position (D2) Shallow Aquitard (D3) Frost-heave Hummocks (D7)
HYDROL Wetland I Primary Ir Surface High V Satura Vater Sedim Drift D Algal N Iron De Surface	Depth (inches): Soil at this locat DOGY hydrology Indicate ndicators (any on the Water (A1) Vater (A1) Vater (A3) marks (B1) lent Deposits (B2) leposits (B3) Wat or Crust (B4) eposits (B5)	ors: e indicator i	s sufficient) S W 4Aa S S S S S S S S S S S S S S S S S S S	parsely Vegeta /ater-stained I nd 4B) alt Crust (B11 quatic Inverte ydrogen Sulfic xidized Rhizos resence of Re	ated Conca Leaves (B9) brates (B1 de Odor (C: spheres ald duced Iron duction in '	ave Surfact (except) (except) (a) (b) (a) (c) (c) (c) (c) (d) (d) (d) (d) (d) (d) (d) (d) (d) (d	ce (B8) MLRA 1 roots (C6)	L, 2,	Secondary Indicators (2 or more required) Water-stained (B9) (MLRA 1,2,4A, and 4B) Drainage Patterns (B10) Dry-season Water Table (C2) Saturation Visible on Aerial Imagery (C9) Geomorphic Position (D2) Shallow Aquitard (D3)

(include capillary fringe)

Wetland Hydrology Present?

Yes 🛛 No 🗌

Surface Water Present? Yes \square No \boxtimes Depth (inches):

Water Table Present?

Yes
No
Depth (inches):

Yes ☐ No ☑ Depth (inches):

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks: Soils were dry during the August 2021 site visit but were suturated during the June 2020 visit.

Wetland name or number Wetland A

RATING SUMMARY – Western Washington

.20	ing_2014	z X
Date of site visit: 6/26/20	Trained by Ecology? X Yes No Date of training ²⁰¹⁴ _	Wetland has multiple HGM classes? \longrightarrow Y \times N
Date of	y?X Yes N	s multiple HGN
	ned by Ecolog	Wetland has
Name of wetland (or ID #): Viewcrest Wetland A	Trai	
ID #): Viewo		ating Slope
f wetland (or	Rated by C. Van Slyke	HGM Class used for rating Slope
Name o	Rated b	HGM CI

OVERALL WETLAND CATEGORY $^{ ext{IV}}$ (based on functions $\overline{ imes}$ or special characteristics $^{ ext{IV}}$

1. Category of wetland based on FUNCTIONS

Score for each function based on three ratings (order of ratings is not important)

9 = H,H,H 8 = H,H,M

FUNCTION	Improving Water Quality	Hydrologic	Habitat	
		Circle the app	Circle the appropriate ratings	
Site Potential	HO MOLO HO MOLO HO MOLO	O1 OM OH	HO MO LO	
Landscape Potential HO M © LO HO M C LO	HO MOLO	HO MO LO	HO MO LO	
Value	HO MOLO HO MOLO HO MOLO TOTAL	HO MO LO	HO MO LO	TOTAL
Score Based on Ratings	4	5	4	13

2. Category based on SPECIAL CHARACTERISTICS of wetland

CHARACTERISTIC	CATEGORY	
Estuarine	II I	
Wetland of High Conservation Value	-	
Bog	I	
Mature Forest	I	
Old Growth Forest	I	
Coastal Lagoon	II I	
Interdunal	VI III II I	
None of the above	\boxtimes	

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

Wetland name or number _____

Maps and figures required to answer questions correctly for Western Washington

Depressional Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	D 1.3, H 1.1, H 1.4	
Hydroperiods	D 1.4, H 1.2	
Location of outlet (can be added to map of hydroperiods)	D 1.1, D 4.1	
Boundary of area within 150 ft of the wetland (can be added to another figure) D 2.2, D 5.2	D 2.2, D 5.2	
Map of the contributing basin	D 4.3, D 5.3	
1 km Polygon: Area that extends 1 km from entire wetland edge - including	н 2.1, н 2.2, н 2.3	
polygons for accessible habitat and undisturbed habitat		
Screen capture of map of 303(d) listed waters in basin (from Ecology website) D 3.1, D 3.2	D 3.1, D 3.2	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	D 3.3	

Riverine Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	H 1.1, H 1.4	
Hydroperiods	H 1.2	
Ponded depressions	R 1.1	
Boundary of area within 150 ft of the wetland (can be added to another figure)	R 2.4	
Plant cover of trees, shrubs, and herbaceous plants	R 1.2, R 4.2	
Width of unit vs. width of stream (can be added to another figure)	R 4.1	
Map of the contributing basin	R 2.2, R 2.3, R 5.2	
1 km Polygon: Area that extends 1 km from entire wetland edge - including	Н 2.1, Н 2.2, Н 2.3	
polygons for accessible habitat and undisturbed habitat		
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	R 3.1	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	R 3.2, R 3.3	

Lake Fringe Wetlands

7 = H,H,L 7 = H,M,M 6 = H,M,L 6 = M,M,M 5 = H,L,L 5 = M,M,L 4 = M,L,L 3 = L,L,L

Map or:	To answer questions:	Figure #
Cowardin plant classes	L1.1, L4.1, H1.1, H1.4	
Plant cover of trees, shrubs, and herbaceous plants	L 1.2	
Boundary of area within 150 ft of the wetland (can be added to another figure) L 2.2	L 2.2	
1 km Polygon: Area that extends 1 km from entire wetland edge - including	Н 2.1, Н 2.2, Н 2.3	
polygons for accessible habitat and undisturbed habitat		
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	L 3.1, L 3.2	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	L 3.3	

Slope Wetlands

Map of:	To answer questions:	Figure #	
Cowardin plant classes	H 1.1, H 1.4	Α	
Hydroperiods	H 1.2	В	
Plant cover of dense trees, shrubs, and herbaceous plants	S 1.3	٧	
Plant cover of dense, rigid trees, shrubs, and herbaceous plants	S 4.1	<	
(can be added to figure above)		ξ	
Boundary of 150 ft buffer (can be added to another figure)	\$ 2.1, \$ 5.1	В	
1 km Polygon: Area that extends 1 km from entire wetland edge - including	Н 2.1, Н 2.2, Н 2.3	C	
polygons for accessible habitat and undisturbed habitat		ر	
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	5 3.1, 5 3.2	Q	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	53.3	Q	

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

Wetland name or number Wetland A

HGM Classification of Wetlands in Western Washington

For questions 1-7, the criteria described must apply to the entire unit being rated

If the hydrologic criteria listed in each question do not apply to the entire unit being rated, you probably have a unit with multiple HGM classes. In this case, identify which hydrologic criteria in questions 1-7 apply, and go to Question 8.

Are the water levels in the entire unit usually controlled by tides except during floods?

NO - go to 2

VES - the wetland class is Tidal Fringe - go to 1.1

1.1 Is the salinity of the water during periods of annual low flow below 0.5 ppt (parts per thousand)?

NO - Saltwater Tidal Fringe (Estuarine)

is Saltwater Tidal Fringe it is an **Estuarine** wetland and is not scored. This method **cannot** be used to If your wetland can be classified as a Freshwater Tidal Fringe use the forms for **Riverine** wetlands. YES - Freshwater Tidal Fringe score functions for estuarine wetlands. The entire wetland unit is flat and precipitation is the only source (>90%) of water to it. Groundwater and surface water runoff are NOT sources of water to the unit. 2

NO - go to 3

YES – The wetland class is Flats If your wetland can be classified as a Flats wetland, use the form for **Depressional** wetlands.

Does the entire wetland unit meet all of the following criteria? 3

The vegetated part of the wetland is on the shores of a body of permanent open water (without any plants on the surface at any time of the year) at least 20 ac (8 ha) in size;

At least 30% of the open water area is deeper than 6.6 ft (2 m).

YES - The wetland class is Lake Fringe (Lacustrine Fringe) NO - go to 4

Does the entire wetland unit meet all of the following criteria?

4.

 \overline{X} The wetland is on a slope (slope can be very gradual), \overline{X} The water flows through the wetland in one direction (unidirectional) and usually comes from seeps. It may flow subsurface, as sheetflow, or in a swale without distinct banks,

X The water leaves the wetland without being impounded.

NO - go to 5

VES - The wetland class is Slope

shallow depressions or behind hummocks (depressions are usually <3 ft diameter and less than 1 ft NOTE: Surface water does not pond in these type of wetlands except occasionally in very small and

Does the entire wetland unit meet all of the following criteria?

Ŋ.

The unit is in a valley, or stream channel, where it gets inundated by overbank flooding from that

The overbank flooding occurs at least once every 2 years.

Wetland Rating System for Western WA: 2014 Update Rating Form - Effective January 1, 2015

3

Wetland name or number Wetland A

NOTE: The Riverine unit can contain depressions that are filled with water when the river is not YES - The wetland class is Riverine NO - go to 6 flooding

surface, at some time during the year? This means that any outlet, if present, is higher than the interior Is the entire wetland unit in a topographic depression in which water ponds, or is saturated to the of the wetland.

NO - go to 7

YES – The wetland class is Depressional

maintained by high groundwater in the area. The wetland may be ditched, but has no obvious natural Is the entire wetland unit located in a very flat area with no obvious depression and no overbank flooding? The unit does not pond surface water more than a few inches. The unit seems to be

NO - go to 8

YES – The wetland class is Depressional

AREAS IN THE UNIT (make a rough sketch to help you decide). Use the following table to identify the stream within a Depressional wetland has a zone of flooding along its sides. GO BACK AND IDENTIFY appropriate class to use for the rating system if you have several HGM classes present within the classes. For example, seeps at the base of a slope may grade into a riverine floodplain, or a small WHICH OF THE HYDROLOGIC REGIMES DESCRIBED IN QUESTIONS 1-7 APPLY TO DIFFERENT Your wetland unit seems to be difficult to classify and probably contains several different HGM wetland unit being scored. ω.

is less than 10% of the unit; classify the wetland using the class that represents more than 90% of the total area. NOTE: Use this table only if the class that is recommended in the second column represents 10% or more of the total area of the wetland unit being rated. If the area of the HGM class listed in column 2

HGM classes within the wetland unit	HGM class to
being rated	use in rating
Slope + Riverine	Riverine
Slope + Depressional	Depressional
Slope + Lake Fringe	Lake Fringe
Depressional + Riverine along stream	Depressional
within boundary of depression	
Depressional + Lake Fringe	Depressional
Riverine + Lake Fringe	Riverine
Salt Water Tidal Fringe and any other	Treat as
class of freshwater wetland	ESTUARINE

lfyou are still unable to determine which of the above criteria apply to your wetland, or ifyou have **more than 2 HGM classes** within a wetland boundary, classify the wetland as Depressional for the

Wetland name or number _____

SLOPE WETLANDS	
Water Quality Functions - Indicators that the site functions to improve water quality	ality
S 1.0. Does the site have the potential to improve water quality?	
5.1.1. Characteristics of the average slope of the wetland: (a 1% slope has a 1 ft vertical drop in elevation for every 100 ft of horizontal distance)	^
Slope is 1% or less	= 3
Slope is > 1%-2% points = 2	
Slope is > 2%-5% points = 1	= 1
Slope is greater than 5% points = 0	0 =
S 1.2. The soil 2 in below the surface (or duff layer) is true clay or true organic (use NRCS definitions): Yes = 3 No = 0	0 0=
S 1.3. Characteristics of the plants in the wetland that trap sediments and pollutants:	
Choose the points appropriate for the description that best fits the plants in the wetland. Dense means you	
have trouble seeing the soil surface (>75% cover), and uncut means not grazed or mowed and plants are higher	ther
than 6 in.	
Dense, uncut, herbaceous plants > 90% of the wetland area	= 6
Dense, uncut, herbaceous plants > ½ of area points = 3	= 3
Dense, woody, plants > ½ of area	= 2
Dense, uncut, herbaceous plants > ½ of area	= 1
Does not meet any of the criteria above for plants	0 =
Total for S 1	3 3

Record the rating on the first page Rating of Site Potential If score is: 12 = H 6-11 = M $\times 0.5 = L$

S 2.0. Does the landscape have the potential to support the water quality function of the site?	
S 2.1. Is > 10% of the area within 150 ft on the uphill side of the wetland in land uses that generate pollutants?	
Yes = 1 No = 0	_
S 2.2. Are there other sources of pollutants coming into the wetland that are not listed in question S 2.1?	
Other sources Yes = 1 No = 0	0
Total for S 2	1

Record the rating on the first page Rating of Landscape Potential If score is: $\times 1.2 = M = 0 = L$

S 3.0. Is the water quality improvement provided by the site valuable to society?	
S 3.1. Does the wetland discharge directly (i.e., within 1 mi) to a stream, river, lake, or marine water that is on the 303(d) list?	0
5.3.2. Is the wetland in a basin or sub-basin where water quality is an issue? At least one aquatic resource in the basin is on the $303(d)$ list.	0
S 3.3. Has the site been identified in a watershed or local plan as important for maintaining water quality? Answer YES if there is a TMDL for the basin in which unit is found.	0
Total for S 3 Add the points in the boxes above	0
Rating of Value If score is: $2.4 = H$ $1 = M$ $\times 0 = L$	first page

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

11

Wetland name or number _____A

SLOPE WETLANDS	
Hydrologic Functions - Indicators that the site functions to reduce flooding and stream erosion	Ľ
S 4.0. Does the site have the potential to reduce flooding and stream erosion?	
5.4.1. Characteristics of plants that reduce the velocity of surface flows during storms: Choose the points appropriate for the description that best fits conditions in the wetland. Stems of plants should be thick enough (usually > ¹ / ₈ in), or dense enough, to remain erect during surface flows. Dense, uncu, rigid plants cover > 90% of the area of the wetland All other conditions	1
Rating of Site Potential If score is: $X = M$ 0 = L	e first page

S 5.0. Does the landscape have the potential to support the hydrologic functions of the site?	s of the site?
S 5.1. Is more than 25% of the area within 150 ft upslope of wetland in land uses or cover that generate excess	er that generate excess
surface runoff?	Yes = 1 No = 0
Rating of Landscape Potential If score is: $\times 1 = M = 0 = L$	Record the rating on the first page

the first page	Rating of Value If score is: $2.4 = H$ $1 = M$ $\times 0 = L$	Rating of Valu
0	Add the points in the boxes above	Total for S 6
,	Ves = 2 No = 0	
o	S 6.2. Has the site been identified as important for flood storage or flood conveyance in a regional flood control plan?	S 6.2. Has the
	No flooding problems anywhere downstream points = 0	No flood
	Surface flooding problems are in a sub-basin farther down-gradient points = 1	Surface
0	natural resources (e.g., houses or salmon redds) points = 2	natural
	The sub-basin immediately down-gradient of site has flooding problems that result in damage to human or	The sub-
	S 6.1. Distance to the nearest areas downstream that have flooding problems:	S 6.1. Distance
	S 6.0. Are the hydrologic functions provided by the site valuable to society?	S 6.0. Are the

NOTES and FIELD OBSERVATIONS:

Wetland name or number Wetland A

		-	-	- 0
ids of all HGM classes.		strata within the Forested class. Check the mbined for each class to meet the threshold 1 the number of structures checked. 4 structures or more; points = 4 3 structures; points = 2 2 structures; points = 1 1 structure: points = 0 shrubs, herbaceous, moss/ground-cover)	the wetland. The water regime has to cover ptions of hydroperiods). 4 or more types present: points = 3 3 types present: points = 2 2 types present: points = 1 1 type present: points = 0 etland 2 points 2 points	st 10 ft?. urple loosestrife, Canadian thiste points = 2 points = 1 points = 1 points = 0 points = 1 points = 2 points = 2 points = 2 points
These questions apply to wetlands of all HGM classes. HABITAT FUNCTIONS - Indicators that site functions to provide important habitat	H 1.0. Does the site have the potential to provide habitat?	H 1.1. Structure of plant community: Indicators are Cowardin classes and strata within the Forested class. Check the Cowardin plant classes in the wetland. Up to 10 patches may be combined for each class to meet the threshold of % ac or more than 10% of the unit if it is smaller than 2.5 ac. Add the number of structures checked. Aquatic bed Astructures or more: points = 2 Emergent Scrub-shrub (areas where shrubs have > 30% cover) The Porested (areas where trees have > 30% cover) I structure: points = 1 The Porested class has 3 out of 5 strate (canopy, sub-canopy, shrubs, herbaceous, moss/ground-cover) that each cover 20% within the Forested notwon	Hydroperiods Check the types of water regimes (hydroperiods) present within the wetland. The water regime has to cover more than 10% of the wetland or % ac to count (see text for descriptions of hydroperiods). Permanently flooded or inundated Seasonally flooded or inundated Cocasionally flooded or inundated Saturated only Permanently flowing stream or river in, or adjacent to, the wetland Seasonally flowing stream in, or adjacent to, the wetland Lake Fringe wetland 2 point Printly flowing stream in, or adjacent to, the wetland Lake Fringe wetland 2 point	Richness of plant species Count the number of plant species in the wetland that cover at least 10 ft? Count the number of plant species can be combined to meet the size threshold and you do not have to name the species. Count the number of the same species can be combined to meet the size threshold and you do not have to name the species. Do not indude Eurasian miltoil, reed canarygrass, purple loosestrife, Canadian thistee points = 1 S - 19 species S - 19 species Interspersion of habitats C - Species Interspersion of habitats Decide from the diagrams below whether interspersion among Cowardin plants classes (described in H 1.1.), or the classes and unvegetated areas (can include open water or mudflats) is high, moderate, low, or none. If you have four or more plant classes on three classes and open water, the rating is always high. Tow = 0 points Low = 1 point Tow = 1 point Tow = 3 points
HABITAT FUNCTIONS	H 1.0. Does the site have	Cowardin plant class Cowardin plant class of % oc or more than Aquatic bed Emergent Scrub-shrub (ar X Forested (areas If the unit has of The Forested class that each cover	H 1.2. Hydroperiods Check the types of water regim more than 10% of the wetland Permanently flooded or in: Seasonally flooded or inun Occasionally flooded or inun X Saturated only Permanently flowing strear Seasonally flowing strear Lake Fringe wetland Freshwater tidal wetland	H 1.3. Richness of plant species Count the number of plant so Count the number of plant so Count the number of plant so Inferent parties of the som the species. Do not indude if you counted: > 19 species 5 - 19 species 6 - 5 species H 1.4. Interspersion of habitate c 5 species H 1.4. Interspersion of habitate h 1.6 species of the classes and unvegetated have four or more plant class hone = 0 points All three diagrams in this row are HIGH = 3 points

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

13

Wetland name or number ______A

Care downed, woody debris within the wetland (> 4 in diameter and 6 it long). X Large, downed, woody debris within the wetland (> 4 in diameter and 6 it long). X Standing snags (dbh > 4 in) within the wetland (> 4 in diameter and 6 it long). X Standing snags (dbh > 4 in) within the wetland (> 4 in diameter and 6 it long). Undercut banks are present for at least 6 6 if (2 m) and/or overhanging plants extends at least 3.3 if (1 m) over a stream for ditch) in, or configuous with the wetland, for at least 33 if (10 m). Stable steep banks of fine material that might be used by beaver or muskraf for denning (> 30 degree slope) OR signs of recent beaver activity are present (cut shrubs or trees that have not yet weathered where wood is exposed) At least is accord thin-stemmed persistent plants or woody branches are present in areas that are permanently or seasonally inundated (structures for egg-loying by amphibitons) Linvasive plants cover less than 25% of the wetland area in every stratum of plants (see H 1.1 for list of strato) Strato) Total for H 1 Rating of Site Potential If score is:
X Standing snags (dbh x 4 in) within the wetland Where word in a stream (or ditch) in, or contiguous with the wetland, for at least 33 ft (1 m) over a stream (or ditch) in, or contiguous with the wetland, for at least 33 ft (1 m) Stable steep banks of fine material that might be used by beaver or muskrat for denning (>30 degree slope) OR signs of frecent beaver activity are present (cut shrubs or trees that have not yet weathered where wood is exposed) At least & ac of thin-emmed persistent plants or woody branches are present in areas that are permanently or seasonally inundated (structures for egg-laying by amphibions) At least & ac of thin-emmed persistent plants or woody branches are present in the boxes above permanently or seasonally inundated (structures for egg-laying by amphibions) Add the points (see H 1.1 for list of strato) 20. Does the landscape have the potential to support the habitat functions of the site? 20. Does the landscape have the potential to support the habitat functions of the site? Colculate: % undisturbed habitat (include only hobitat that directly obuts wetland unit). Colculate: % undisturbed habitat is: 1,3 33% of 1 km Polygon points = 3 20-3% of 1 km Polygon points = 0 10-19% of 1 km Polygon points = 0
Over a stream (or ditch) in a consistence with the weekland, for at least 33 ft (10 m) Stable steep banks of fine material that might be used by beaver or muskraf for denning (> 30 degree slope) OR signs of frecent beaver activity are present (cut shrubs or trees that have not yet weathered where wood is exposed) At least % ac of thin-stemmed persistent plants or woody branches are present in areas that are permanently or seasonally inundated (structures for egg-laying by amphibions) Add the boxes above sharp or easonally inundated (structures for egg-laying by amphibions) Add the points (see H 1.1 for list of strata) Add the points in the boxes above attracts) 2.0. Does the landscape have the potential to support the habitat functions of the site? 2.1. Accessible habitat (include only hobitat that directly abuts wetland unit). Calculate: % undisturbed habitat \(\frac{16}{16} \) + \(\frac{16}{16} \) moderate and low intensity land uses\(\frac{1}{2} \) \(\frac{10}{2} \) points = 3 20-3% of 1 km Polygon 10-19% of 1 km Polygon points = 0 10-19% of 1 km Polygon points = 1
Stable steep banks of fine material that might be used by beaver or muskrat for denning (> 30 degree slope) OR signs of recent beaver activity are present (cut shrubs or trees that have not yet weathered where wood is exposed) At least % ac of thin-stemmed persistent plants or woody branches are present in areas that are permanently or seasonally inundated (structures for egg-loying by amphibions) Invasive plants cover less than 25% of the wetland area in every stratum of plants (see H 1.1 for list of strata) Add the points in the boxes above ating of Site Potential If score is: 15-18 = H 7-14 = M X0-6 = L Record the rating on the fire 2.0. Does the landscape have the potential to support the habitat functions of the site? 3.1. Accessible habitat (include only habitat first wooderate and low intensity land uses)/2] 0 = 16 w points = 3 2.1. Accessible habitat is: points = 1 2.2. Accessible habitat is: points = 1 2.3. Accessible habitat is: points = 1 2.4. Accessible habitat is: points = 1 2.5. Accessible habitat is: points = 2 2.6. Accessible habitat is: points = 2 2.7. Accessible habitat is: points = 2 2.8. Accessible habitat is: points = 0 2.9. Accessible habitat is: points = 0 2.9. Accessible habitat is: points = 0 3.9. Accessible habitat is: poin
where woon is exposed to this exposed to the exposed present in areas that are permanently or seasonally inundated (structures for egg-loying by amphibions) —Invasive plants cover less than 25% of the wetland area in every stratum of plants (see H 1.1 for list of strata) —Invasive plants cover less than 25% of the wetland area in every stratum of plants (see H 1.1 for list of strata) 2.0 Does the landscape have the potential to support the habitat functions of the site? 2.1. Accessible habitat (include only hobitat that directly obuts wetland unit). Calculate: % undisturbed habitat is + [(% moderate and low intensity land uses)/2]
permanently or seasonally inundated (structures for egg-laying by amphibians) Linvasive plants cover less than 25% of the wetland area in every stratum of plants (see H 1.1 for list of stratu) Add the points in the boxes above Add the points in the boxes above Add the points in the boxes above S.O. Does the landscape have the potential to support the habitat functions of the site? Colculate: % undisturbed habitat (include only habitat 10 + [(% moderate and low intensity land uses)/2]_0 = 16 - 16 - 16 - 16 - 16 - 16 - 16 - 16
Invasive plants cover less than 25% of the wetland area in every stratum of plants (see H 1.1 for list of strata) Add the points in the boxes above ating of Site Potential If score is: 15-18 = H
ating of Site Potential If score is:15-18 = H7-14 = MX0-6 = L
2.0. Does the landscape have the potential to support the habitat functions of the site? 2.1. Accessible habitat (include only habitat that directly abuts wetland unit). 2.2. Accessible habitat (include only habitat that directly abuts wetland unit). Calculate: % undisturbed habitat 16 + [(% moderate and low intensity land uses)/2] 0 = 16 % if total accessible habitat is: > ½ (83.3%) of 1 km Polygon 2.3. Accessible habitat is: points = 3 points = 3 to -33% of 1 km Polygon 2.4. Accessible habitat is: points = 3 points = 3 to -35% of 1 km Polygon 2.5. Accessible habitat is: points = 3 points = 1 to -35% of 1 km Polygon 2.6. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.7. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.8. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 1 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 10 to -35% of 1 km Polygon 2.9. Accessible habitat is: points = 10 to -35% of 1 km Polygon 2.9.
0
tensity land uses)/2 $\frac{1}{2}$ = _
at is:
alygon n n
-
H 2.2. Undisturbed habitat in 1 km Polygon around the wetland. Calculate: % undisturbed habitat 48 ± [9, moderate and low intensity land uses/2] 1 = 47 %
ed habitat > 50% of Polygon
patches points =
Undisturbed habitat 10-50% and > 3 patches
Undisturbed habitat < 10% of 1 km Polygon
> 50% of 1 km Polygon is high intensity land use
≤ 50% of 1 km Polygon is high intensity
Rating of Landscape Potential If score is, $4.6 = H$ $1.3 = M$ $\times (1 = L$ Record the rating on the first page
H 3.0. Is the habitat provided by the site valuable to society?
H.3.1. Does the site provide habitat for species valued in laws, regulations, or policies? Choose only the highest score
Cite meets ANY of the following criteria:
thin 100 m (see next page)
— It provides habitat for Threatened or Endangered species (any plant or animal on the state or federal lists)
— It is a Watland of High Conservation Value as determined by the Denartment of Natural Recourses — It is a Watland of High Conservation Value as determined by the Denartment of Natural Recourses
the been categorized as an important habitat site in a local or regional comprehensive plan, in a
Shoreline Master Plan, or in a watershed plan Site has 1 or 2 priority habitats (listed on next page) within 100 m
Site does not meet any of the criteria above
0 = L
7=0 M=T → H=Z

Wetland name or number Wetland A

WDFW Priority Habitats

Priority habitats listed by WDFW (see complete descriptions of WDFW priority habitats, and the counties in which they can be found, in: Washington Department of Fish and Wildlife. 2008. Priority Habitat and Species List. Olympia, Washington. 177 pp. http://wdfw.wagov/publications/D0165/wdfnw00165.pdf or access the list from here:

Count how many of the following priority habitats are within 330 ft (100 m) of the wetland unit: NOTE: This question is independent of the land use between the wetland unit and the priority habitat.

- **Aspen Stands**: Pure or mixed stands of aspen greater than 1 ac (0.4 ha).
- Biodiversity Areas and Corridors: Areas of habitat that are relatively important to various species of native fish and
 wildlife (full descriptions in WDFW PHS report).
- Herbaceous Balds: Variable size patches of grass and forbs on shallow soils over bedrock.
- Old-growth/Mature forests: Old-growth west of Cascade crest. Stands of at least 2 tree species, forming a multilayered canopy with occasional small openings; with at least 8 trees/ac (20 trees/ha) > 32 in (81 cm) dhh or > 200
 years of age, Mature forests. Stands with average diameters exceeding 21 in (53 cm) dbh; crown cover may be less
 than 100%; decay, decadence, numbers of snags, and quantity of large downed material is generally less than that
 found in old-growth; 80-200 years old west of the Cascade crest.
- Oregon White Oak: Woodland stands of pure oak or oak/conifer associations where canopy coverage of the oak
 component is important (full descriptions in WDFW PHS report p. 158 see web link above).
 - component is important (Juli descriptions in WDFW PHS report p. 158 see web link above).

 Riparian: The area adjacent to aquatic systems with flowing water that contains elements of both aquatic and terrestrial ecosystems which mutually influence each other.
- Westside Prairies: Herbaceous, non-forested plant communities that can either take the form of a dry prairie or a wet
 prairie (full descriptions in WDFW PHS report p. 161 see web link above).
- Instream: The combination of physical, biological, and chemical processes and conditions that interact to provide
 functional life history requirements for instream fish and wildlife resources.
- X Nearshore: Relatively undisturbed nearshore habitats. These include Coastal Nearshore, Open Coast Nearshore, and Puget Sound Nearshore. (full descriptions of habitats and the definition of relatively undisturbed are in WDFW report see web link on previous page).
- Caves: A naturally occurring cavity, recess, void, or system of interconnected passages under the earth in soils, rock, ice, or other geological formations and is large enough to contain a human.
- Cliffs: Greater than 25 ft (7.6 m) high and occurring below 5000 ft elevation.
- Talus: Homogenous areas of rock rubble ranging in average size 0.5 6.5 ft (0.15 2.0 m), composed of basalt, andesite, and/or sedimentary rock, including riprap slides and mine tailings. May be associated with cliffs.
- Snags and Logs. Trees are considered snags if they are dead or dying and exhibit sufficient decay characteristics to enable cavity excavation/use by wildlife. Priority snags have a diameter at breast height of > 20 in (51 cm) in western Washington and are > 6.5 ft (2 m) in height. Priority logs are > 12 in (30 cm) in diameter at the largest end, and > 20 ft (6 m) long.

Note: All vegetated wetlands are by definition a priority habitat but are not included in this list because they are addressed

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

15

Wetland name or number Wetland B

RATING SUMMARY – Western Washington

	Trained by Ecology? \times Yes No Date of training $\frac{2014}{}$	Wetland has multiple HGM classes? $\mathbb{Y} \times \mathbb{N}$ N
Name of wetland (or ID #): Viewcrest Wetland B	Rated by C. Van Slyke Trained I	4GM Class used for rating Slope We

OVERALL WETLAND CATEGORY $^{ ext{IV}}$ (based on functions $\overline{ imes}$ or special characteristics $^{ ext{IV}}$

1. Category of wetland based on FUNCTIONS

Score for each function based on three ratings (order of ratings is not important)

9 = H,H,H 8 = H,H,M

FUNCTION	Improving Water Quality	Hydrologic	Habitat	
		Circle the ap	Circle the appropriate ratings	
Site Potential	HO MOLO	HO MOLO HO MOLO HO MOLO	HO MO LO	
Landscape Potential HO MOLO HO MOLO HO MOLO	HO MOLO	HO MO LO	HO MO LO	
Value	HO MOLO	HO MO LO	HO MOLO HO MOLO HO MOLO TOTAL	TOTAL
Score Based on Ratings	4	က	4	11

2. Category based on SPECIAL CHARACTERISTICS of wetland

CHARACTERISTIC	CATEGORY	
Estuarine	II I	
Wetland of High Conservation Value	I	
Bog	I	
Mature Forest	I	
Old Growth Forest	I	
Coastal Lagoon	II II	
Interdunal	VI III II	
None of the above	\boxtimes	

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

Wetland name or number _____

Maps and figures required to answer questions correctly for Western Washington

Depressional Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	D 1.3, H 1.1, H 1.4	
Hydroperiods	D 1.4, H 1.2	
Location of outlet (can be added to map of hydroperiods)	D 1.1, D 4.1	
Boundary of area within 150 ft of the wetland (can be added to another figure) D 2.2, D 5.2	D 2.2, D 5.2	
Map of the contributing basin	D 4.3, D 5.3	
1 km Polygon: Area that extends 1 km from entire wetland edge - including	Н 2.1, Н 2.2, Н 2.3	
polygons for accessible habitat and undisturbed habitat		
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	D 3.1, D 3.2	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	D 3.3	

Riverine Wetlands

Map of:	To answer questions: Fig	Figure #
Cowardin plant classes	Н 1.1, Н 1.4	
Hydroperiods	H 1.2	
Ponded depressions	R 1.1	
Boundary of area within 150 ft of the wetland (can be added to another figure)	R 2.4	
Plant cover of trees, shrubs, and herbaceous plants	R 1.2, R 4.2	
Width of unit vs. width of stream (can be added to another figure)	R 4.1	
Map of the contributing basin	R 2.2, R 2.3, R 5.2	
1 km Polygon: Area that extends 1 km from entire wetland edge - including	Н 2.1, Н 2.2, Н 2.3	
polygons for accessible habitat and undisturbed habitat		
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	R 3.1	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	R 3.2, R 3.3	

Lake Fringe Wetlands

7 = H,H,L 7 = H,M,M 6 = H,M,L 6 = M,M,M 5 = H,L,L 5 = M,M,L 4 = M,L,L 3 = L,L,L

Map or:	To answer questions:	Figure #
Cowardin plant classes	L1.1, L4.1, H1.1, H1.4	
Plant cover of trees, shrubs, and herbaceous plants	L 1.2	
Boundary of area within 150 ft of the wetland (can be added to another figure) L 2.2	L 2.2	
1 km Polygon: Area that extends 1 km from entire wetland edge - including	Н 2.1, Н 2.2, Н 2.3	
polygons for accessible habitat and undisturbed habitat		
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	L 3.1, L 3.2	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	L 3.3	

Slope Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	Н 1.1, Н 1.4	∢
Hydroperiods	H 1.2	В
Plant cover of dense trees, shrubs, and herbaceous plants	S 1.3	٧
Plant cover of dense, rigid trees, shrubs, and herbaceous plants	S 4.1	<
(can be added to figure above)		ζ
Boundary of 150 ft buffer (can be added to another figure)	\$ 2.1, \$ 5.1	ω
1 km Polygon: Area that extends 1 km from entire wetland edge - including	Н 2.1, Н 2.2, Н 2.3	c
polygons for accessible habitat and undisturbed habitat		ر
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	5 3.1, 5 3.2	О
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	S 3.3	О
	c	

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

Wetland name or number Wetland B

HGM Classification of Wetlands in Western Washington

For questions 1-7, the criteria described must apply to the entire unit being rated

If the hydrologic criteria listed in each question do not apply to the entire unit being rated, you probably have a unit with multiple HGM classes. In this case, identify which hydrologic criteria in questions 1-7 apply, and go to Question 8.

Are the water levels in the entire unit usually controlled by tides except during floods?

NO - go to 2

VES - the wetland class is Tidal Fringe - go to 1.1

1.1 Is the salinity of the water during periods of annual low flow below 0.5 ppt (parts per thousand)?

NO - Saltwater Tidal Fringe (Estuarine)

score functions for estuarine wetlands.

is Saltwater Tidal Fringe it is an **Estuarine** wetland and is not scored. This method **cannot** be used to If your wetland can be classified as a Freshwater Tidal Fringe use the forms for **Riverine** wetlands.

YES - Freshwater Tidal Fringe

The entire wetland unit is flat and precipitation is the only source (>90%) of water to it. Groundwater and surface water runoff are NOT sources of water to the unit. 2

NO - go to 3

YES – The wetland class is Flats If your wetland can be classified as a Flats wetland, use the form for **Depressional** wetlands.

Does the entire wetland unit meet all of the following criteria? 3

The vegetated part of the wetland is on the shores of a body of permanent open water (without any plants on the surface at any time of the year) at least 20 ac (8 ha) in size;

At least 30% of the open water area is deeper than 6.6 ft (2 m).

YES - The wetland class is Lake Fringe (Lacustrine Fringe) NO - go to 4

Does the entire wetland unit meet all of the following criteria?

4.

 \overline{X} The wetland is on a slope (slope can be very gradual), \overline{X} The water flows through the wetland in one direction (unidirectional) and usually comes from

seeps. It may flow subsurface, as sheetflow, or in a swale without distinct banks,

X The water leaves the wetland without being impounded.

NO - go to 5

YES - The wetland class is Slope

shallow depressions or behind hummocks (depressions are usually <3 ft diameter and less than 1 ft NOTE: Surface water does not pond in these type of wetlands except occasionally in very small and

Does the entire wetland unit meet all of the following criteria?

Ŋ.

The unit is in a valley, or stream channel, where it gets inundated by overbank flooding from that

The overbank flooding occurs at least once every 2 years.

Wetland Rating System for Western WA: 2014 Update Rating Form - Effective January 1, 2015

3

Wetland name or number_wetland B

NOTE: The Riverine unit can contain depressions that are filled with water when the river is not YES - The wetland class is Riverine NO - go to 6 flooding

surface, at some time during the year? This means that any outlet, if present, is higher than the interior Is the entire wetland unit in a topographic depression in which water ponds, or is saturated to the of the wetland.

NO - go to 7

YES – The wetland class is Depressional

maintained by high groundwater in the area. The wetland may be ditched, but has no obvious natural Is the entire wetland unit located in a very flat area with no obvious depression and no overbank flooding? The unit does not pond surface water more than a few inches. The unit seems to be outlet.

NO - go to 8

YES – The wetland class is Depressional

AREAS IN THE UNIT (make a rough sketch to help you decide). Use the following table to identify the stream within a Depressional wetland has a zone of flooding along its sides. GO BACK AND IDENTIFY appropriate class to use for the rating system if you have several HGM classes present within the classes. For example, seeps at the base of a slope may grade into a riverine floodplain, or a small WHICH OF THE HYDROLOGIC REGIMES DESCRIBED IN QUESTIONS 1-7 APPLY TO DIFFERENT Your wetland unit seems to be difficult to classify and probably contains several different HGM wetland unit being scored. ω.

is less than 10% of the unit; classify the wetland using the class that represents more than 90% of the total area. NOTE: Use this table only if the class that is recommended in the second column represents 10% or more of the total area of the wetland unit being rated. If the area of the HGM class listed in column 2

lfyou are still unable to determine which of the above criteria apply to your wetland, or ifyou have **more than 2 HGM classes** within a wetland boundary, classify the wetland as Depressional for the

Wetland name or number ____

SLOPE WETLANDS	
Water Quality Functions - Indicators that the site functions to improve water quality	
S 1.0. Does the site have the potential to improve water quality?	
5 1.1. Characteristics of the average slope of the wetland: (a 1% slope has a 1 ft vertical drop in elevation for every 100 ft of horizontal distance)	
Slope is 1% or less points = 3	c
Slope is > 1%-2% points = 2	ò
Slope is > 2%-5% points = 1	
Slope is greater than 5% points = 0	
S 1.2. The soil 2 in below the surface (or duff layer) is true clay or true organic (use NRCS definitions): Yes = 3 No = 0	0
S 1.3. Characteristics of the plants in the wetland that trap sediments and pollutants:	
Choose the points appropriate for the description that best fits the plants in the wetland. Dense means you	
have trouble seeing the soil surface (>75% cover), and uncut means not grazed or mowed and plants are higher than 6 in.	
Dense, uncut, herbaceous plants > 90% of the wetland area	2
Dense, uncut, herbaceous plants > $\frac{1}{2}$ of area	
Dense, woody, plants > 1/4 of area points = 2	
Dense, uncut, herbaceous plants > ¼ of area points = 1	
Does not meet any of the criteria above for plants	
Total for S 1	2

Record the rating on the first page Rating of Site Potential If score is: 12 = H 6-11 = M $\times 0.5 = L$

2.0. Does the landscape have the pote	S 2.0. Does the landscape have the potential to support the water quality function of the site?	ion of the site?	
12.1. Is $> 10%$ of the area within 150 ft on the	5.2.1. Is > $10%$ of the area within 150 ft on the uphill side of the wetland in land uses that generate pollutants?	at generate pollutants?	0
		Yes = 1 No = 0	
2.2. Are there other sources of pollutants or	52.2. Are there other sources of pollutants coming into the wetland that are not listed in question 52.1 ?	in question S 2.1?	,
Other sources	upslope lawns and gardens	Yes = 1 No = 0	1
Total for S 2	Add t	Add the points in the boxes above	1

Record the rating on the first page Rating of Landscape Potential If score is: $\times 1.2 = M$ _ 0 = L

S 3.0. Is the water quality improvement provided by the site valuable to society?	
S 3.1. Does the wetland discharge directly (i.e., within 1 mi) to a stream, river, lake, or marine water that is on the 303(d) list?	0
S 3.2. Is the wetland in a basin or sub-basin where water quality is an issue? At least one aquatic resource in the bosin is on the $303(d)$ list.	0 8
S 3.3. Has the site been identified in a watershed or local plan as important for maintaining water quality? <i>Answer YES</i> if there is a TMDL for the basin in which unit is found.	0
Total for S 3 Add the points in the boxes above	0
Rating of Value If score is: $2.4 = H$ $1 = M$ $0 = L$	the first page

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

11

Wetland name or number _____

SLOPE WETLANDS	
Hydrologic Functions - Indicators that the site functions to reduce flooding and stream erosion	
S 4.0. Does the site have the potential to reduce flooding and stream erosion?	
S.4.1. Characteristics of plants that reduce the velocity of surface flows during storms: Choose the points appropriate	
for the description that best fits conditions in the wetland. Stems of plants should be thick enough (usually $> \frac{1}{8}$)	
in), or dense enough, to remain erect during surface flows.	
Dense, uncut, rigid plants cover > 90% of the area of the wetland	
All other conditions points = 0	
Record the rating of Site Potential If score is: 1=M X0=L	adac

e first page	Rating of Landscape Potential if score is: $1 = M \times 0 = L$ Record the rating on the first page	Rati
	surface runoff? Yes = $1 \text{ No} = 0$	
-	S 5.1. Is more than 25% of the area within 150 ft upslope of wetland in land uses or cover that generate excess	S 5.1
	S 5.0. Does the landscape have the potential to support the hydrologic functions of the site?	S 5.1

the first page	Rating of Value If score is: $2.4 = H$ $1 = M$ $0 = L$ Record the rating on the first page
0	Total for S 6 Add the points in the boxes above
,	Yes = 2 No = 0
O	S 6.2. Has the site been identified as important for flood storage or flood conveyance in a regional flood control plan?
	No flooding problems anywhere downstream points = 0
	Surface flooding problems are in a sub-basin farther down-gradient
0	natural resources (e.g., houses or salmon redds) points = 2
	The sub-basin immediately down-gradient of site has flooding problems that result in damage to human or
	S 6.1. Distance to the nearest areas downstream that have flooding problems:
	S 6.0. Are the hydrologic functions provided by the site valuable to society?

NOTES and FIELD OBSERVATIONS:

Wetland name or number Wetland B

These questions apply to wetlands of all HGM classes. HABITAT FUNCTIONS - Indicators that site functions to provide important habitat	These questions apply to wetlands of all HGM classes icators that site functions to provide important habitat	IGM classes.	
H 1.0. Does the site have the potential to provide habitat?	to provide habitat?		
H 1.1. Structure of plant community. Indicators are Cowardin dasses and strata within the Forested class. Check the Cowardin plant classes in the wetland. Up to 10 patches may be combined for each class to meet the threshold of % ac or more than 10% of the unit if it is smaller than 2.5 ac. Add the number of structures checked. — Aquatic bed — Aquatic bed — Structures or more: points = 2 — Emergent — Scrub-shrub (areas where shrubs have > 30% cover) — Scrub-shrub (areas where trees have > 30% cover) — Structures: points = 1 — Istructure: points = 0 — Istructure: points = 0 — If the unit has a forested class, check if: — The Forested class has 3 out of 5 strated (areas), sub-canopy, shrubs, herbaceous, moss/ground-cover) — that each cover 20% within the Forested polygon	Structure of plant community: Indicators are Cowardin classes and strata within the Forested class. Check the Cowardin plant classes in the wetland. Up to 10 patches may be combined for each class to meet the threshold of ¼ ac or more than 10% of the unit if it is smaller than 2.5 ac. Add the number of structures checked. Aquatic bed A structures or more: points = 2 Emergent Scrub-shrub (areas where shrubs have > 30% cover) X Forested (areas where trees have > 30% cover) If the unit has a Forested class, check if: The Forested class has 3 and to 5 strated (clanopy, sub-canopy, shrubs, herbaceous, moss/ground-cover) that each cover 20% within the Forested polywon	in the Forested class. Check the each class to meet the threshold r of structures checked. 4 structures or more: points = 4 3 structures; points = 1 2 structures; points = 0 1 structure: points = 0	0
H 1.2. Hydroperiods Check the types of water regimes (hydroperiods) present with more than 10% of the wetland or ¼ ac to count (see text for de permanently flooded or inundated Seasonally flooded or inundated Occasionally flooded or inundated X Saturated only Permanently flowing stream or river in, or adjacent to, the Seasonally flowing stream in, or adjacent to, the Wetland Lake Fringe wetland Freshwater tidal wetland	o count (see text for descriptions of o count (see text for descriptions of o count (see text for descriptions of o count (see text for descriptions).	m 01 - 1 C	0
H 1.3. Richness of plant species Count the number of plant species ir Different patches of the same specie the species. Do not include Eurasia If you counted: > 19 species < 5 - 19 species < 5 species	Richness of plant species Count the number of plant species in the wetland that cover at least 10 ft². Count the number of plant species can be combined to meet the size threshold and you do not have to name uperies of the same species can be combined to meet the size threshold and thistle the species port include Eurosian milfoil, reed canarygrass, purple loosestrife, Canadian thistle Fig. 19 species 5 - 19 species c S species points = 0	old and you do not have to name strife, Canadian thistle points = 2 points = 1 points = 0	-
H 1.4. Interspersion of habitats Decide from the diagrams below wh the classes and unvegetated areas (hove four or more plant classes or th None = 0 points All three diagrams in this row are HIGH = 3points	Interspersion of habitats Decide from the diagrams below whether interspersion among Cowardin plants classes (described in H 1.1), or the classes and unwegstated areas (can include open water or mudifats) is high, moderate, low, or none. If you have four or more plant classes or three classes and open water, the rating is always high. Interspersion among Cowardin plants are classes or three classes and open water or mudifats) is high, moderate, low, or none. If you have four or more plant classes or three classes and open water, the rating is always high. Interspersion among Cowardin plants are classes and open water or mudifats) is high, moderate = 2 points. Interspersion among Cowardin plants are classes and open water or mudifats) is high, moderate = 2 points. Interspersion among Cowardin plants are classes and open water or mudifats are classes and open water or moderate = 2 points. Interspersion among Cowardin plants are classes and open water or mudifats are classes and open water or moderate = 2 points. Interspersion among Cowardin plants are classes and open water or mudifats are classes and open water or mudifats are classes and open water or mudifats.	plants classes (described in H 1.1), or shigh, moderate, low, or none. If you g is always high. Moderate = 2 points	ō

Wetland Rating System for Western WA: 2014 Update Rating Form - Effective January 1, 2015

13

Wetland name or number _____

H.1.5. Special habitat features: Check the habitat features that are present in the wetland. <i>The number of checks is the number of points</i> .	
X Large, downed, woody debris within the wetland (> 4 in diameter and 6 ft long). X Standing snags (dbh > 4 in) within the wetland	
Undercut banks are present for at least 6.6 ft (2 m) and/or overhanging plants extends at least 3.3 ft (1 m) over a stream (or ditch) in, or contiguous with the wetland, for at least 33 ft (10 m) Stable steep banks of fine material that might be used by beaver or muskrat for denning (> 30 degree slope) OR signs of recent beaver activity are present (cut shrubs or trees that have not yet weathered where wood is excreted)	2
At least % ac of thin-stemmed persistent plants or woody branches are present in areas that are permanently or seasonally inundated (structures for egg-loying by amphibions)	
Total for H 1	6
Rating of Site Potential If score is: $15-18 = H$ $7-14 = M$ $\times 0-6 = L$ Record the rating on the first page	ıe first pag
H 2.0. Does the landscape have the potential to support the habitat functions of the site?	
H 2.1. Accessible habitat (include <i>only habitat that directly abuts wetland unit</i>). Calculate: % undisturbed habitat $\frac{16}{16} + \frac{16}{16}$ wnoderate and low intensity land uses $\frac{1}{20} = \frac{16}{16}$ %	
If total accessible habitat is: $> \frac{1}{2} / 33.3\%$) of 1 km Polygon points = 3	-
points =	
1 km Polygon around the wetland.	
itat $\frac{46}{1}$ + [(% moderate and low intensity land uses)/2] $\frac{1}{1}$ = $\frac{47}{1}$	
Undisturbed habitat 10-50% and in 1-3 patches	-
S	
Undisturbed habitat < 10% of 1 km Polygon	
land use	-5
S 50% Of 1 km Poygon is nign intensity Total for H 2 And the moints in the boxes above	0
ndscape Potential If score is: 4-6 = H 1-3 = M X < 1 = L	e first page
H 3.0. Is the habitat provided by the site valuable to society?	
H 3.1. Does the site provide habitat for species valued in laws, regulations, or policies? Choose only the highest score that applies to the wetland being rated. Site meets ANY of the following criteria:	
It has 3 or more priority habitats within 100 m (see next page) It provides habitat for Threatened or Endangered species (any plant or animal on the state or federal lists)	
It is mapped as a location for an individual WDFW priority species It is a Wetland of High Conservation Value as determined by the Department of Natural Resources It has been careendated as an important habitat site in a local or regional comprehensive plan in a	-
Shoreline Master Plan, or in a watershed plan Site has 1 or 2 priority habitats (listed on next page) within 100 m	
Site does not meet any of the criteria above	
Rating of Value If score is: $2 = H \times 1 = M = 0 = L$	he first pag

Wetland Kating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

Wetland name or number Wetland B

WDFW Priority Habitats

Priority habitats listed by WDFW (see complete descriptions of WDFW priority habitats, and the counties in which they can be found, in: Washington Department of Fish and Wildlife. 2008. Priority Habitat and Species List. Olympia, Washington. 177 pp. http://wdfw.wagov/publications/D0165/wdfnw00165.pdf or access the list from here:

Count how many of the following priority habitats are within 330 ft (100 m) of the wetland unit: NOTE: This question is independent of the land use between the wetland unit and the priority habitat.

- **Aspen Stands**: Pure or mixed stands of aspen greater than 1 ac (0.4 ha).
- Biodiversity Areas and Corridors: Areas of habitat that are relatively important to various species of native fish and
 wildlife (full descriptions in WDFW PHS report).
- Herbaceous Balds: Variable size patches of grass and forbs on shallow soils over bedrock.
- Old-growth/Mature forests: Old-growth west of Cascade crest. Stands of at least 2 tree species, forming a multilayered canopy with occasional small openings; with at least 8 trees/ac (20 trees/ha) > 32 in (81 cm) dhh or > 200
 years of age, Mature forests. Stands with average diameters exceeding 21 in (53 cm) dbh; crown cover may be less
 than 100%; decay, decadence, numbers of snags, and quantity of large downed material is generally less than that
 found in old-growth; 80-200 years old west of the Cascade crest.
- Oregon White Oak: Woodland stands of pure oak or oak/conifer associations where canopy coverage of the oak
 component is important (full descriptions in WDFW PHS report p. 158 see web link above).
 - Reportants. The area adjacent to aquatic systems with flowing water that contains elements of both aquatic and terrestrial ecosystems which mutually influence each other.
- Westside Prairies: Herbaceous, non-forested plant communities that can either take the form of a dry prairie or a wet
 prairie (full descriptions in WDFW PHS report p. 161 see web link above).
- Instream: The combination of physical, biological, and chemical processes and conditions that interact to provide
 functional life history requirements for instream fish and wildlife resources.
- Mearshore: Relatively undisturbed nearshore habitats. These include Coastal Nearshore, Open Coast Nearshore, and Puget Sound Nearshore, (full descriptions of Habitats and the definition of relatively undisturbed are in WDFW report see web link on previous page).
- Caves: A naturally occurring cavity, recess, void, or system of interconnected passages under the earth in soils, rock, ice, or other geological formations and is large enough to contain a human.
- Cliffs: Greater than 25 ft (7.6 m) high and occurring below 5000 ft elevation.
- Talus: Homogenous areas of rock rubble ranging in average size 0.5 · 6.5 ft (0.15 2.0 m), composed of basalt, andesite, and/or sedimentary rock, including riprap slides and mine tailings. May be associated with cliffs.
- Snags and Logs. Trees are considered snags if they are dead or dying and exhibit sufficient decay characteristics to enable cavity excavation/use by wildlife. Priority snags have a diameter at breast height of > 20 in (51 cm) in western Washington and are > 6.5 ft (2 m) in height. Priority logs are > 12 in (30 cm) in diameter at the largest end, and > 20 ft (6 m) long.

Note: All vegetated wetlands are by definition a priority habitat but are not included in this list because they are addressed

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

15

Wetland name or number Wetland C

RATING SUMMARY – Western Washington

	2014	z
Date of site visit: 6/26/20	Trained by Ecology? X Yes No Date of training ²⁰¹⁴	Wetland has multiple HGM classes? \longrightarrow Y \longrightarrow N
Date of site	es No Da	ple HGM cla
	cology?X y	nd has multi
d C	rained by E	Wetlar
Name of wetland (or ID #): Viewcrest Wetland C		٩
); View		ting Slop
etland (or ID	. Van Slyke	used for rat
Name of we	Rated by C. Van Slyke	HGM Class used for rating Slope

OVERALL WETLAND CATEGORY $^{ ext{IV}}$ (based on functions $\overline{ imes}$ or special characteristics $^{ ext{IV}}$

1. Category of wetland based on FUNCTIONS

Category II – Total score = 20 - 27 Category III – Total score = 16 - 19 X Category IV – Total score = 9 - 15

Score for each function based on three ratings (order of ratings is not important)

9 = H,H,H 8 = H,H,M

FUNCTION	Improving Water Ouality	Hydrologic	Habitat	
		Circle the app	Circle the appropriate ratings	
Site Potential	HO MOLO	HO MOLO HO MOLO HO MOLO	HO MO LO	
Landscape Potential HO MO LO HO MO LO	HO MOLO	HO MO LO	HO MO LO	
Value	HO MOL®	HO MOLO HO MOLO HO MOLO TOTAL	HO MO LO	TOTAL
Score Based on Ratings	က	3	4	10

2. Category based on SPECIAL CHARACTERISTICS of wetland

CHARACTERISTIC	CATEGORY	
Estuarine	II I	
Wetland of High Conservation Value	I	
Bog	I	
Mature Forest	I	
Old Growth Forest	I	
Coastal Lagoon	II I	
Interdunal	VI III III I	
None of the above	\boxtimes	

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

Wetland name or number _____

Maps and figures required to answer questions correctly for Western Washington

Depressional Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	D 1.3, H 1.1, H 1.4	
Hydroperiods	D 1.4, H 1.2	
Location of outlet (can be added to map of hydroperiods)	D 1.1, D 4.1	
Boundary of area within 150 ft of the wetland (can be added to another figure) D 2.2, D 5.2	D 2.2, D 5.2	
Map of the contributing basin	D 4.3, D 5.3	
1 km Polygon: Area that extends 1 km from entire wetland edge - including	Н 2.1, Н 2.2, Н 2.3	
polygons for accessible habitat and undisturbed habitat		
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	D 3.1, D 3.2	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	D 3.3	

Riverine Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	H 1.1, H 1.4	
Hydroperiods	H 1.2	
Ponded depressions	R 1.1	
Boundary of area within 150 ft of the wetland (can be added to another figure)	R 2.4	
Plant cover of trees, shrubs, and herbaceous plants	R 1.2, R 4.2	
Width of unit vs. width of stream (can be added to another figure)	R 4.1	
Map of the contributing basin	R 2.2, R 2.3, R 5.2	
1 km Polygon: Area that extends 1 km from entire wetland edge - including	Н 2.1, Н 2.2, Н 2.3	
polygons for accessible habitat and undisturbed habitat		
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	R 3.1	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	R 3.2, R 3.3	

Lake Fringe Wetlands

7 = H,H,L 7 = H,M,M 6 = H,M,L 6 = M,M,M 5 = H,L,L 5 = M,M,L 4 = M,L,L 3 = L,L,L

Map or:	lo answer questions: Figure #	Figure #
Cowardin plant classes	L1.1, L4.1, H1.1, H1.4	
Plant cover of trees, shrubs, and herbaceous plants	L 1.2	
Boundary of area within 150 ft of the wetland (can be added to another figure) L 2.2	L 2.2	
1 km Polygon: Area that extends 1 km from entire wetland edge - including	Н 2.1, Н 2.2, Н 2.3	
polygons for accessible habitat and undisturbed habitat		
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	L 3.1, L 3.2	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	L 3.3	

Slope Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	Н 1.1, Н 1.4	∢
Hydroperiods	H 1.2	В
Plant cover of dense trees, shrubs, and herbaceous plants	S 1.3	٧
Plant cover of dense, rigid trees, shrubs, and herbaceous plants	S 4.1	<
(can be added to figure above)		ζ
Boundary of 150 ft buffer (can be added to another figure)	5 2.1, 5 5.1	В
1 km Polygon: Area that extends 1 km from entire wetland edge - including	Н 2.1, Н 2.2, Н 2.3	c
polygons for accessible habitat and undisturbed habitat)
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	5 3.1, 5 3.2	О
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	S 3.3	Q
	c	

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

Wetland name or number Wetland C

HGM Classification of Wetlands in Western Washington

For questions 1-7, the criteria described must apply to the entire unit being rated

If the hydrologic criteria listed in each question do not apply to the entire unit being rated, you probably have a unit with multiple HGM classes. In this case, identify which hydrologic criteria in questions 1-7 apply, and go to Question 8.

Are the water levels in the entire unit usually controlled by tides except during floods?

NO - go to 2

VES - the wetland class is Tidal Fringe - go to 1.1

1.1 Is the salinity of the water during periods of annual low flow below 0.5 ppt (parts per thousand)?

NO - Saltwater Tidal Fringe (Estuarine)

is Saltwater Tidal Fringe it is an **Estuarine** wetland and is not scored. This method **cannot** be used to If your wetland can be classified as a Freshwater Tidal Fringe use the forms for **Riverine** wetlands. score functions for estuarine wetlands.

YES - Freshwater Tidal Fringe

The entire wetland unit is flat and precipitation is the only source (>90%) of water to it. Groundwater and surface water runoff are NOT sources of water to the unit. 2

NO - go to 3

YES – The wetland class is Flats If your wetland can be classified as a Flats wetland, use the form for **Depressional** wetlands.

Does the entire wetland unit meet all of the following criteria? 3

The vegetated part of the wetland is on the shores of a body of permanent open water (without any plants on the surface at any time of the year) at least 20 ac (8 ha) in size;

At least 30% of the open water area is deeper than 6.6 ft (2 m).

YES - The wetland class is Lake Fringe (Lacustrine Fringe) NO - go to 4

Does the entire wetland unit meet all of the following criteria?

4.

 \overline{X} The wetland is on a slope (slope can be very gradual), \overline{X} The water flows through the wetland in one direction (unidirectional) and usually comes from seeps. It may flow subsurface, as sheetflow, or in a swale without distinct banks,

X The water leaves the wetland without being impounded.

NO - go to 5

YES - The wetland class is Slope

shallow depressions or behind hummocks (depressions are usually <3 ft diameter and less than 1 ft NOTE: Surface water does not pond in these type of wetlands except occasionally in very small and

Does the entire wetland unit meet all of the following criteria?

Ŋ.

The unit is in a valley, or stream channel, where it gets inundated by overbank flooding from that

The overbank flooding occurs at least once every 2 years.

Wetland Rating System for Western WA: 2014 Update Rating Form - Effective January 1, 2015

3

Wetland name or number Wetland C

NOTE: The Riverine unit can contain depressions that are filled with water when the river is not YES - The wetland class is Riverine NO - go to 6 flooding

surface, at some time during the year? This means that any outlet, if present, is higher than the interior Is the entire wetland unit in a topographic depression in which water ponds, or is saturated to the of the wetland.

NO - go to 7

YES – The wetland class is Depressional

maintained by high groundwater in the area. The wetland may be ditched, but has no obvious natural Is the entire wetland unit located in a very flat area with no obvious depression and no overbank flooding? The unit does not pond surface water more than a few inches. The unit seems to be outlet.

NO - go to 8

YES – The wetland class is Depressional

AREAS IN THE UNIT (make a rough sketch to help you decide). Use the following table to identify the stream within a Depressional wetland has a zone of flooding along its sides. GO BACK AND IDENTIFY appropriate class to use for the rating system if you have several HGM classes present within the classes. For example, seeps at the base of a slope may grade into a riverine floodplain, or a small WHICH OF THE HYDROLOGIC REGIMES DESCRIBED IN QUESTIONS 1-7 APPLY TO DIFFERENT Your wetland unit seems to be difficult to classify and probably contains several different HGM wetland unit being scored. ω.

is less than 10% of the unit; classify the wetland using the class that represents more than 90% of the total area. NOTE: Use this table only if the class that is recommended in the second column represents 10% or more of the total area of the wetland unit being rated. If the area of the HGM class listed in column 2

lfyou are still unable to determine which of the above criteria apply to your wetland, or ifyou have **more than 2 HGM classes** within a wetland boundary, classify the wetland as Depressional for the

Wetland name or number Wetland C

SLOPE WETLANDS	
Water Quality Functions - Indicators that the site functions to improve water quality	
S 1.0. Does the site have the potential to improve water quality?	
S 1.1. Characteristics of the average slope of the wetland: (a 1% slope has a 1 ft vertical drop in elevation for every 100 ft of horizontal distance)	
Slope is 1% or less points = 3	c
Slope is > 1%-2% points = 2	>
Slope is > 2%-5% points = 1	
Slope is greater than 5% points = 0	
S 1.2. The soil 2 in below the surface (or duff layer) is true clay or true organic (use NRCS definitions): Yes = 3 No = 0	0
S 1.3. Characteristics of the plants in the wetland that trap sediments and pollutants:	
Choose the points appropriate for the description that best fits the plants in the wetland. Dense means you	
hove trouble seeing the soil surface (>75% cover), and uncut means not grazed or mowed and plants are higher than 6 in	
Dense, uncut, herbaceous plants > 90% of the wetland area	0
Dense, uncut, herbaceous plants > ½ of area	
Dense, woody, plants > 1/2 of area	
Dense, uncut, herbaceous plants > ¼ of area points = 1	
Does not meet any of the criteria above for plants	
Total for S 1 Add the points in the boxes above	0

Record the rating on the first page Rating of Site Potential If score is: 12 = H 6-11 = M $\times 0.5 = L$

S 2.0. Does the landscape have the potential to support the water quality function of the site?	_
S 2.1. Is > 10% of the area within 150 ft on the uphill side of the wetland in land uses that generate pollutants?	c
Yes = 1 No = 0	>
S 2.2. Are there other sources of pollutants coming into the wetland that are not listed in question S 2.1?	c
Other sources Yes = 1 No = 0	0
Total for S 2 Add the points in the boxes above 0	0

Record the rating on the first page Rating of Landscape Potential If score is: $1-2 = M \times 0 = L$

	0	0	0	0	rst page
valuable to society?	S 3.1. Does the wetland discharge directly (i.e., within 1 mi) to a stream, river, lake, or marine water that is on the $303(d)$ ist?	S 3.2. Is the wetland in a basin or sub-basin where water quality is an issue? At least one aquatic resource in the basin is on the 303(d) list.	S 3.3. Has the site been identified in a watershed or local plan as important for maintaining water quality? Answer YES if there is a TMDL for the basin in which unit is found.	Add the points in the boxes above	Record the rating on the first page
vement provided by the site	directly (i.e., within 1 mi) to a str	ub-basin where water quality is a	n a watershed or local plan as im sin in which unit is found.		$= H $ $1 = M $ $\times 0 = L$
S 3.0. Is the water quality improvement provided by the site valuable to society?	S 3.1. Does the wetland discharge of 303(d) list?	S 3.2. Is the wetland in a basin or so on the 303(d) list.	S 3.3. Has the site been identified in a watershed or local pli if there is a TMDL for the basin in which unit is found.	Total for S 3	Rating of Value If score is: $2.4 = H$ $1 = M$ $\times 0 = L$

11

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

Wetland name or number _____

SLOPE WETLANDS	
Hydrologic Functions - Indicators that the site functions to reduce flooding and stream erosion	
S 4.0. Does the site have the potential to reduce flooding and stream erosion?	
S 4.1. Characteristics of plants that reduce the velocity of surface flows during storms: Choose the points appropriate	
for the description that best fits conditions in the wetland. Stems of plants should be thick enough (usually $>^{1}/_{8}$	
in), or dense enough, to remain erect during surface flows.	
Dense, uncut, rigid plants cover > 90% of the area of the wetland	
All other conditions points = 0	
Record the rating of Site Potential If score is: $1 = M \times 0 = L$	aaac

	ĺ
S 5.0. Does the landscape have the potential to support the hydrologic functions of the site?	
S 5.1. Is more than 25% of the area within 150 ft upslope of wetland in land uses or cover that generate excess	
surface runoff? Yes = 1 No = 0	-
Rating of Landscape Potential If score is: 1= M × 0 = L	st page

S 6.0. Are the hydrologic functions provided by the site valuable to society?	
S 6.1. Distance to the nearest areas downstream that have flooding problems:	
The sub-basin immediately down-gradient of site has flooding problems that result in damage to human or	
natural resources (e.g., houses or salmon redds) points = 2	0
Surface flooding problems are in a sub-basin farther down-gradient	
No flooding problems anywhere downstream points = 0	
S 6.2. Has the site been identified as important for flood storage or flood conveyance in a regional flood control plan?	0
Yes = 2 No = 0	
Total for S 6 Add the points in the boxes above	0
Dating of Value ferova is 2.4 - H 1 - M X 0 - 1	ho firet nado

NOTES and FIELD OBSERVATIONS:

Wetland name or number Wetland C

These questions apply to wetlands of all HGM classes. HABITAT FUNCTIONS - Indicators that site functions to provide important habitat	of all HGM classes.	
H 1.0. Does the site have the potential to provide habitat?		
H 1.1. Structure of plant community: Indicators are Cowardin classes and strata within the Forested class. Check the Cowardin plant classes in the wetland. Up to 10 patches may be combined for each class to meet the threshold of ¼ or or more than 10% of the unit if it is smaller than 2.5 ac. Add the number of structures checked. — Add the number of structures checked. — Add the number of structures or more: points = 2 — Emergent — Scrub-shrub (areas where shrubs have > 30% cover) — Scrub-shrub (areas where trees have > 30% cover) — Istructures: points = 1 — Structures: points = 1 — Istructure: points = 0 If the unit has a Forested class, sheek if: — The Forested class has a out of 5 strated (clanopy, sub-canopy, shrubs, herbaceous, moss/ground-cover) — that each rover 20% within the Forested polywon	B + 11 + 6	0
H 1.2. Hydroperiods Check the types of water regimes (hydroperiods) present within the wetland. The water regime has to cover more than 10% of the wetland or % act to count (see text for descriptions of hydroperiods). Permanently flooded or inundated Seasonally flooded or inundated X saturated only Permanently flowing stream or river in, or adjacent to, the wetland Seasonally flowing stream in, or adjacent to, the wetland Type present: points = (Seasonally flowing stream in, or adjacent to, the wetland Lake Fringe wetland Ereshwater tidal wetland 2 points	20 d d 0 10 10 10 10 10 10 10 10 10 10 10 10 1	0
H 1.3. Richness of plant species Count the number of plant species in the wetland that cover at least 10 ft². Count the number of plant species can be combined to meet the size threshold and you do not have to name by the species on be combined to meet the size threshold and you do not have to name the species and plants the species profile, read canarygrass, purple loosestrife, Canadian thistle If you counted: > 19 species 5 - 19 species c > 5 species points = 0	10 ft ² . The treshold and you do not have to name ite loosestrife, Canadian thistle points = 2 points = 1 points = 0	٢
H 1.4. Interspersion of habitats Decide from the diagrams below whether interspersion among Cowardin plants classes (described in H 1.1), or the classes and unvegetated areas (can include open water or mudflats) is high, moderate, low, or none. If you have four or more plant classes or three classes and open water, the rating is always high. None = 0 points All three diagrams in this row are HIGH = 3 points		0

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

13

Wetland name or number _____

n 1.3. special readures. Check the habitat features that are present in the wetland. The number of checks is the number of points.	
angst, downed, wodey deens within the wetland (> 4 in diameter and 0 it forg)	
Undercut banks are present for at least 6.6 ft (2 m) and/or overhanging plants extends at least 3.3 ft (1 m)	
over a stream (or ditch) in, or contiguous with the wetland, for at least 33 ft (10 m)	
stope) OR signs of recent beaver activity are present (cut shrubs or trees that have not yet weathered	-
where wood is exposed)	
At least ¼ ac of thin-stemmed persistent plants or woody branches are present in areas that are	
permanently or seasonally inundated (structures for egg-laying by amphibians)	
\overline{X} Invasive plants cover less than 25% of the wetland area in every stratum of plants (see H 1.1 for list of	
strata)	
Total for H 1	2
Rating of Site Potential If score is: 15-18 = H \sim 7-14 = M \sim 0-6 = L	he first pa
H 2.0. Does the landscape have the potential to support the habitat functions of the site?	
H 2.1. Accessible habitat (include only habitat that directly abuts wetland unit).	
Calculate: % undisturbed habitat 16 + [(% moderate and low intensity land uses)/2] 0 = 16 %	
If total accessible habitat is:	
> ¹ / ₃ (33.3%) of 1 km Polygon points = 3	-
10-19% of 1 km Polygon points = 1	
< 10% of 1 km Polygon	
ed habitat in 1 km Polygon around the wetland.	
$\frac{40}{100} + \frac{1}{100}$ moderate and low intensity land uses)/2] = $\frac{47}{100}$	
	-
es points =	
S	
ıygorı pomus =	
land use po	-5
OLT KIII POLYBOILIS HIBH HILEHISILY	ď
Add the points	0
Rating of Landscape Potential If score is: $-4.6 = H$ $-1.3 = M$ $\times < 1 = L$ Record the rating on the first page	e first pag
H 3.0. Is the habitat provided by the site valuable to society?	•
H 3.1. Does the site provide habitat for species valued in laws, regulations, or policies? Choose only the highest score	,
Site meets ANY of the following criteria:	
 It has 3 or more priority habitats within 100 m (see next page) It provides habitat for Threatened or Endangered species (any plant or animal on the state or federal lists) 	
— It is mapped as a location for an individual WDFW priority species	-
— It is a Wetland of High Conservation Value as determined by the Department of Natural Resources	
— It has been categorized as an important habitat site in a local or regional comprehensive plan, in a Shoreline Master Plan, or in a watershed plan	
Site has 1 or 2 priority habitats (listed on next page) within 100 m	
Site does not meet any of the criteria above	
Rating of Value If score is: $2 = H \times 1 = M = 0 = L$	he first pa
Wotland Dating Cintom for Worter WA. 2014 Hadata	

Wetland name or number Wetland C

WDFW Priority Habitats

Priority habitats listed by WDFW (see complete descriptions of WDFW priority habitats, and the counties in which they can be found, in: Washington Department of Fish and Wildlife. 2008. Priority Habitat and Species List. Olympia, Washington. 177 pp. http://wdfw.wagov/publications/Ol165/wdfw00165.pdf or access the list from here:

Count how many of the following priority habitats are within 330 ft (100 m) of the wetland unit: NOTE: This question is independent of the land use between the wetland unit and the priority habitat.

- Aspen Stands: Pure or mixed stands of aspen greater than 1 ac (0.4 ha).
- Biodiversity Areas and Corridors: Areas of habitat that are relatively important to various species of native fish and
 wildlife (full descriptions in WDFW PHS report).
- Herbaceous Balds: Variable size patches of grass and forbs on shallow soils over bedrock.
- Old-growth/Mature forests: Old-growth west of Cascade crest. Stands of at least 2 tree species, forming a multilayered canopy with occasional small openings; with at least 8 trees/ac (20 trees/ha) > 32 in (81 cm) dhh or > 200
 years of age, Mature forests. Stands with average diameters exceeding 21 in (53 cm) dbh; crown cover may be less
 than 100%; decay, decadence, numbers of snags, and quantity of large downed material is generally less than that
 found in old-growth; 80-200 years old west of the Cascade crest.
- Oregon White Oak: Woodland stands of pure oak or oak/conifer associations where canopy coverage of the oak
 component is important (full descriptions in WDFW PHS report p. 158 see web link above).
 - component is important *yan descriptions in WDF W FIDS TEPORT p. 139 See Web THR doove).* Riparian: The area adjacent to aquatic systems with flowing water that contains elements of both aquatic and terrestrial ecosystems which mutually influence each other.
- Westside Prairies: Herbaceous, non-forested plant communities that can either take the form of a dry prairie or a wet prairie (full descriptions in WDFW PHS report p. 161 – see web link above).
- Instream: The combination of physical, biological, and chemical processes and conditions that interact to provide functional life history requirements for instream fish and wildlife resources.
- X Nearshore: Relatively undisturbed nearshore habitats. These include Coastal Nearshore, Open Coast Nearshore, and Puget Sound Nearshore. (Jull descriptions of habitats and the definition of relatively undisturbed are in WDFW report see web link on previous page).
- Caves: A naturally occurring cavity, recess, void, or system of interconnected passages under the earth in soils, rock, ice, or other geological formations and is large enough to contain a human.
- Cliffs: Greater than 25 ft (7.6 m) high and occurring below 5000 ft elevation.
- Talus: Homogenous areas of rock rubble ranging in average size 0.5 6.5 ft (0.15 2.0 m), composed of basalt, andesite, and/or sedimentary rock, including riprap slides and mine tailings. May be associated with cliffs.
- Snags and Logs. Trees are considered snags if they are dead or dying and exhibit sufficient decay characteristics to enable cavity excavation/use by wildlife. Priority snags have a diameter at breast height of > 20 in (51 cm) in western Washington and are > 6.5 ft (2 m) in height. Priority logs are > 12 in (30 cm) in diameter at the largest end, and > 20 ft (6 m) long.

Note: All vegetated wetlands are by definition a priority habitat but are not included in this list because they are addressed

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

12

Wetland name or number _____

RATING SUMMARY – Western Washington

Name of wetland (or ID #): Viewcrest Wetland D	Vetland D Date of site visit: 6/26/20
Rated by C. Van Slyke	Trained by Ecology? X Yes No Date of training 2014
HGM Class used for rating Slope	Wetland has multiple HGM classes? Y X N

NOTE: Form is not complete without the figures requested (figures can be combined).

Source of base aerial photo/map_Whalcom County 2017

OVERALL WETLAND CATEGORY IV (based on functions X or special characteristics)

1. Category of wetland based on FUNCTIONS Category 1 - Total serve = 23 - 27

Score for each function based on three ratings (order of ratings is not important)

9 = H,H,H 8 = H,H,M

FUNCTION	Improving Water Quality		Hydrologic	Habitat	
		O	rcle the app	Circle the appropriate ratings	
Site Potential	D NO NO L	OH OH	MO LO	HO MOLO HO MOLO HO MOLO	
Landscape Potential HO MO LO HO MO LO	910MOH	O _H	MO LO	HO MO LO	
Value	91ОМОН	О _Н	MO LO	HO MOLO HO MOLO HO MOLO TOTAL	TOTAL
Score Based on	က	က		4	10

2. Category based on SPECIAL CHARACTERISTICS of wetland

CHARACTERISTIC	CATEGORY
Estuarine	III I
Wetland of High Conservation Value	I
Bog	I
Mature Forest	I
Old Growth Forest	I
Coastal Lagoon	II I
Interdunal	VI III II I
None of the above	\boxtimes

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

Wetland name or number Wetland D

Maps and figures required to answer questions correctly for Western Washington

Depressional Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	D 1.3, H 1.1, H 1.4	
Hydroperiods	D 1.4, H 1.2	
Location of outlet (can be added to map of hydroperiods)	D 1.1, D 4.1	
Boundary of area within 150 ft of the wetland (can be added to another figure) D 2.2, D 5.2	D 2.2, D 5.2	
Map of the contributing basin	D 4.3, D 5.3	
1 km Polygon: Area that extends 1 km from entire wetland edge - including	н 2.1, н 2.2, н 2.3	
polygons for accessible habitat and undisturbed habitat		
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	D 3.1, D 3.2	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	D 3.3	

Riverine Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	H 1.1, H 1.4	
Hydroperiods	H 1.2	
Ponded depressions	R 1.1	
Boundary of area within 150 ft of the wetland (can be added to another figure)	R 2.4	
Plant cover of trees, shrubs, and herbaceous plants	R 1.2, R 4.2	
Width of unit vs. width of stream (can be added to another figure)	R 4.1	
Map of the contributing basin	R 2.2, R 2.3, R 5.2	
1 km Polygon: Area that extends 1 km from entire wetland edge - including	н 2.1, н 2.2, н 2.3	
polygons for accessible habitat and undisturbed habitat		
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	R 3.1	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	R 3.2, R 3.3	

Lake Fringe Wetlands

7 = H,H,L 7 = H,M,M 6 = H,M,L 6 = M,M,M 5 = H,L,L 5 = M,L,L 4 = M,L,L 3 = L,L,L

Map of:	To answer questions:	Figure #
Cowardin plant classes	L1.1, L4.1, H1.1, H1.4	
Plant cover of trees, shrubs, and herbaceous plants	L 1.2	
Boundary of area within 150 ft of the wetland (can be added to another figure) L 2.2	L 2.2	
1 km Polygon: Area that extends 1 km from entire wetland edge - including	Н 2.1, Н 2.2, Н 2.3	
polygons for accessible habitat and undisturbed habitat		
Screen capture of map of 303(d) listed waters in basin (from Ecology website) L 3.1, L 3.2	L 3.1, L 3.2	
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	L 3.3	

Slope Wetlands

Map of:	To answer questions:	Figure #
Cowardin plant classes	H 1.1, H 1.4	٧
Hydroperiods	H 1.2	В
Plant cover of dense trees, shrubs, and herbaceous plants	S 1.3	٧
Plant cover of dense, rigid trees, shrubs, and herbaceous plants	S 4.1	<
(can be added to figure above)		1
Boundary of 150 ft buffer (can be added to another figure)	5 2.1, 5 5.1	80
1 km Polygon: Area that extends 1 km from entire wetland edge - including	Н 2.1, Н 2.2, Н 2.3	(
polygons for accessible habitat and undisturbed habitat)
Screen capture of map of 303(d) listed waters in basin (from Ecology website)	5 3.1, 5 3.2	Q
Screen capture of list of TMDLs for WRIA in which unit is found (from web)	53.3	Q
	•	

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

7

Wetland name or number Wetland D

HGM Classification of Wetlands in Western Washington

For questions 1-7, the criteria described must apply to the entire unit being rated.

If the hydrologic criteria listed in each question do not apply to the entire unit being rated, you probably have a unit with multiple HGM classes. In this case, identify which hydrologic criteria in questions 1-7 apply, and go to Question 8.

Are the water levels in the entire unit usually controlled by tides except during floods?

NO - go to 2

YES - the wetland class is Tidal Fringe - go to 1.1

 $1.1\,\mathrm{ls}$ the salinity of the water during periods of annual low flow below $0.5\,\mathrm{ppt}$ (parts per thousand)?

NO - Saltwater Tidal Fringe (Estuarine)

Ifit is Saltwater Tidal Fringe it is an **Estuarine** wetland and is not scored. This method cannot be used to If your wetland can be classified as a Freshwater Tidal Fringe use the forms for **Riverine** wetlands. YES - Freshwater Tidal Fringe score functions for estuarine wetlands. The entire wetland unit is flat and precipitation is the only source (>90%) of water to it. Groundwater and surface water runoff are NOT sources of water to the unit. 2

If your wetland can be classified as a Flats wetland, use the form for **Depressional** wetlands.

YES - The wetland class is Flats

Does the entire wetland unit **meet all** of the following criteria? ω.

The vegetated part of the wetland is on the shores of a body of permanent open water (without any plants on the surface at any time of the year) at least 20 ac (8 ha) in size;

At least 30% of the open water area is deeper than 6.6 ft (2 m)

YES - The wetland class is Lake Fringe (Lacustrine Fringe) NO - go to 4

Does the entire wetland unit meet all of the following criteria?

4.

 \overline{X} The wetland is on a slope (slope can be very gradual), \overline{X} The water flows through the wetland in one direction (unidirectional) and usually comes from seeps. It may flow subsurface, as sheetflow, or in a swale without distinct banks,

X The water leaves the wetland without being impounded.

NO - go to 5

YES – The wetland class is **Slope**

shallow depressions or behind hummocks (depressions are usually <3 ft diameter and less than 1 ft NOTE: Surface water does not pond in these type of wetlands except occasionally in very small and

Does the entire wetland unit meet all of the following criteria?

. ك

The unit is in a valley, or stream channel, where it gets inundated by overbank flooding from that

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

3

Wetland name or number _____

NOTE: The Riverine unit can contain depressions that are filled with water when the river is not YES - The wetland class is Riverine NO - go to 6 flooding Is the entire wetland unit in a topographic depression in which water ponds, or is saturated to the surface, at some time during the year? This means that any outlet, if present, is higher than the interior of the wetland.

NO - go to 7

YES – The wetland class is Depressional

maintained by high groundwater in the area. The wetland may be ditched, but has no obvious natural Is the entire wetland unit located in a very flat area with no obvious depression and no overbank flooding? The unit does not pond surface water more than a few inches. The unit seems to be outlet. ۲.

NO - go to 8

YES – The wetland class is Depressional

AREAS IN THE UNIT (make a rough sketch to help you decide). Use the following table to identify the stream within a Depressional wetland has a zone of flooding along its sides. GO BACK AND IDENTIFY appropriate class to use for the rating system if you have several HGM classes present within the classes. For example, seeps at the base of a slope may grade into a riverine floodplain, or a small WHICH OF THE HYDROLOGIC REGIMES DESCRIBED IN QUESTIONS 1-7 APPLY TO DIFFERENT Your wetland unit seems to be difficult to classify and probably contains several different HGM wetland unit being scored. ω.

is less than 10% of the unit; classify the wetland using the class that represents more than 90% of the total area. NOTE: Use this table only if the class that is recommended in the second column represents 10% or more of the total area of the wetland unit being rated. If the area of the HGM class listed in column 2

HGM classes within the wetland unit	HGM class to
being rated	use in rating
Slope + Riverine	Riverine
Slope + Depressional	Depressional
Slope + Lake Fringe	Lake Fringe
Depressional + Riverine along stream	Depressional
within boundary of depression	
Depressional + Lake Fringe	Depressional
Riverine + Lake Fringe	Riverine
Salt Water Tidal Fringe and any other	Treat as
class of freshwater wetland	ESTUARINE

lfyou are still unable to determine which of the above criteria apply to your wetland, or if you have **more than 2 HGM classes** within a wetland boundary, classify the wetland as Depressional for the

Wetland name or number _____

SLOPE WETLANDS	
Water Quality Functions - Indicators that the site functions to improve water quality	
S 1.0. Does the site have the potential to improve water quality?	
S 1.1. Characteristics of the average slope of the wetland: (a 1% slope has a 1 ft vertical drop in elevation for every	
100 ft of horizontal distance)	
Slope is 1% or less points = 3	c
Slope is > 1%-2% points = 2	,
Slope is > 2%-5% points = 1	
Slope is greater than 5% points = 0	
S1.2. The soil 2 in below the surface (or duff layer) is true clay or true organic (use NRCS definitions): Yes = 3 No = 0	0
S 1.3. Characteristics of the plants in the wetland that trap sediments and pollutants:	
Choose the points appropriate for the description that best fits the plants in the wetland. Dense means you	
have trouble seeing the soil surface (>75% cover), and uncut means not grazed or mowed and plants are higher	
than 6 in.	
Dense, uncut, herbaceous plants > 90% of the wetland area	-
Dense, uncut, herbaceous plants > ½ of area points = 3	
Dense, woody, plants > ½ of area points = 2	
Dense, uncut, herbaceous plants > ¼ of area points = 1	
Does not meet any of the criteria above for plants points = 0	
Total for S 1 Add the points in the boxes above	٢

Record the rating on the first page S 2.0. Does the landscape have the potential to support the water quality function of the site? Rating of Site Potential If score is: 12 = H 6-11 = M $\times 0.5 = L$

S 2.1. Is > 10% of the area within 150 ft on the uphill side of the wetland in land uses that generate pollutants?	c
Yes = 1 No = 0	•
S 2.2. Are there other sources of pollutants coming into the wetland that are not listed in question S 2.1?	·
Other sources Yes = 1 No = 0	o
Total for S 2	0

Record the rating on the first page Rating of Landscape Potential If score is: $1-2 = M \times 0 = L$

S 3.0. Is the water quality improvement provided by the site valuable to society?	S 3.1. Does the wetland discharge directly (i.e., within 1 mi) to a stream, river, lake, or marine water that is on the 303(d) list?	5.3.2. Is the wetland in a basin or sub-basin where water quality is an issue? At least one aquatic resource in the basin is on the 303(d) list. Yes = 1 No = 0	an as important for maintaining water qu	or the basin in which unit is found. Yes = $2 \text{ No} = 0$
3.0. Is the water quality improvement provided	i 3.1. Does the wetland discharge directly (i.e., within 303(d) list?	: 3.2. Is the wetland in a basin or sub-basin where wa on the 303(d) list.	: 3.3. Has the site been identified in a watershed or local pla if there is a TMDI for the basin in which unit is found	بالمتحدث والمتحدث والمتحدد والمتد والمتحد والمتحد والمتحدد والمتحدد والمتحدد والمتحدد والمتحد

Rating of Value If score is: 2.4 = H 1 = M $\times 0 = L$

Record the rating on the first page

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

11

Wetland name or number _____

SLOPE WETLANDS	
Hydrologic Functions - Indicators that the site functions to reduce flooding and stream erosion	n
S 4.0. Does the site have the potential to reduce flooding and stream erosion?	
5 4.1. Characteristics of plants that reduce the velocity of surface flows during storms: Choose the points appropriate for the description that best fits conditions in the wetland. Stems of plants should be thick enough (usually > '/s in), or dense enough, to remain erect during surface flows. Dense, uncut, rigid plants cover > 90% of the area of the wetland All other conditions	0
Rating of Site Potential If score is: $1=M \times 0=L$	e first page

e first page	Rating of Landscape Potential If score is1 = M X 0 = L Record the rating on the first page
	surface runoff? Yes = 1 No = 0
+	S 5.1. Is more than 25% of the area within 150 ft upslope of wetland in land uses or cover that generate excess
	S 5.0. Does the landscape have the potential to support the hydrologic functions of the site?

S 6.1. Distance to the nearest areas downstream that have flooding problems:	The sub-basin immediately down-gradient of site has flooding problems that result in damage to human or		Surface (Bodding problems are in a sub-basin falurer downrighadren). No flooding problems anywhere downstream	S 6.2. Has the site been identified as important for flood storage or flood conveyance in a regional flood control plan? $_0$ Yes = $2~No$ = 0	Add the points in the boxes above 0	re is: $2.4 = H$ $1 = M$ $\times 0 = L$ Record the rating on the first page
	S 6.1. Distance to the nearest areas downst The sub-basin immediately down-gra	natural resources (e.g., houses or salmon redds)	Surface nodding problems are in a sub-bashin No flooding problems anywhere downstream	S 6.2. Has the site been identified as import	Total for S 6	Rating of Value If score is: $2-4 = H$ $1 = M$ $\times 0 = L$

Rating of Value If score is: 2-4 = H 1 = M $\times 0 = L$

NOTES and FIELD OBSERVATIONS:

Wetland name or number Wetland D

The HABITAT FUNCTIONS - Indic	These questions apply to wetlands of all HGM classes. HABITAT FUNCTIONS - Indicators that site functions to provide important habitat	all HGM classes.
H 1.0. Does the site have the potential to provide habitat?	ential to provide habitat?	
H 1.1. Structure of plant community: Indicators are Coward Cowardin plant classes in the wetland. Up to 10 pate of % acor more than 10% of the unit if it is smaller th Aquatic bed X Emergent X Scrub-shrub (areas where shrubs have > 30% co Forested (areas where trees have > 30% cover) If the unit has a Forested class, check if If the unit has a Forested class, check if The Forested class has 3 out of 5 strata (canop) that each cover 20% within the Forested polyg	H 1.1. Structure of plant community: Indicators are Cowardin classes and strata within the Forested class. Check the Cowardin plant classes in the wetland. Up to 10 patches may be combined for each class to meet the threshold of % ac or more than 10% of the unit if it is smaller than 2.5 ac. Add the number of structures checked. Aquatic bed Astructures or more: points = 2 Structures: points = 2 Structures: points = 2 Forested (areas where shrubs have > 30% cover) Forested (areas where trees have > 30% cover) I structures: points = 0 If the unit has a of posseted class, check if. The Forested class has 3 out of 5 strata (canopy, sub-canopy, shrubs, herbaceous, moss/ground-cover) that each cover 20% within the Forested polygon	within the Forested class. Check the for each class to meet the threshold mber of structures checked. 4 structures or more: points = 4 3 structures: points = 1 1 structure: points = 0 herbaceous, moss/ground-cover)
H 12. Hydroperiods Check the types of water regimes (hydromore than 10% of the wetland or % act more than 10% of the wetland or % act Permanently flooded or inundated Cocasionally flooded or inundated X saturated only Permanently flowing stream or rive Permanently flowing stream in, or ad Lake Fringe wetland Freshwater tidal wetland	Hydroperiods Check the types of water regimes (hydroperiods) present within the wetland. The water regime has to cover more than 10% of the wetland or % acto count (see text for descriptions of hydroperiods). Permanently flooded or inundated Cocasionally flooded or inundated As more types present: points =: Cocasionally flooded or inundated Types present: points =: Seasonally flowing stream or river in, or adjacent to, the wetland Lake Fringe wetland Lake Fringe wetland Spoint Sp	nd. The water regime has to cover findropenods). 4 or more types present: points = 3 types present: points = 2 types present: points = 1 1 type present: points = 0
H 1.3. Richness of plant species Count the number of plant spe Different patches of the same the species. Do not include E If you counted: > 19 species < 5 - 19 species < 5 species	Richness of plant species Count the number of plant species in the wetland that cover at least 10 ft? Count the number of plant species can be combined to meet the size threshold and you do not have to name byficerent patches of the same species can be combined to meet the size threshold and you do not have to name the species. The species speci	reshold and you do not have to name osestrife, Canadian thiste points = 2 points = 1 points = 1
H 1.4. Interspersion of habitats Decide from the diagrams better classes and unvegetated. howe four or more plant class None = 0 points All three diagrams in this row are HIGH = 3points	Interspersion of habitats Decide from the diagrams below whether interspersion among Cowardin plants classes (described in H 1.1), or the classes and unvegetated areas (can include open water or mudflats) is high, moderate, low, or none. If you have four or more plant classes or three classes and open water, the rating is always high. Interspersion among Cowardin plants or none. If you have four or more plant classes or three classes and open water, the rating is always high. Interspersion among Cowardin Plants Intersper	plants classes (described in H 1.1), or high, moderate, low, or none. If you g is always high. Moderate = 2 points

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

13

Wetland name or number _____

H 1.5. Special habitat features:	
Check the habitat features that are present in the wetland. The number of checks is the number of points. X large, downed, woody debris within the wetland (> 4 in diameter and 6 ft long). Standing snags (dbh > 4 in) within the wetland (> 4 in diameter and 6 ft long). Standing snags (dbh > 4 in) within the wetland (> 10 in) and/or overhanging plants extends at least 3.3 ft (1 m) over a stream (or ditch) in, or contiguous with the wetland, for at least 33 ft (10 m) Stable steep banks of fine material that might be used by beaver or muskrat for denning (> 30 degree slope) (OR signs of recent beaver activity are present (cut shrubs or trees that have not yet weathered where wood is exposed) At least is a cof thin-stemmed persistent plants or woody branches are present in areas that are permanently or seasonally inundated (structures for egg-loying by omphibions)	~
wasive plants cover less than 25% of the wetland area in every stratur strata)	
Add the points in	ر د د
Rating of Site Potential If score is: 15-18 = H 7-14 = M $\times 0.6$ = L Record the rating on the first page H 2.0. Does the landscape have the potential to support the habitat functions of the site?	e first pag
H.2.1. Accessible habitat (include <i>only habitat that directly abuts wetland unit</i>). Calculate: % undisturbed habitat $\frac{16}{16} + \frac{16}{16}$ woderate and low intensity land uses)/21_0 =16%	
If total accessible habitat is: ${}^{1}/_{3}(33.3\%) \text{ of } 1 \text{ km Polygon} \\$	-
20-33% of 1 km Polygon points = 2	
round the wetland. itat $\frac{46}{16} + [(\% \text{ moderate and low intensity land uses})/2]^{-1} = \frac{47}{16}$	
Undisturbed habitat > 50% of Polygon Lindigitushed habitat > 10.50% and its 13. aarthos	-
lygon	
H 2.3. Land use intensity in 1 km Polygon: If > 50% of 1 km Polygon is light intensity land use - 10% of 1 km Polygon is light intensity land use	?
Add the points in the bo	0
ndscape Potential If score is: 4-6 = H 1-3 = M X<1 = L	first page
H 3.0. Is the habitat provided by the site valuable to society?	. 1
H 3.1. Does the site provide habitat for species valued in laws, regulations, or policies? Choose only the highest score that capplies to the wetford being orded.	
— It has 3 or more priority habitats within 100 m (see next page)	
 It provides habitat for Infrarence or Endangered Species (any plant or animal on the state or rederal lists) It is mapped as a location for an individual WDFW priority species It is a Wetland of High Conservation Value as determined by the Department of Natural Resources 	-
— It has been categorized as an important habitat site in a local or regional comprehensive plan, in a Shoreline Master Plan, or in a watershed plan within 100 m Site has 1 or 2 priority habitats (listed on next page) within 100 m	
n=1	

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

Wetland name or number Wetland D

WDFW Priority Habitats

Priority habitats listed by WDFW (see complete descriptions of WDFW priority habitats, and the counties in which they can be found, in: Washington Department of Fish and Wildlife. 2008. Priority Habitat and Species List. Olympia, Washington. 177 pp. http://wdfw.wa.gov/publications/00165/wdfw00165.pdf or access the list from here:


Count how many of the following priority habitats are within 330 ft (100 m) of the wetland unit. **NOTE**: This question is independent of the land use between the wetland unit and the priority habitat.

- Aspen Stands: Pure or mixed stands of aspen greater than 1 ac (0.4 ha).
- Biodiversity Areas and Corridors: Areas of habitat that are relatively important to various species of native fish and
 wildlife (full descriptions in WDFW PHS report).
- Herbaceous Balds: Variable size patches of grass and forbs on shallow soils over bedrock.
- Old-growth/Mature forests: Old-growth west of Cascade crest. Stands of at least 2 tree species, forming a multi-layered canopy with occasional small openings; with at least 8 trees/ac (20 trees/ha) > 32 in (81 cm) dbh or > 200 years of age. Mature forests. Stands with average diameters exceeding 21 in (53 cm) dbh, crown cover may be less than 100%; decay, decadence, numbers of snags, and quantity of large downed material is generally less than that found in old-growth; 80-200 years old west of the Cascade crest.
- Oregon White Oak: Woodland stands of pure oak or oak/conifer associations where canopy coverage of the oak
 component is important (full descriptions in WDFW PHS report p. 158 see web link above).
 - Riparian: The area adjacent to aquatic systems with flowing water that contains elements of both aquatic and terrestrial ecosystems which mutually influence each other.
- Westside Prairies: Herbaceous, non-forested plant communities that can either take the form of a dry prairie or a wet
 prairie (full descriptions in WDFW PHS report p. 161 see web link above).
- Instream: The combination of physical, biological, and chemical processes and conditions that interact to provide functional life history requirements for instream fish and wildlife resources.
- X Nearshore: Relatively undisturbed nearshore habitats. These include Coastal Nearshore, Open Coast Nearshore, and Puget Sound Nearshore. (full descriptions of habitats and the definition of relatively undisturbed are in WDFW report asee web link on previous page).
- Caves: A naturally occurring cavity, recess, void, or system of interconnected passages under the earth in soils, rock, ice, or other geological formations and is large enough to contain a human.
- Cliffs: Greater than 25 ft (7.6 m) high and occurring below 5000 ft elevation
- Talus: Homogenous areas of rock rubble ranging in average size 0.5 6.5 ft (0.15 2.0 m), composed of basalt, andesite, and/or sedimentary rock, including riprap slides and mine tailings. May be associated with cliffs.
- Snags and Logs: Trees are considered snags if they are dead or dying and exhibit sufficient decay characteristics to enable cavity excavation/use by wildlife. Priority snags have a diameter at breast height of > 20 in (51 cm) in western Washington and are > 6.5 ft (2 m) in height. Priority logs are > 12 in (30 cm) in diameter at the largest end, and > 20 ft (6 m) long.

Note: All vegetated wetlands are by definition a priority habitat but are not included in this list because they are addressed elsewhere.

Wetland Rating System for Western WA: 2014 Update Rating Form – Effective January 1, 2015

15

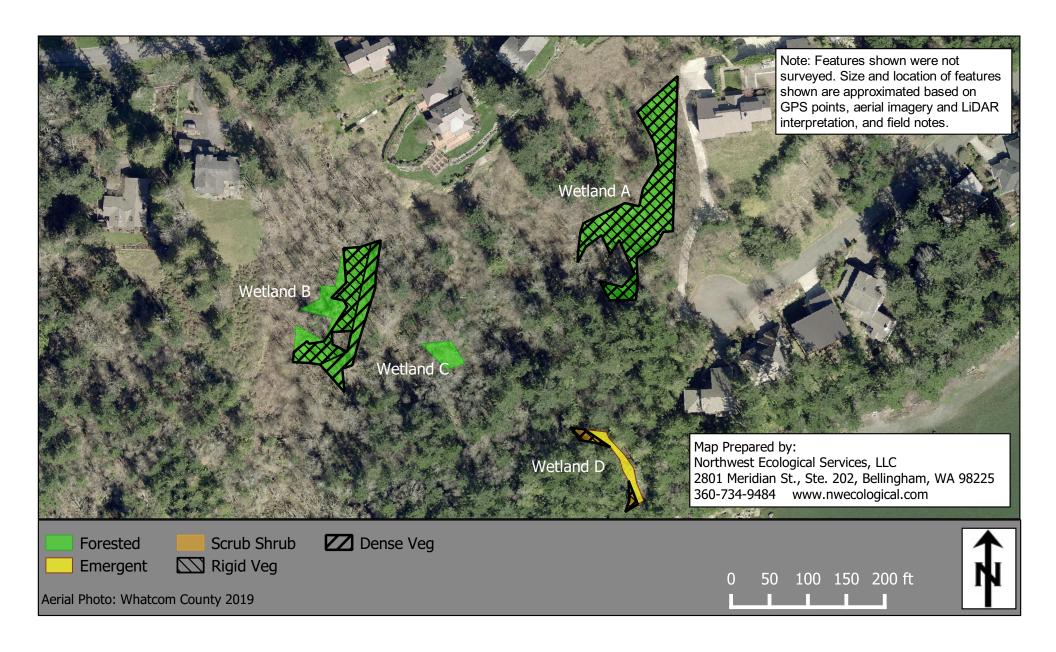





Wetland Rating Figure: Vegetation Map


The Woods at Viewcrest Wetland Delineation Update


Attachment A


FEB 2022

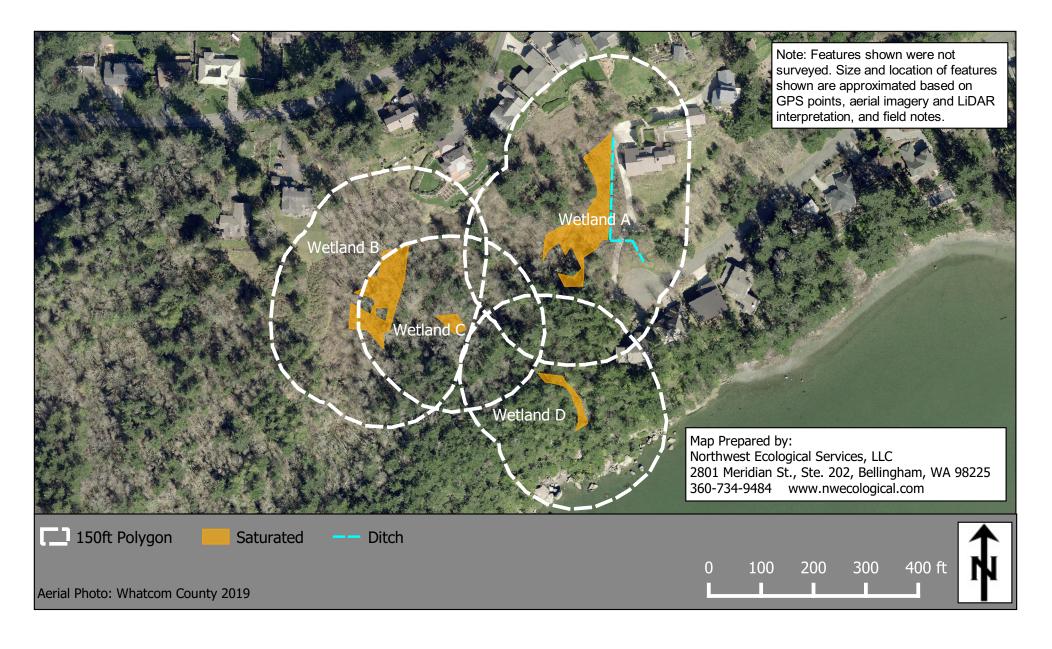


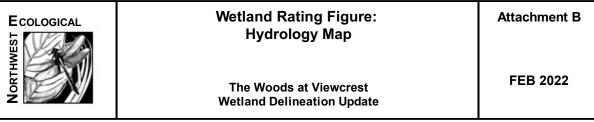

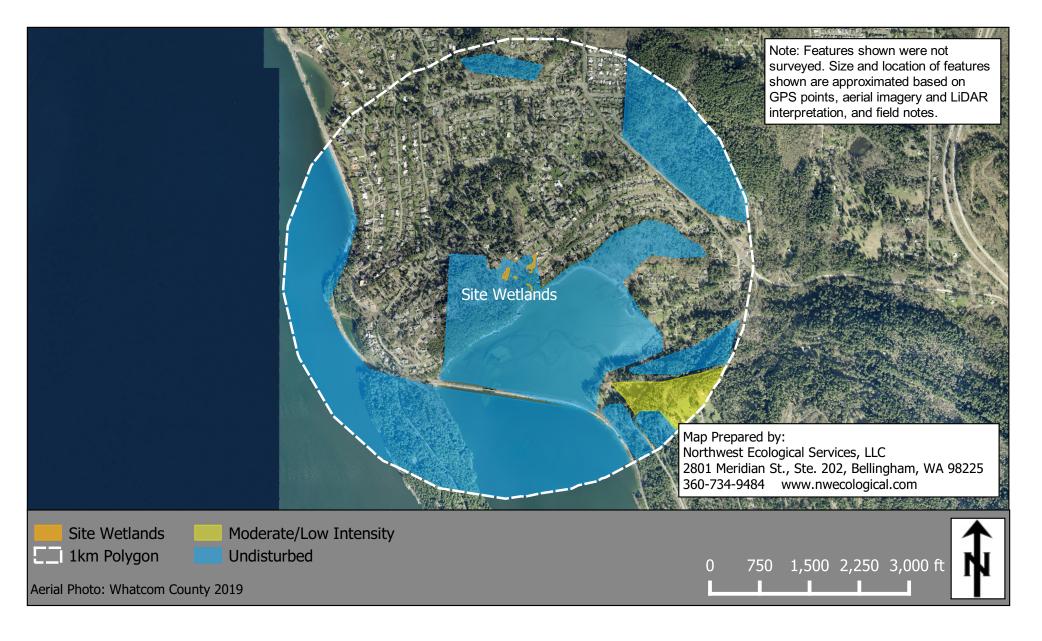

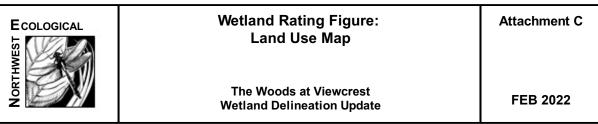

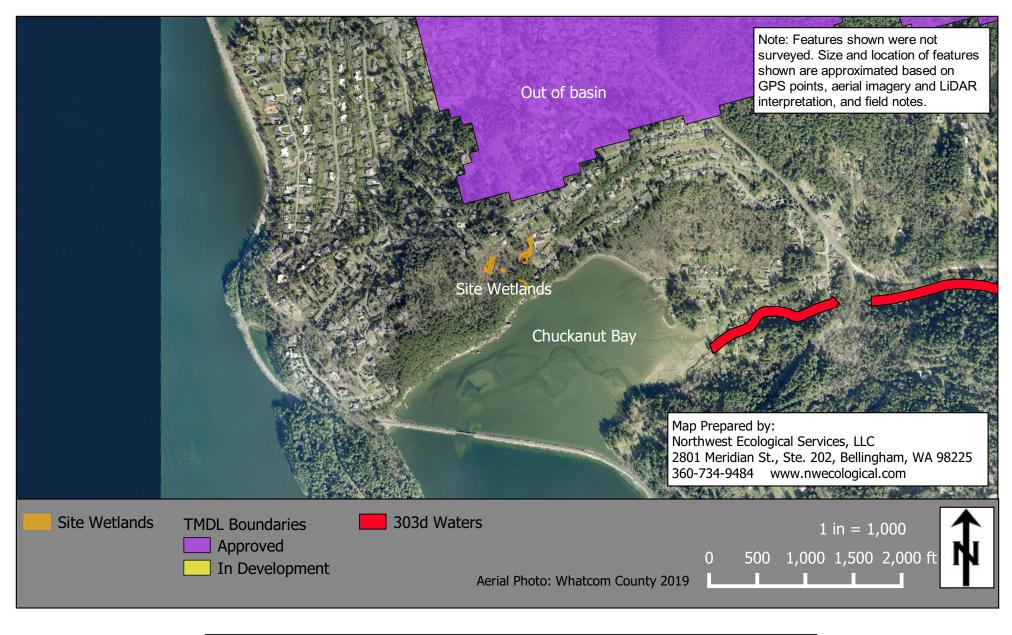

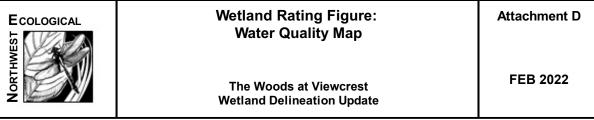

8.7 GULD FOR MODULAR WETLAND SYSTEM



August 2021

GENERAL USE LEVEL DESIGNATION FOR BASIC (TSS) ENHANCED AND PHOSPHORUS TREATMENT

For

MWS-Linear Modular Wetland

Ecology's Decision

Based on Modular Wetland Systems, Inc, application submissions, including the Technical Evaluation Report, dated April 1, 2014, Ecology hereby issues the following use level designation:

- 1. General Use Level Designation (GULD) for the MWS-Linear Modular Wetland Stormwater Treatment System for Basic, Phosphorus, and Enhanced treatment
 - Sized at a hydraulic loading rate of:
 - 1 gallon per minute (gpm) per square foot (sq ft) of Wetland Cell Surface Area
 - Prefilter box (approved at either 22 inches or 33 inches tall)
 - 3.0 gpm/sq ft of prefilter box surface area for moderate pollutant loading rates (low to medium density residential basins).
 - 2.1 gpm/sq ft of prefilter box surface area for high pollutant loading rates (commercial and industrial basins).
- 2. Ecology approves the MWS Linear Modular Wetland Stormwater Treatment System units for Basic, Phosphorus, and Enhanced treatment at the hydraulic loading rate listed above. Designers shall calculate the water quality design flow rates using the following procedures:
 - Western Washington: For treatment installed upstream of detention or retention, the water quality design flow rate is the peak 15-minute water quality treatment design flow rate as calculated using the latest version of the Western Washington Hydrology Model or other Ecology- approved continuous runoff model.

- Eastern Washington: For treatment installed upstream of detention or retention, the water quality design flow rate is the peak 15-minute water quality treatment design flow rate as calculated using one of the three methods described in Chapter 2.2.5 of the Stormwater Management Manual for Eastern Washington (SWMMEW) or local manual.
- Entire State: For treatment installed downstream of detention, the water quality treatment design flow rate is the full 2-year release rate of the detention facility.
- 3. These use level designations have no expiration date but may be amended or revoked by Ecology, and are subject to the conditions specified below.

Ecology's Conditions of Use

Applicants shall comply with the following conditions:

- 1) Design, assemble, install, operate, and maintain the MWS Linear Modular Wetland Stormwater Treatment System units, in accordance with Modular Wetland Systems, Inc. applicable manuals and documents and the Ecology Decision.
- 2) Each site plan must undergo Modular Wetland Systems, Inc. review and approval before site installation. This ensures that site grading and slope are appropriate for use of a MWS Linear Modular Wetland Stormwater Treatment System unit.
- 3) MSW Linear Modular Wetland Stormwater Treatment System media shall conform to the specifications submitted to and approved by Ecology.
- 4) The applicant tested the MWS Linear Modular Wetland Stormwater Treatment System with an external bypass weir. This weir limited the depth of water flowing through the media, and therefore the active treatment area, to below the root zone of the plants. This GULD applies to MWS Linear Modular Wetland Stormwater Treatment Systems whether plants are included in the final product or not.
- 5) Maintenance: The required maintenance interval for stormwater treatment devices is often dependent upon the degree of pollutant loading from a particular drainage basin. Therefore, Ecology does not endorse or recommend a "one size fits all" maintenance cycle for a particular model/size of stormwater treatment technology.
 - Typically, Modular Wetland Systems, Inc. designs MWS Linear Modular Wetland systems for a target prefilter media life of 6 to 12 months.
 - Indications of the need for maintenance include effluent flow decreasing to below the design flow rate or decrease in treatment below required levels.
 - Owners/operators must inspect MWS Linear Modular Wetland systems
 for a minimum of twelve months from the start of post-construction
 operation to determine site-specific maintenance schedules and
 requirements. You must conduct inspections monthly during the wet
 season, and every other month during the dry season (According to the
 SWMMWW, the wet season in western Washington is October 1 to April

- 30. According to the SWMMEW, the wet season in eastern Washington is October 1 to June 30). After the first year of operation, owners/operators must conduct inspections based on the findings during the first year of inspections.
- Conduct inspections by qualified personnel, follow manufacturer's guidelines, and use methods capable fo determining either a decrease in treated effluent flowrate and/or a decrease in pollutant removal ability.
- When inspections are performed, the following findings typically serve as maintenance triggers:
 - Standing water remains in the vault between rain events, or
 - Bypass occurs during storms smaller than the design storm.
 - If excessive floatables (trash and debris) are present (but no standing water or excessive sedimentation), perform a minor maintenance consisting of gross solids removal, not prefilter media replacement.
 - Additional data collection will be used to create a correlation between pretreatment chamber sediment depth and pre-filter clogging (see *Issues to be Addressed by the Company* section below)
- 6) Discharges from the MWS Linear Modular Wetland Stormwater Treatment System units shall not cause or contribute to water quality standards violations in receiving waters.

Applicant: Modular Wetland Systems, Inc.

Applicant's Address: 5796 Armada Drive, Suite 250

Carlsbad, CA 92008

Application Documents:

Original Application for Conditional Use Level Designation, Modular Wetland System, Linear Stormwater Filtration System Modular Wetland Systems, Inc., January 2011

Quality Assurance Project Plan: Modular Wetland System – Linear Treatment System Performance Monitoring Project, draft, January 2011

Revised Application for Conditional Use Level Designation, Modular Wetland System, Linear Stormwater Filtration System Modular Wetland Systems, Inc., May 2011

Memorandum: Modular Wetland System-Linear GULD Application Supplementary Data, April 2014

Technical Evaluation Report: Modular Wetland System Stormwater Treatment System Performance Monitoring, April 2014

Applicant's Use Level Request:

 General Use Level Designation as a Basic, Enhanced, and Phosphorus treatment device in accordance with Ecology's Guidance for Evaluating Emerging Stormwater Treatment Technologies Technology Assessment Protocol – Ecology (TAPE) January 2011 Revision.

Applicant's Performance Claims:

- The MWS Linear Modular wetland is capable of removing a minimum of 80-percent of TSS from stormwater with influent concentrations between 100 and 200 mg/L.
- The MWS Linear Modular wetland is capable of removing a minimum of 50-percent of total phosphorus from stormwater with influent concentrations between 0.1 and 0.5 mg/L.
- The MWS Linear Modular wetland is capable of removing a minimum 30-percent of dissolved copper from stormwater with influent concentrations between 0.005 and 0.020 mg/L.
- The MWS Linear Modular wetland is capable of removing a minimum 60-percent of dissolved zinc from stormwater with influent concentrations between 0.02 and 0.30 mg/L.

Ecology's Recommendations:

Modular Wetland System, Inc. has shown Ecology, through laboratory and field-testing, that the MWS – Linear Modular Wetland Stormwater Treatment System filter system is capable of attaining Ecology's Basic, Phosphorus, and Enhanced treatment goals.

Findings of Fact:

Laboratory Testing

The MWS-Linear Modular wetland has the:

- Capability to remove 99 percent of total suspended solids (using Sil-Co-Sil 106) in a quarter-scale model with influent concentrations of 270 mg/L.
- Capability to remove 91 percent of total suspended solids (using Sil-Co-Sil 106) in laboratory conditions with influent concentrations of 84.6 mg/L at a flow rate of 3.0 gpm per square foot of media.
- Capability to remove 93 percent of dissolved Copper in a quarter-scale model with influent concentrations of 0.757 mg/L.
- Capability to remove 79 percent of dissolved Copper in laboratory conditions with influent concentrations of 0.567 mg/L at a flow rate of 3.0 gpm per square foot of media.

- Capability to remove 80.5-percent of dissolved Zinc in a quarter-scale model with influent concentrations of 0.95 mg/L at a flow rate of 3.0 gpm per square foot of media.
- Capability to remove 78-percent of dissolved Zinc in laboratory conditions with influent concentrations of 0.75 mg/L at a flow rate of 3.0 gpm per square foot of media.

Field Testing

- Modular Wetland Systems, Inc. conducted monitoring of an MWS-Linear (Model # MWS-L-4-13) from April 2012 through May 2013, at a transportation maintenance facility in Portland, Oregon. The manufacturer collected flow-weighted composite samples of the system's influent and effluent during 28 separate storm events. The system treated approximately 75 percent of the runoff from 53.5 inches of rainfall during the monitoring period. The applicant sized the system at 1 gpm/sq ft. (wetland media) and 3gpm/sq ft. (prefilter).
- Influent TSS concentrations for qualifying sampled storm events ranged from 20 to 339 mg/L. Average TSS removal for influent concentrations greater than 100 mg/L (n=7) averaged 85 percent. For influent concentrations in the range of 20-100 mg/L (n=18), the upper 95 percent confidence interval about the mean effluent concentration was 12.8 mg/L.
- Total phosphorus removal for 17 events with influent TP concentrations in the range of 0.1 to 0.5 mg/L averaged 65 percent. A bootstrap estimate of the lower 95 percent confidence limit (LCL95) of the mean total phosphorus reduction was 58 percent.
- The lower 95 percent confidence limit of the mean percent removal was 60.5 percent for dissolved zinc for influent concentrations in the range of 0.02 to 0.3 mg/L (n=11). The lower 95 percent confidence limit of the mean percent removal was 32.5 percent for dissolved copper for influent concentrations in the range of 0.005 to 0.02 mg/L (n=14) at flow rates up to 28 gpm (design flow rate 41 gpm). Laboratory test data augmented the data set, showing dissolved copper removal at the design flow rate of 41 gpm (93 percent reduction in influent dissolved copper of 0.757 mg/L).

Issues to be addressed by the Company:

- 1. Modular Wetland Systems, Inc. should collect maintenance and inspection data for the first year on all installations in the Northwest in order to assess standard maintenance requirements for various land uses in the region. Modular Wetland Systems, Inc. should use these data to establish required maintenance cycles.
- 2. Modular Wetland Systems, Inc. should collect pre-treatment chamber sediment depth data for the first year of operation for all installations in the Northwest. Modular Wetland Systems, Inc. will use these data to create a correlation between sediment depth and pre-filter clogging.

Technology Description:

Download at http://www.modularwetlands.com/

Contact Information:

Applicant: Zach Kent

BioClean A Forterra Company 5796 Armada Drive, Suite 250

Carlsbad, CA 92008

zach.kent@forterrabp.com

Applicant website: http://www.modularwetlands.com/

Ecology web link: http://www.ecy.wa.gov/programs/wg/stormwater/newtech/index.html

Ecology: Douglas C. Howie,

P.E. Department of Ecology Water Quality Program

(360) 870-0983

douglas.howie@ecy.wa.gov

Revision History

Date	Revision
June 2011	Original use-level-designation document
September 2012	Revised dates for TER and expiration
January 2013	Modified Design Storm Description, added Revision Table, added maintenance discussion, modified format in accordance with Ecology
	standard
December 2013	Updated name of Applicant
April 2014	Approved GULD designation for Basic, Phosphorus, and Enhanced treatment
December 2015	Updated GULD to document the acceptance of MWS – Linear Modular Wetland installations with or without the inclusion of plants
July 2017	Revised Manufacturer Contact Information (name, address, and email)
December 2019	Revised Manufacturer Contact Address
July 2021	Added additional prefilter sized at 33 inches
August 2021	Changed "Prefilter" to "Prefilter box"