

APPROVED

City Engineer

Date

CITY OF BELLINGHAM


1" SINGLE/DUAL WATER SERVICE

DRAWING

WA-830
1 of 2

NOTES:

1. CONTRACTOR SHALL PROVIDE AND INSTALL WATER SERVICE FROM THE MAIN TO THE CURB STOP. CITY WILL PROVIDE AND INSTALL METER BOX/LID, METER SETTER, METER AND TAIL PIPE OUT OF METER BOX.
2. ALL SERVICE TAPS TO LIVE WATER MAINS ARE TO BE PERFORMED ONLY BY THE CITY.
3. TAPPING HOLE SHALL BE THE SAME DIAMETER AS THE SERVICE TAP IF THE PIPE IS DRY OR NOT IN SERVICE.
4. THERE SHALL BE A MINIMUM OF TWO FEET SEPARATION BETWEEN WATER TAPS TO THE WATER MAIN AND TAPS SHALL BE A MINIMUM TWO FEET FROM ANY FITTING.
5. ALL UNDERGROUND FITTINGS SHALL BE FORD BRASS OR APPROVED EQUAL AND FLARED WITHIN THE PUBLIC RIGHT-OF-WAY. NO SWEAT OR COMPRESSION CONNECTIONS ARE TO BE USED. THE USE OF TEFLON TAPE FOR THREAD SEALING IS ACCEPTABLE, THE USE OF PIPE DOPE IS NOT ACCEPTABLE.
6. TEFLON BALL TYPE CURB STOPS ARE NOT ALLOWED.
7. PROVIDE A MINIMUM CLEARANCE OF 1" TO CORPORATION STOP, METER AND SETTER INSIDE METER BOX.
8. NO SERVICES SHALL BE BACKFILLED UNTIL INSPECTED AND APPROVED BY THE CITY INSPECTOR.
9. METER BOX SHALL HAVE CLEARANCE TO THE WATER SERVICE PIPE AND SHALL NOT TOUCH OR REST ON THE WATER SERVICE PIPE.
10. NON-METALLIC WATER SERVICE PIPES SHALL HAVE A CORROSION-RESISTANT BLUE INSULATED 14 AWG COPPER TRACER WIRE SUITABLE FOR DIRECT BURIAL PER THE UNIFORM PLUMBING CODE SECTION 604.10.1.

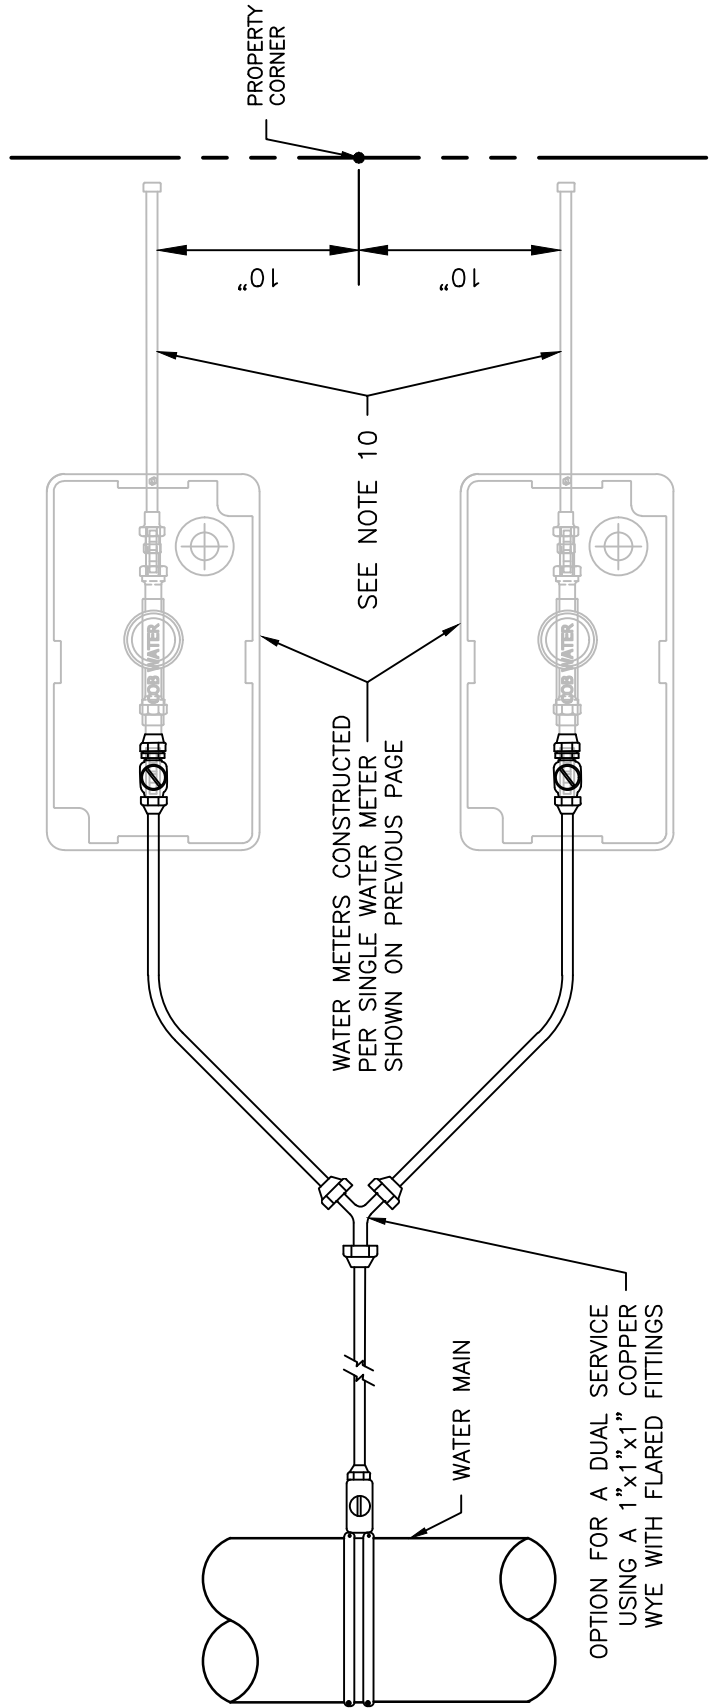

OPTION FOR A DUAL SERVICE USING A 1"x1"x1" COPPER WYE WITH FLARED FITTINGS

APPROVED

City Engineer

Date

CITY OF BELLINGHAM

1" SINGLE/DUAL WATER SERVICE

DRAWING

WA-830
2 of 2